
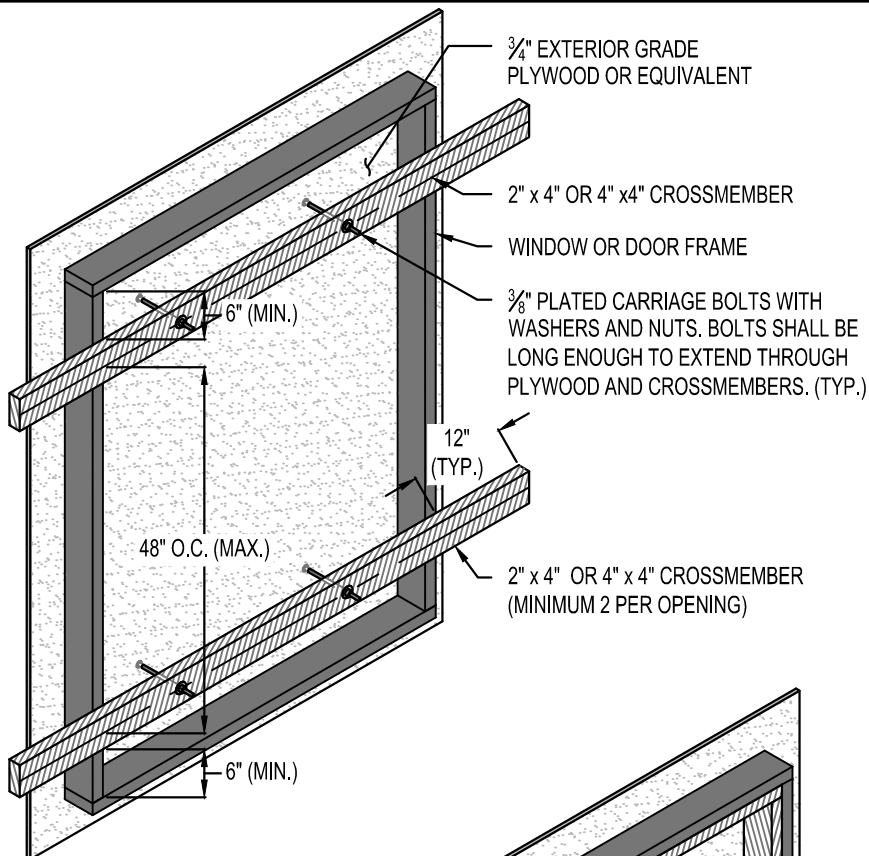




**FIGURE A - BOARDING
OF WINDOW OR DOOR**

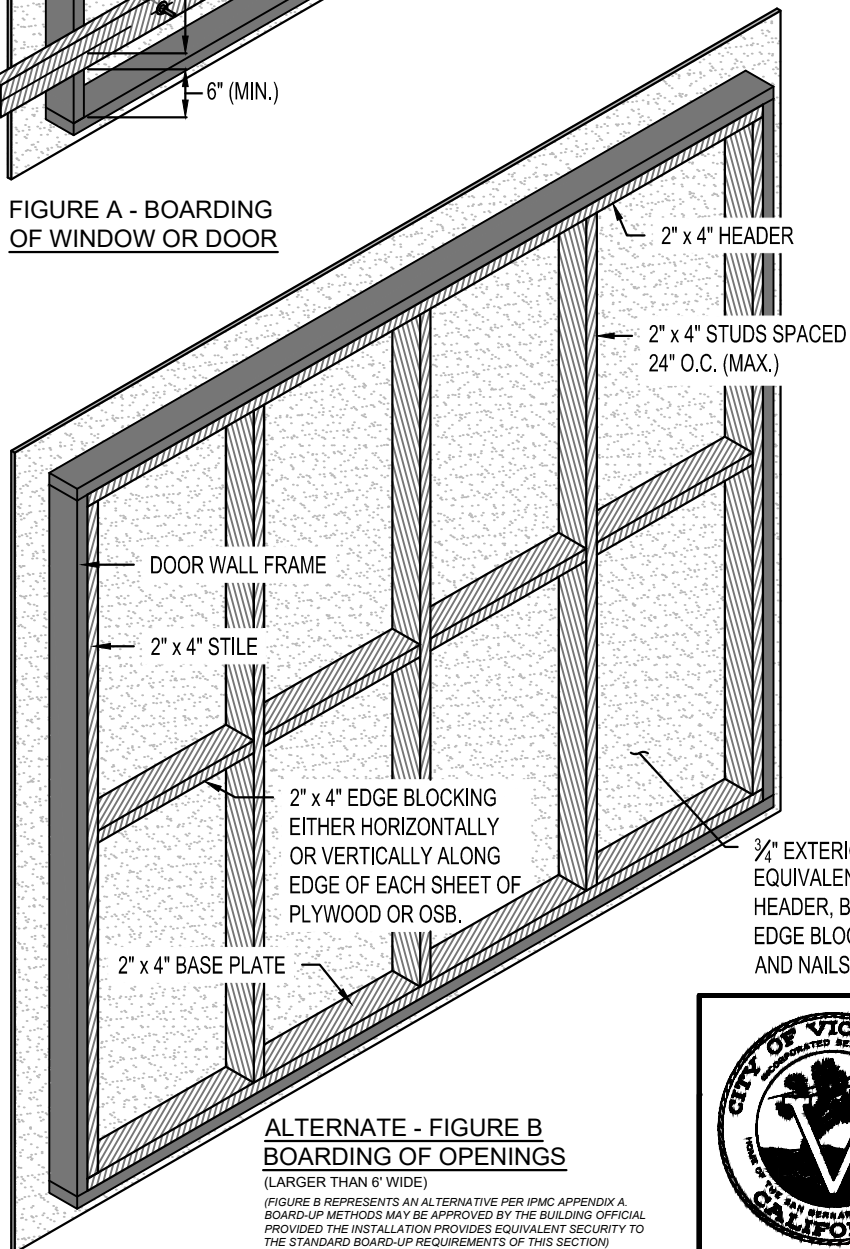

**ALTERNATE - FIGURE B
BOARDING OF OPENINGS
(LARGER THAN 6' WIDE)**

(FIGURE B REPRESENTS AN ALTERNATIVE PER IPCM APPENDIX A. BOARD-UP METHODS MAY BE APPROVED BY THE BUILDING OFFICIAL PROVIDED THE INSTALLATION PROVIDES EQUIVALENT SECURITY TO THE STANDARD BOARD-UP REQUIREMENTS OF THIS SECTION.)

INSTALLATION NOTES:

1. BOARDING MATERIAL SHALL CONSIST OF MINIMUM 3/4-INCH EXTERIOR-GRADE PLYWOOD OR EQUIVALENT AND SHALL BE CUT TO FIT THE DOOR OR WINDOW OPENING NEATLY OR SHALL PROVIDE AN EQUAL OVERLAP AT THE PERIMETER OF THE DOOR OR WINDOW OPENING.
2. **WINDOWS/ DOORS** SHALL BE OPENED TO ALLOW THE CARRIAGE BOLT TO PASS THROUGH OR THE WINDOW SASH SHALL BE REMOVED AND STORED. 2-INCH BY 4-INCH OR 4-INCH BY 4-INCH CROSSMEMBERS SHALL BE PLACED ON THE INTERIOR SIDE OF THE WINDOW OPENING AND SHALL EXTEND A MINIMUM OF 12 INCHES BEYOND EACH SIDE OF THE WINDOW OPENING. A MINIMUM OF TWO CONTINUOUS CROSSMEMBERS SHALL BE PROVIDED AT EACH WINDOW OPENING. CROSSMEMBERS AND BOARDING MATERIAL SHALL BE PREDRILLED. THE ASSEMBLY SHALL BE ALIGNED AND SECURED WITH 3/8-INCH PLATED CARRIAGE BOLTS, WASHERS, AND NUTS. BOLTS SHALL BE INSTALLED THROUGH THE PLYWOOD AND CROSSMEMBERS AND SHALL BE THREADED TO THE CORRECT LENGTH AND TIGHTENED SECURELY.
3. **OPENINGS (LARGER THAN 6- FEET WIDE)** SHALL BE SECURED WITH MINIMUM 3/4-INCH EXTERIOR-GRADE PLYWOOD OR EQUIVALENT, SUPPORTED BY 2-INCH BY 4-INCH OR 4-INCH BY 4-INCH CROSSMEMBERS. A MINIMUM OF TWO CONTINUOUS CROSSMEMBERS SHALL BE PROVIDED AT EACH DOOR OPENING AND SHALL EXTEND A MINIMUM OF 12 INCHES BEYOND EACH SIDE OF THE DOOR OPENING. CROSSMEMBERS SHALL BE SECURED TO THE PLYWOOD WITH 3/8-INCH PLATED CARRIAGE BOLTS, WASHERS, AND NUTS. BOLTS SHALL BE INSTALLED THROUGH THE PLYWOOD AND CROSSMEMBERS AND SHALL BE THREADED TO THE CORRECT LENGTH AND TIGHTENED SECURELY.
4. ALL DOORS, WINDOWS, AND OTHER BUILDING OPENINGS SHALL BE CLOSED, SECURED, AND LOCKED IN AN APPROVED MANNER TO PREVENT UNAUTHORIZED ACCESS.
5. ALL BROKEN GLAZING SHALL BE REMOVED PRIOR TO BOARDING UP WINDOW OR DOOR OPENING.
6. EXTERIOR PLYWOOD AND STUDS SHALL BE PAINTED TO MATCH EXTERIOR PRIMARY STRUCTURE.
7. THE BUILDING OFFICIAL MAY REQUIRE ADDITIONAL FRAMING, CROSSMEMBERS, OR ALTERNATIVE METHODS AS NECESSARY BASED ON OPENING SIZE, CONDITION, OR FIELD CONDITIONS.



Development Department
Building Division

BOARDING OF DOOR OR WINDOW DETAILS

14343 Civic Drive
Victorville, CA 92393

(760) 955-5100
Fax (760) 269-0072

7/16/2026