



STANDARD DRAWINGS

APRIL 2026

**City of Victorville
Engineering Department**

STREET IMPROVEMENTS

Street Improvement Standard Drawings Index	S-INDEX
Standard Curb and Gutter	S-01
Residential Drive Approach, Type 1, Type 2 and Type 3 (3 Sheets)	S-02
Commercial Drive Approach, Type 1, Type 2 and Type 3 (3 Sheets)	S-03
Standard Commercial and Residential Sidewalk	S-04
Standard Cross Gutter	S-05
Barricade Details	S-06
Standard Manhole/Clean-Out Frame and Cover Installation	S-07
Blank Intentionally	S-08
Standard Curb	S-09
Trench Backfill and Pavement Repairs (2 Sheets)	S-10
Curb Ramp (8 Sheets)	S-11
Fire Hydrant Location	S-12
Corner Utility Location	S-13
P.L.S.S. Survey Monumentation Replacement	S-14
Blank Intentionally	S-15
Centerline Survey Ties, Standard 1	S-16
Centerline Survey Ties, Standard 2	S-17
Slope and Parkway Grading Requirements	S-18
Blank Intentionally	S-19
Standard Cutoff Wall for Drainage Channel	S-20
Street Geometric Cross-Sections (4 Sheets)	S-21
Metal Hand Railings (2 Sheets).....	S-22
Blank Intentionally	S-23
Rural Street Section	S-24
Street Design Standards (5 Sheets)	S-25
Typical Cul-de-Sac.....	S-26
Offset Cul-de-Sac	S-27
Standard Knuckle	S-28
Internally Illuminated Street Name Sign (I.I.S.N.S.)	S-29
Internally Illuminated Street Name Sign Safety Cable	S-30
Stop Bar, Legend Detail, and Stop Sign Location.....	S-31
Street Name Sign Installation.....	S-32
Micro-Utility Trenching for Fiber Optic Cable	S-33
Standard Commercial Cobblestone Median	S-34

TRAFFIC IMPROVEMENTS

Traffic Improvement Standard Drawings Index	T-INDEX
Blank Intentionally	T-01
Blank Intentionally	T-02
Blank Intentionally	T-03
Blank Intentionally	T-04
Intersection Display Panel	T-05
R Cabinet Foundation Layout	T-06
R Cabinet Equipment Layout	T-07
Detector Rack Layout	T-08
Pedestrian Push Button Post	T-09

DRAINAGE IMPROVEMENTS

Drainage Improvement Standard Drawings Index	D-INDEX
Standard Wash Crossing	D-01A
Channel Crossing in Existing Rural Residential Areas Only	D-01B
Standard Drop Inlet (4 Sheets)	D-02
Curb Opening Catch Basin with Gratings	D-03
Storm Drain Manhole Frame and Cover	D-04
Precast Storm Drain Manhole	D-05
Dry Well System Details (2 Sheets)	D-06
Dry Well and Interceptor	D-07

GENERAL SURFACE IMPROVEMENTS

General Surface Improvement Standard Drawings Index	GS-INDEX
Circular Driveway (2 Sheets)	GS-01
Hammerhead Driveway, Type 1 (2 Sheets)	GS-02
Hammerhead Driveway, Type 2 (2 Sheets)	GS-03
Hammerhead Driveway, Type 3 (2 Sheets)	GS-04
Hammerhead Driveway, Type 4 (2 Sheets)	GS-05
Hammerhead Driveway, Type 5 (2 Sheets)	GS-06

SANITARY SEWER IMPROVEMENTS

Sanitary Sewer Improvement Standard Drawings Index	SS-INDEX
Sanitary Sewer Manhole.....	SS-01
Sanitary Sewer 30" Manhole Frame and Cover.....	SS-02
Sewer Laterals	SS-03
Cleanouts (2 Sheets).....	SS-04
PVC Sewer Pipe Bedding (2 Sheets)	SS-05
Clean-Out Frame and Cover	SS-06
Sanitary Sewer Drop Manhole	SS-07
Sanitary Sewer Manhole with Internal Sewer Main Drop	SS-07A
Temporary Sand Trap	SS-08
Sanitary Sewer Saddle	SS-09
Blank Intentionally	SS-10




WATER IMPROVEMENTS

Water Improvement Standard Drawings Index	W-INDEX
Typical Service Installation for 3/4" and 1" Meters	W-01
Blank Intentionally	W-02
Typical Service Installation for 1-1/2" and 2" Meters	W-03
3" Domestic Service (2 Sheets)	W-04
4" Domestic Service (2 Sheets)	W-05
6" Domestic Service in Vault (2 Sheets)	W-06
Blank Intentionally	W-07
Blank Intentionally	W-08
Blank Intentionally	W-09
Meter Box Placement	W-10
Standard Fire Hydrant	W-11
Blow-Off Fire Hydrant	W-12
Typical Fire Hydrant Pavement Marker Installation	W-13
Phase Break End	W-14
Temporary Blow-Off Assembly, 2"	W-15
4" Blow-Off Assembly	W-16
6" Blow-Off Assembly	W-17
Valve Can Assembly	W-18
Valve Operator Extension	W-19
Typical Butterfly Valve Operator Locations	W-20
Hot Tap Detail - AC, PVC, DIP	W-21
Tapping Outlet - For Steel Pipe	W-22
Welded Steel Pipe Butt-Joint with Handhole	W-23
Standard 1" Air and Vacuum Release Valve Assembly	W-24
Standard 2" Air and Vacuum Release Valve Assembly	W-25
Standard 4" Air and Vacuum Release Valve Assembly	W-26
Air & Vacuum Valve Enclosure	W-27
Fire Service - Reduced Pressure Detector Assembly (2 Sheets)	W-28
Blank Intentionally	W-29
3" and Larger - Reduced Pressure Backflow Device Installation (2 Sheets)	W-30
LMAD Backflow Device Installation (2 Sheets)	W-31
Blank Intentionally	W-32
Vault and Lid	W-33
Separation Criteria for Existing Water Mains from New Sanitary Sewers or Storm Drains	W-34
Separation Criteria for New Water Mains from Existing Sanitary Sewers or Storm Drains	W-35
Typical Trench / Pipe Zone Backfill Schematic	W-36
Water Mains Undercrossing Sewer and Storm Drain - CMLC Steel Pipe	W-37
Water Mains Undercrossing Sewer and Storm Drain - Steel Sleeve Casing	W-38
2" and Smaller - Reduced Pressure Backflow Device Installation	W-39
Minimum Protection for Filling Water Trucks	W-40
Cutting and Plugging Abandoned Water Mains	W-41
Guard Post	W-42

DRAWING INDEX

S-01	STANDARD CURB & GUTTER
S-02	RESIDENTIAL DRIVE APPROACH (3 SHEETS)
S-03	STANDARD COMMERCIAL DRIVE APPROACH (3 SHEETS)
S-04	STANDARD COMMERCIAL AND RESIDENTIAL SIDEWALK
S-05	STANDARD CROSS GUTTER
S-06	BARRICADE DETAILS
S-07	STANDARD MANHOLE/CLEAN-OUT FRAME AND COVER INSTALLATION
S-08	BLANK INTENTIONALLY
S-09	STANDARD CURB
S-10	TRENCH BACKFILL AND PAVEMENT REPAIRS (2 SHEETS)
S-11	CURB RAMP (8 SHEETS)
S-12	FIRE HYDRANT LOCATION
S-13	CORNER UTILITY LOCATION
S-14	P.L.S.S SURVEY MONUMENTATION REPLACEMENT
S-15	BLANK INTENTIONALLY
S-16	CENTERLINE SURVEY TIES STANDARD 1
S-17	CENTERLINE SURVEY TIES STANDARD 2
S-18	SLOPE AND PARKWAY GRADING REQUIREMENTS
S-19	BLANK INTENTIONALLY
S-20	STANDARD CUTOFF WALL FOR DRAINAGE CHANNEL
S-21	STANDARD STREET CROSS-SECTIONS (4 SHEETS)
S-22	METAL HAND RAILINGS (2 SHEETS)
S-23	BLANK INTENTIONALLY
S-24	RURAL STREET SECTION
S-25	STREET DESIGN STANDARDS (5 SHEETS)
S-26	TYPICAL CUL-DE-SAC
S-27	OFFSET CUL-DE-SAC
S-28	STANDARD KNUCKLE
S-29	INTERNALLY ILLUMINATED STREET NAME SIGN (I.I.S.N.S)
S-30	INTERNALLY ILLUMINATED STREET NAME SIGN (I.I.S.N.S.) SAFETY CABLE
S-31	STOP BAR, LEGEND DETAIL, AND STOP SIGN LOCATION
S-32	STREET NAME SIGN INSTALLATION
S-33	MICRO-UTILITY TRENCHING FOR FIBER OPTIC CABLE
S-34	STANDARD COMMERCIAL COBBLESTONE MEDIAN

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	STREET IMPROVEMENT STANDARD DRAWINGS INDEX	S-INDEX
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

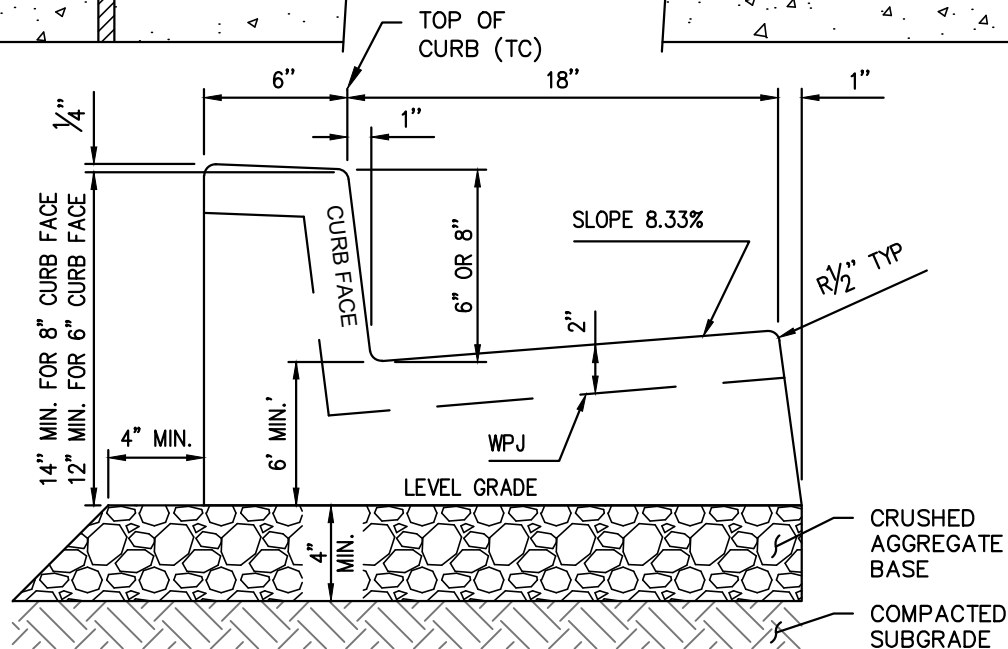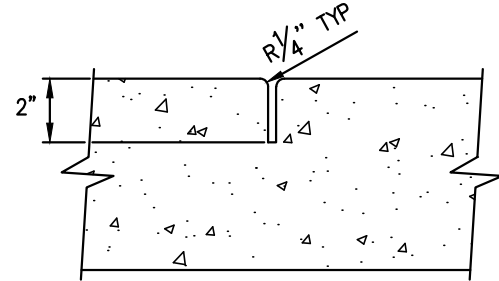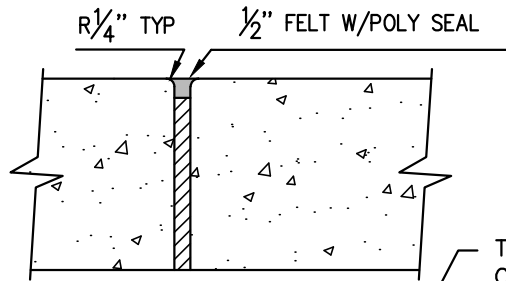

STANDARD CURB & GUTTER


NOT TO SCALE

NOTES:

1. THE CURB FACE SHALL BE 6" FOR RESIDENTIAL/LOCAL ROADS WITH 8" FOR COLLECTOR/ARTERIAL AND COMMERCIAL/INDUSTRIAL ROADS.
2. THE CURB & GUTTER SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
3. THE CURB & GUTTER SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK.
4. THE SURFACE OF THE CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
5. THE CURB & GUTTER SHALL BE CONSTRUCTED ON A MINIMUM 4" THICK LAYER OF CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 8" MINIMUM 90% RELATIVE COMPACTED NATIVE SUBGRADE.
6. CRUSHED AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR 26-1.02B OF THE CALTRANS SPECIFICATIONS.
7. WEAKENED PLANE JOINTS SHALL BE AT LEAST 2" DEEP AND CONSTRUCTED AT 10' INTERVALS. COLD JOINTS BETWEEN WEAKENED PLANE JOINTS ARE PROHIBITED.
8. EXPANSION JOINTS SHALL BE CONSTRUCTED AT ALL CURB RETURNS, DRIVEWAY APPROACHES AND 60' INTERVALS.
9. EXPANSION JOINTS SHALL BE ½" WIDE FELT PLACED ¾" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT. SEE STD S-04.
10. IF EXISTING CURB & GUTTER IS TO BE REMOVED, IT SHALL BE SCORED AT LEAST 1" DEEP WITH A CONCRETE SAW PRIOR TO REMOVAL. IF THE SAWCUT LINE IS CLOSER THAN 2' TO AN EXPANSION JOINT OR WEAKENED PLANE JOINT, THE CURB AND GUTTER SHALL BE REMOVED TO THE EXPANSION OR WEAKENED PLANE JOINT.
11. GUTTER SHALL HAVE ROUGH BROOM FINISH WITH 2" SHINER AT FLOW LINE.
13. CONCRETE CYLINDER COMPRESSIVE STRENGTH TEST RESULTS, ASTM C31/C39, SHALL BE PROVIDED FOR BUT NOT LIMITED TO: DRIVE APPROACH AND CURB RETURN LOCATIONS.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STANDARD CURB & GUTTER	S-01
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

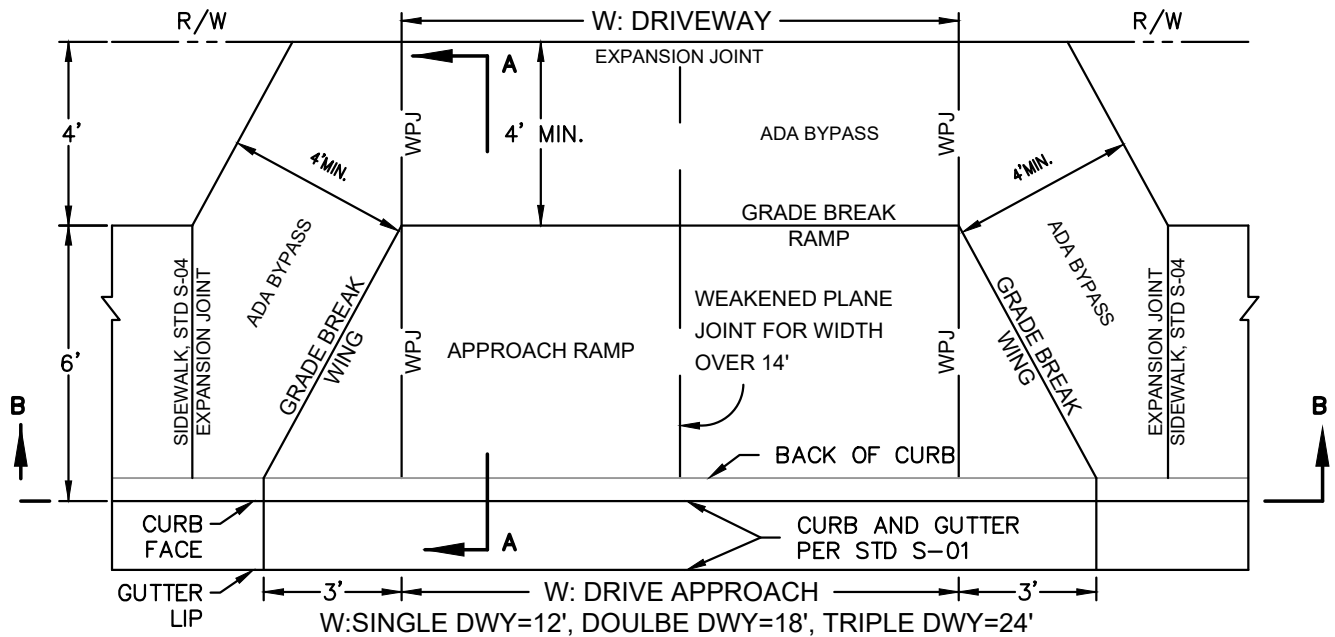


PLAN VIEW

(N.T.S.)

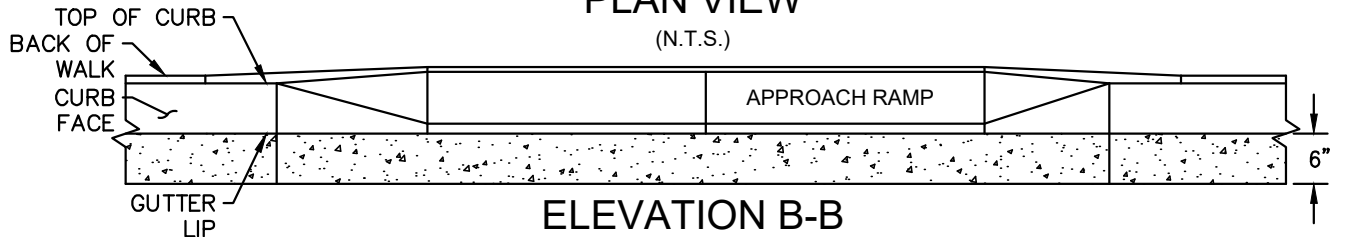

ELEVATION B-B

(N.T.S.)

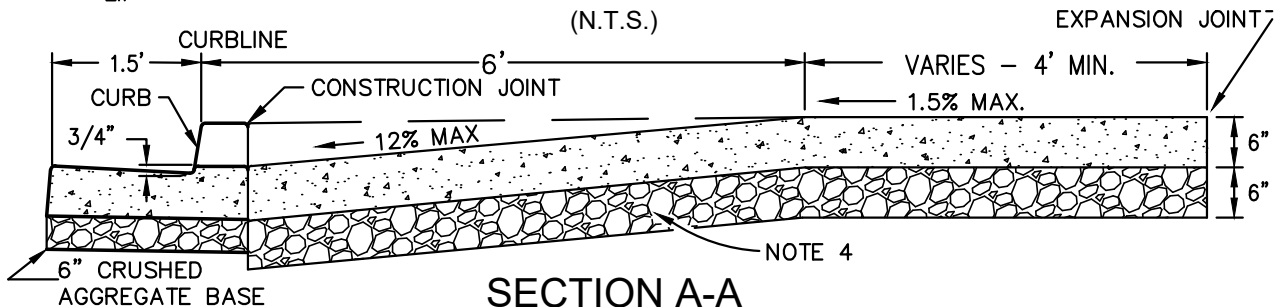

SECTION A-A




(N.T.S.)

NOTES:

1. THE DRIVE APPROACH SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE DRIVE APPROACH SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK. COMPRESSIVE STRENGTH TEST RESULTS PER ASTM C39 SHALL BE PROVIDED.
3. THE SURFACE OF THE CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
4. THE DRIVE APPROACH SHALL BE CONSTRUCTED ON A MINIMUM 6" THICK LAYER OF NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 8" MINIMUM 90% RELATIVE COMPACTION NATIVE SUBGRADE.
5. CRUSHED AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR SECTION 26-1.02B OF THE CALTRANS SPECIFICATIONS.
6. WEAKENED PLANE JOINTS (WPJ) SHALL BE AT LEAST 2" DEEP.
7. EXPANSION JOINTS SHALL BE CONSTRUCTED AT BOTH ENDS OF DRIVEWAY APPROACHES.
8. EXPANSION JOINTS SHALL BE 1/2" FELT PLACED 3/4" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT. SEE STD S-04.
9. THE DRIVE APPROACH SHALL BE ALIGNED WITH GARAGE DOOR(S) OR CARPORT AND BE PERPENDICULAR TO THE CURB. SPECIAL CIRCUMSTANCES MAY APPLY TO THE BULB OF CUL-DE-SACS AND KNUCKLES (SEE S-02 TYPE 2 & 3).
10. THE DRIVE APPROACH SHALL BE MEDIUM BROOM FINISH.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	RESIDENTIAL DRIVE APPROACH TYPE 1	S-02
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 3

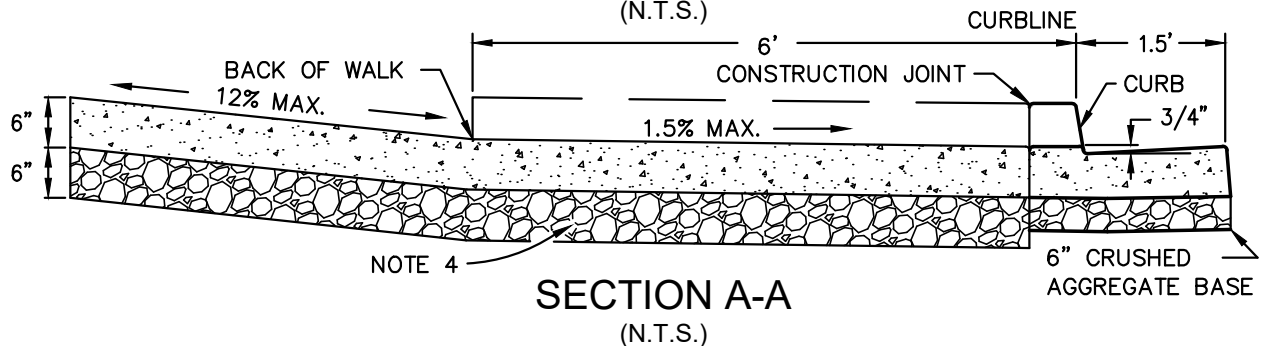
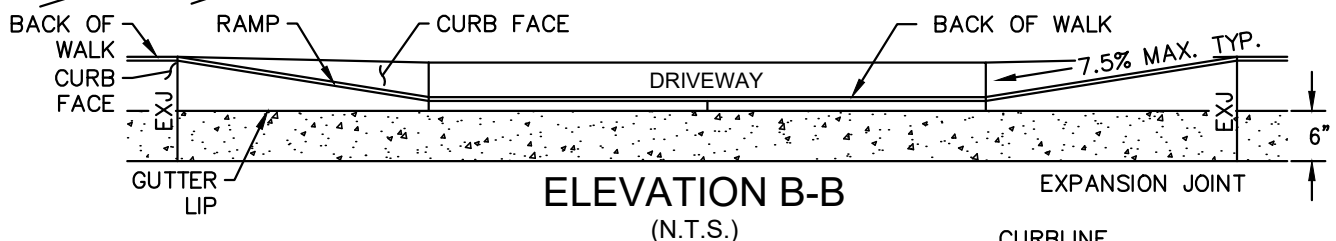
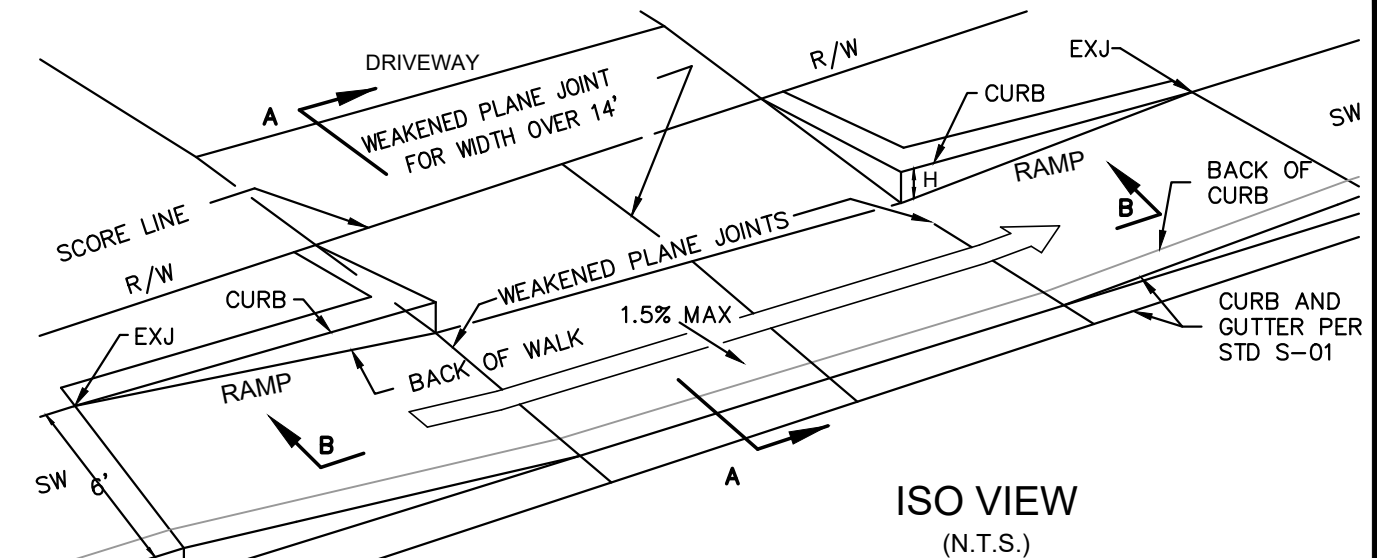


NOTES:

1. THE DRIVE APPROACH SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE DRIVE APPROACH SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK. COMPRESSIVE STRENGTH TEST RESULTS PER ASTM C39 SHALL BE PROVIDED.
3. THE SURFACE OF THE CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
4. THE DRIVE APPROACH SHALL BE CONSTRUCTED ON A MINIMUM 6" THICK LAYER OF NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 8" MINIMUM 90% RELATIVE COMPACTION NATIVE SUBGRADE.
5. AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR SECTION 26-1.02B OF THE CALTRANS SPECIFICATIONS.
6. WEAKENED PLANE JOINTS (WPJ) SHALL BE AT LEAST 2" DEEP.
7. EXPANSION JOINTS SHALL BE CONSTRUCTED AT BOTH ENDS OF DRIVEWAY APPROACH AND BETWEEN APPROACH & DRIVEWAY.
8. EXPANSION JOINTS (EXJ) SHALL BE 1/2" FELT PLACED 3/4" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT. SEE STD S-04.
9. THE DRIVE APPROACH SHALL BE ALIGNED WITH GARAGE DOOR(S) OR CARPORT AND BE PERPENDICULAR TO THE CURB.
10. THE DRIVE APPROACH SHALL BE MEDIUM BROOM FINISH.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	RESIDENTIAL DRIVE APPROACH TYPE 2	S-02
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 3

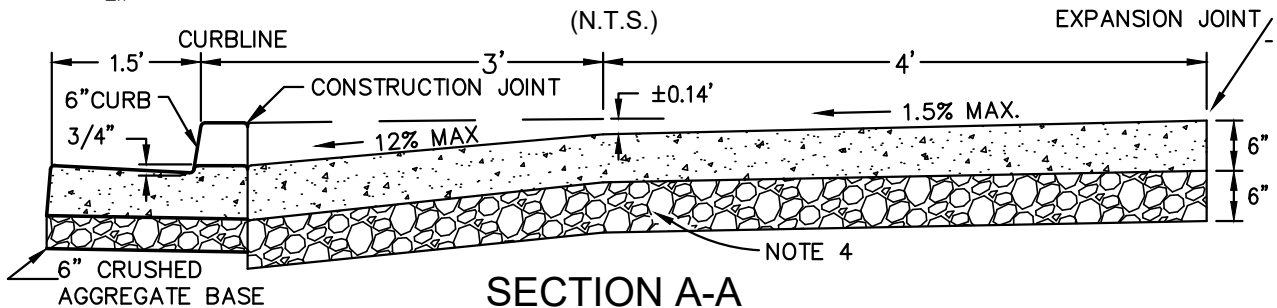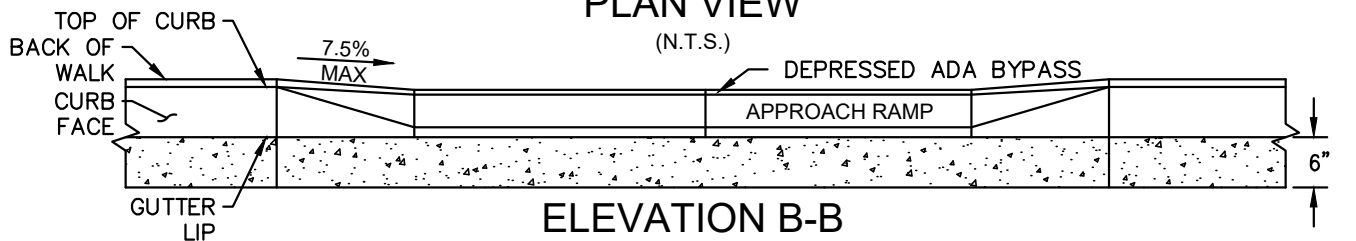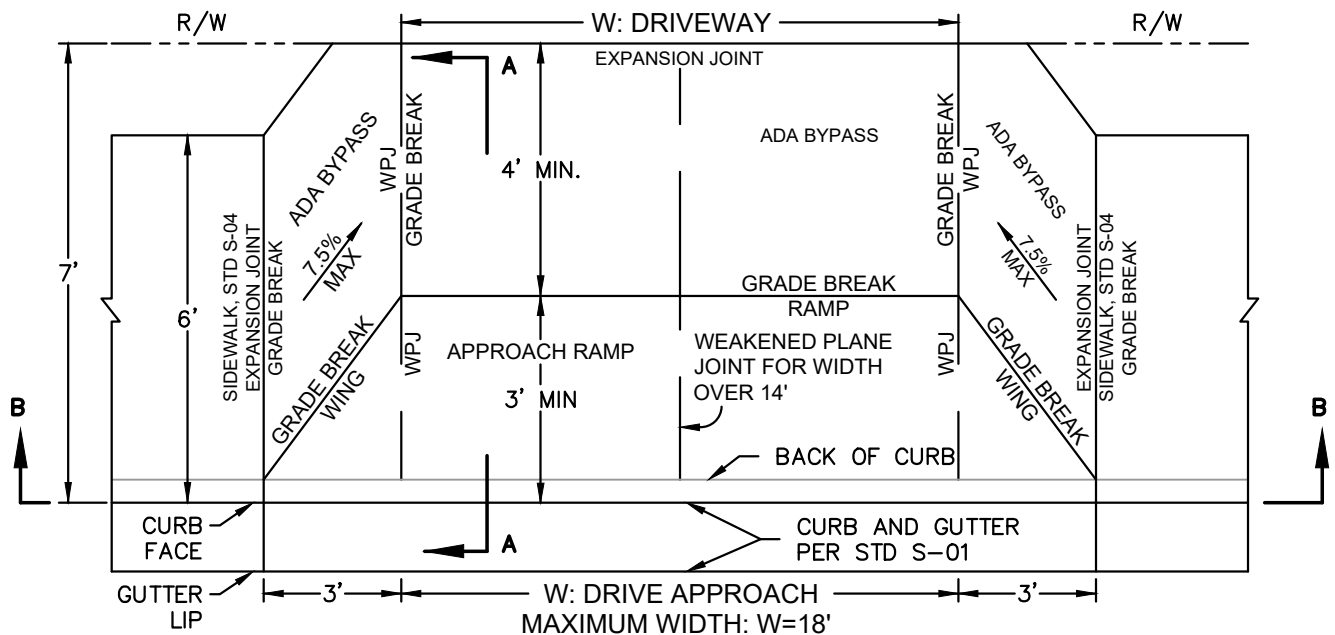


NOTES:




1. THE DRIVE APPROACH SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE DRIVE APPROACH SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK. COMPRESSIVE STRENGTH TEST RESULTS PER ASTM C39 SHALL BE PROVIDED.
3. THE SURFACE OF THE CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
4. THE DRIVE APPROACH SHALL BE CONSTRUCTED ON A MINIMUM 6" THICK LAYER OF NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 8" MINIMUM 90% RELATIVE COMPACTION NATIVE SUBGRADE.
5. CRUSHED AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR SECTION 26-1.02B OF THE CALTRANS SPECIFICATIONS.
6. WEAKENED PLANE JOINTS (WPJ) SHALL BE AT LEAST 2" DEEP.
7. EXPANSION JOINTS SHALL BE CONSTRUCTED AT BOTH ENDS OF DRIVEWAY APPROACHES.
8. EXPANSION JOINTS SHALL BE 1/2" FELT PLACED 3/4" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT. SEE STD S-04
9. THE DRIVE APPROACH SHALL BE ALIGNED WITH GARAGE DOOR(S) OR CARPORT AND BE PERPENDICULAR TO THE CURB.
10. THE DRIVE APPROACH SHALL BE MEDIUM BROOM FINISH.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	RESIDENTIAL DRIVE APPROACH TYPE 3	S-02
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 3 OF 3

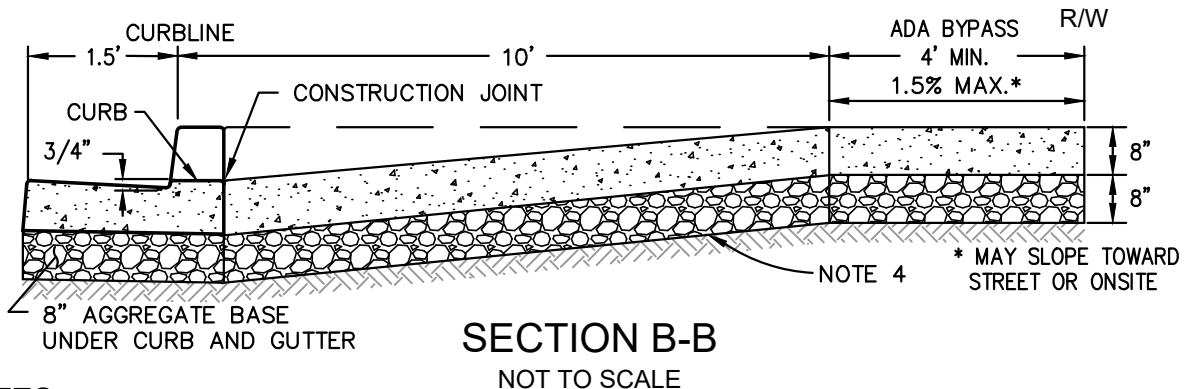

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	STANDARD COMMERCIAL DRIVE APPROACH (TYPE 1)	S-03
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 3

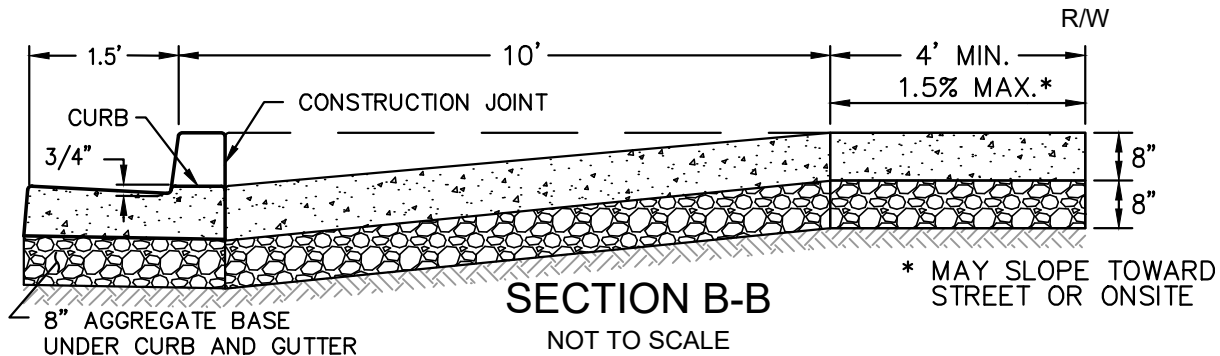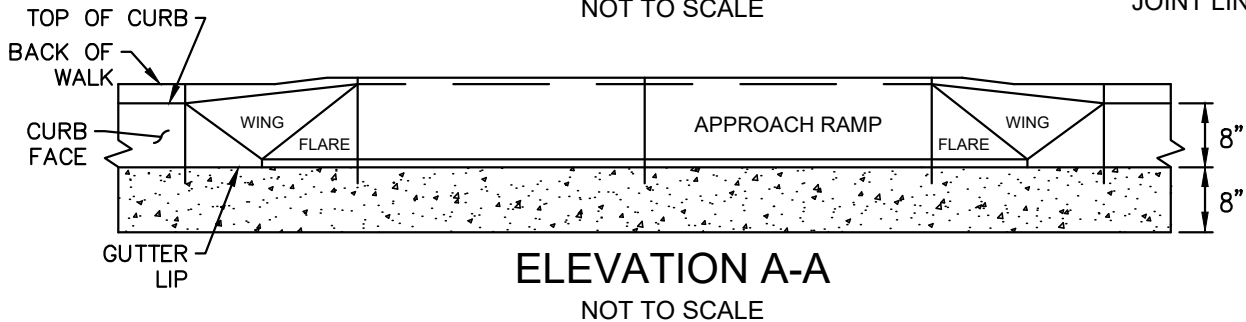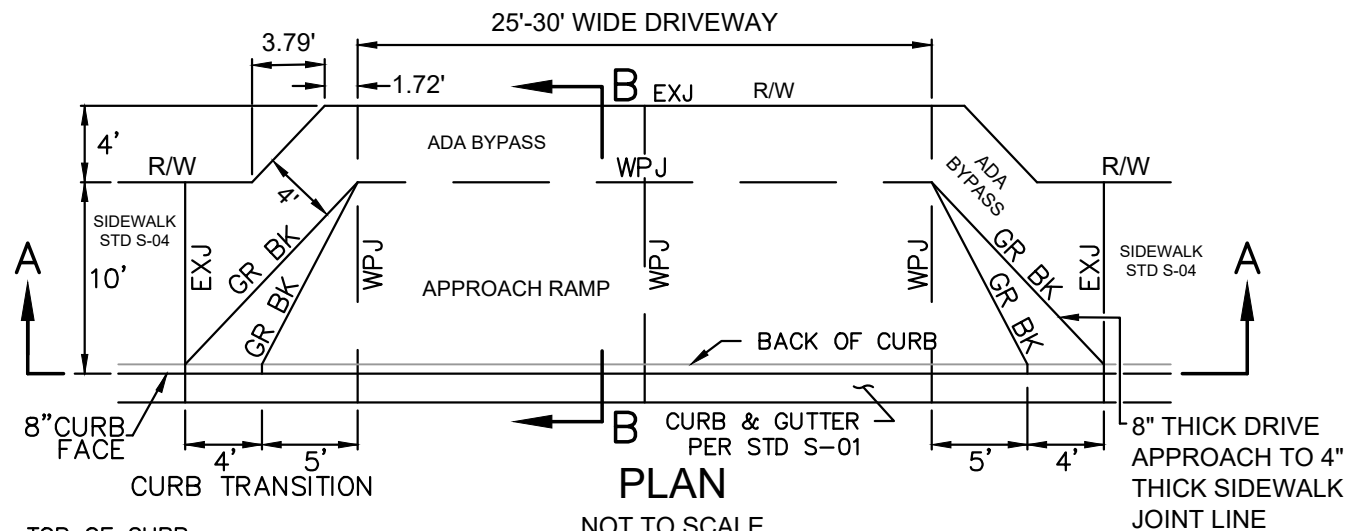

NOTES:

1. THE DRIVE APPROACH SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE DRIVE APPROACH SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK. COMPRESSIVE STRENGTH TEST RESULTS PER ASTM C39 SHALL BE PROVIDED.
3. THE SURFACE OF THE CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
4. THE DRIVE APPROACH SHALL BE CONSTRUCTED ON A MINIMUM 8" THICK LAYER OF NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 8" MINIMUM 90% RELATIVE COMPACTION NATIVE SUBGRADE.
5. AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR SECTION 26-1.02B OF THE CALTRANS SPECIFICATIONS.
6. WEAKENED PLANE JOINTS (WPJ) SHALL BE AT LEAST 2" DEEP.
7. EXPANSION JOINTS (EXJ) SHALL BE CONSTRUCTED AT BOTH ENDS OF DRIVE APPROACH AND BETWEEN ADA BYPASS AND CONCRETE DRIVEWAY. See STD S-04.
8. EXPANSION JOINTS SHALL BE 1/2" WIDE FELT PLACED 3/4" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT.
9. THE DRIVE APPROACH SHALL BE MEDIUM BROOM FINISH.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	FLARED CURB COMMERCIAL DRIVE APPROACH (TYPE 2)	S-03
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 3

R	W**
20'	30'-40'


**MAY BE WIDER WHEN ADDITIONAL LANES ARE JUSTIFIED AND WITH CITY ENGINEER'S APPROVAL

*THE DEDICATION OF ADDITIONAL RIGHT-OF-WAY SHALL BE REQUIRED IF ALL ELEMENTS OF THE APPROACH ARE NOT IN THE EXISTING PUBLIC RIGHT-OF-WAY.

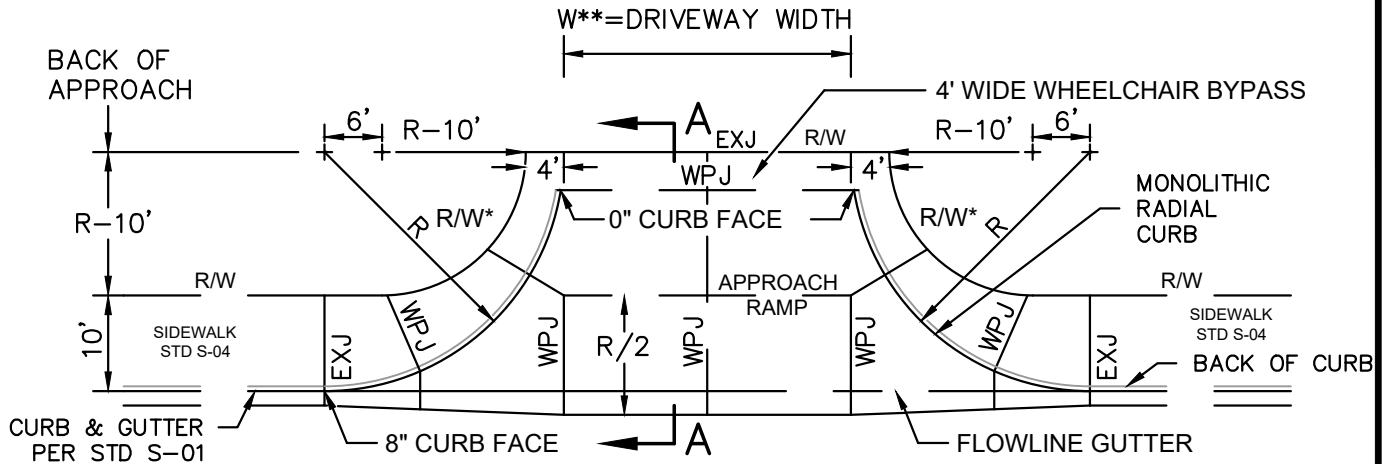

PLAN

NOT TO SCALE

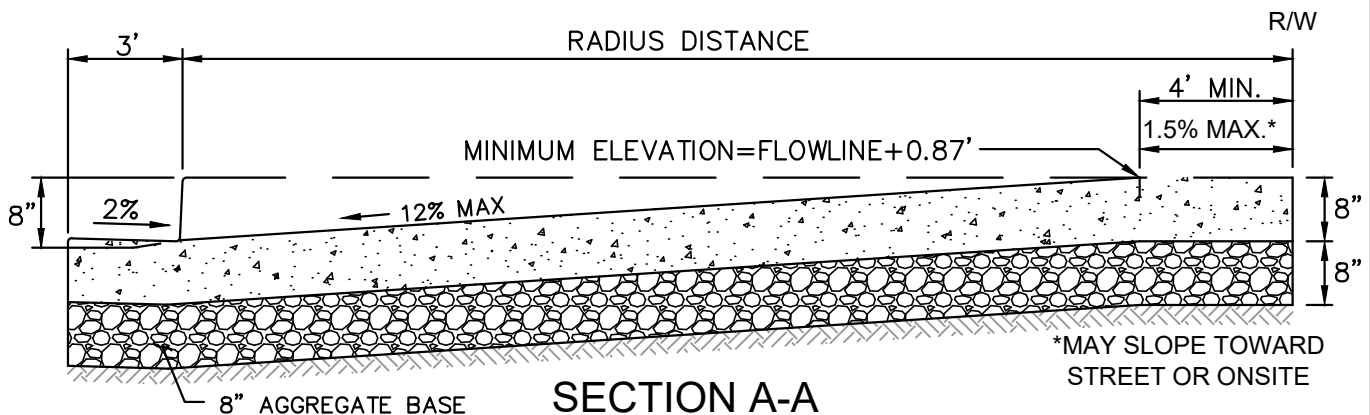

SECTION A-A



NOT TO SCALE

NOTES:


1. THE DRIVE APPROACH SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE DRIVE APPROACH SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK. COMPRESSIVE STRENGTH TEST RESULTS PER ASTM C39 SHALL BE PROVIDED.
3. THE SURFACE OF THE CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
4. THE DRIVE APPROACH SHALL BE CONSTRUCTED ON A MINIMUM 8" THICK LAYER OF NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 8" MINIMUM 90% RELATIVE COMPACTION NATIVE SUBGRADE.
5. AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR SECTION 26-1.02B OF THE CALTRANS SPECIFICATIONS.
6. WEAKENED PLANE JOINTS (WPJ) SHALL BE AT LEAST 2" DEEP.
7. EXPANSION JOINTS (EXJ) SHALL BE CONSTRUCTED AT BOTH ENDS OF DRIVE APPROACH AND BETWEEN ADA BYPASS AND CONCRETE DRIVEWAY. See STD S-04.
8. EXPANSION JOINTS SHALL BE 1/2" WIDE FELT PLACED 3/4" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT.
9. THE DRIVE APPROACH SHALL BE MEDIUM BROOM FINISH.
10. THE 4' WIDE WHEELCHAIR BYPASS AND SIDEWALK MAY BE PLACED SEPARATELY FROM THE MONOLITHIC APPROACH RAMP AND RADIAL CURB.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CURB RETURN COMMERCIAL DRIVE APPROACH (TYPE 3)	S-03
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 3 OF 3

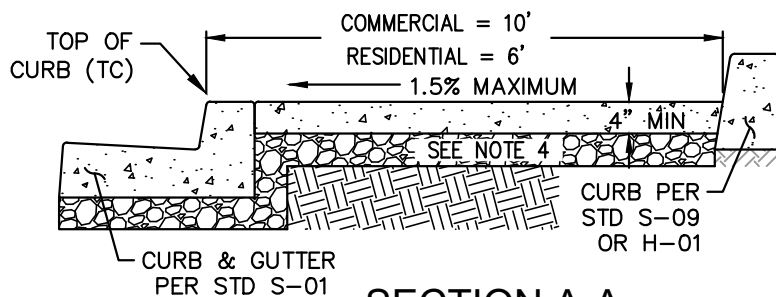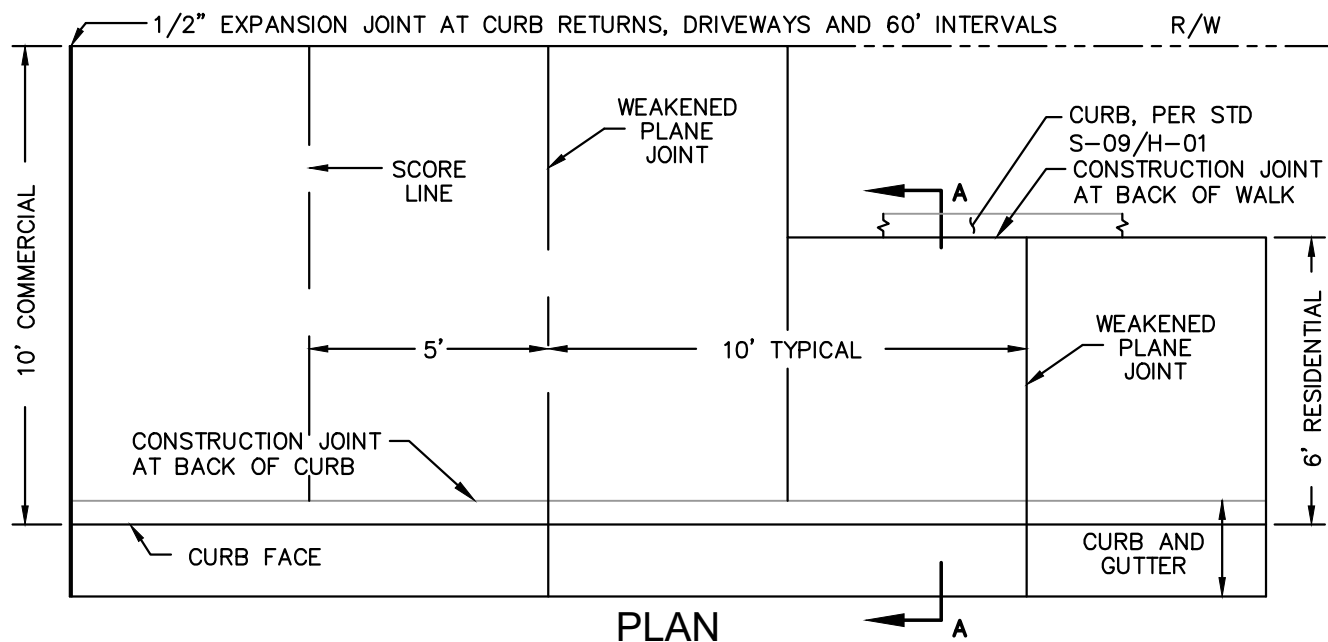

SECTION A-A
NOT TO SCALE

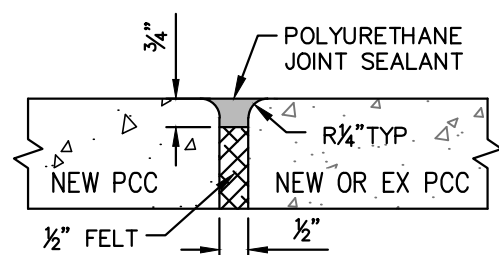


EXPANSION JOINT
NOT TO SCALE

NOTES:


1. THE SIDEWALK SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE SIDEWALK SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK.
3. THE SURFACE OF THE CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
4. THE SIDEWALK SHALL BE CONSTRUCTED ON A MINIMUM 4" THICK LAYER OF NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 8" MINIMUM 90% RELATIVE COMPACTION NATIVE SUBGRADE.
5. CRUSHED AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR 26-1.02B OF THE CALTRANS SPECIFICATIONS.
6. ON STRAIGHT RUN SIDEWALK, WEAKENED PLANE JOINTS SHALL BE INSTALLED ON 10' CENTERS. SIDEWALK SHALL BE SCORED ON 5' CENTERS.
7. WEAKENED PLANE JOINTS SHALL BE AT LEAST 2" DEEP.
8. EXPANSION JOINTS SHALL BE CONSTRUCTED AT ALL CURB RETURNS, DRIVEWAY APPROACHES AND AT 60' INTERVALS.
9. EXPANSION JOINTS SHALL BE 1/2" WIDE FELT PLACED 3/4" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT.
10. IF EXISTING SIDEWALK IS TO BE REMOVED, IT SHALL BE SCORED AT LEAST 1" DEEP WITH A CONCRETE SAW PRIOR TO REMOVAL. IF THE SAWCUT LINE IS CLOSER THAN 2' TO A SCORE LINE, WEAKENED PLANE JOINT OR EXPANSION JOINT, THE REMOVAL SHALL BE AS A PANEL TO THE NEAREST SCORE LINE OR JOINT.
11. SIDEWALK SHALL BE LIGHT BROOM FINISH.
12. SIDEWALK SHALL BE WIDENED LOCALLY TO PROVIDE A MINIMUM OF 4' CLEAR OF OBSTRUCTIONS IN THE SIDEWALK SUCH AS UTILITY POLES, STREET LIGHTS, FIRE HYDRANTS, ETC.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	STANDARD COMMERCIAL AND RESIDENTIAL SIDEWALK	S-04
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

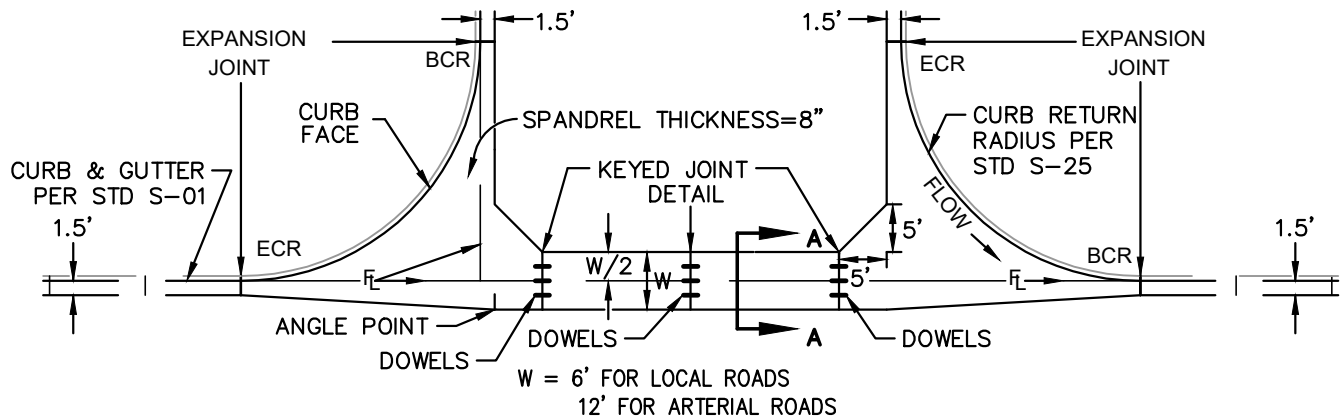

CROSS GUTTER
NOT TO SCALE

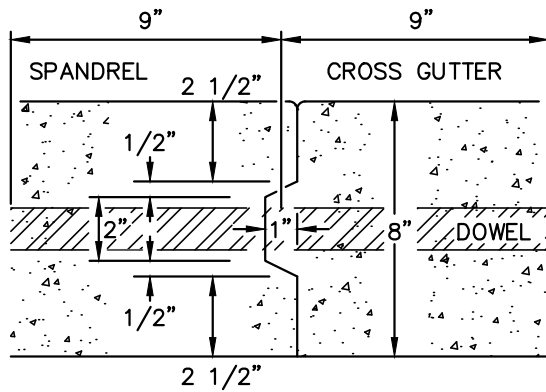

KEYED JOINT DETAIL
NOT TO SCALE

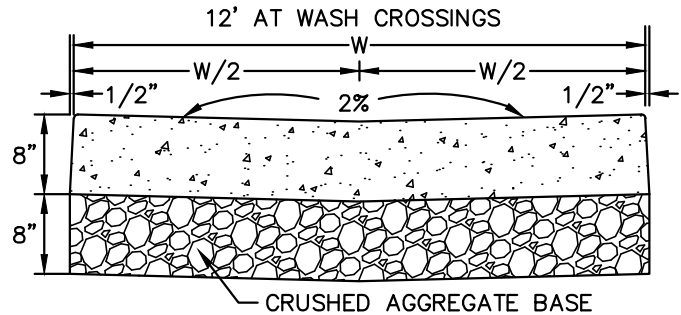

SECTION A-A
NOT TO SCALE

NOTES:


1. THE CROSS GUTTER SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE CROSS GUTTER SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK. COMPRESSIVE STRENGTH TEST RESULTS PER ASTM C39 SHALL BE PROVIDED.
3. THE SURFACE OF THE CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
4. THE SPANDREL AND CROSS GUTTER SHALL BE CONSTRUCTED ON A MINIMUM 8" THICK LAYER OF NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 12" MINIMUM 90% RELATIVE COMPACTION NATIVE SOIL.
5. CRUSHED AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR 26-1.02B OF THE CALTRANS SPECIFICATIONS.
6. A MONOLITHIC CURB SHALL BE CONSTRUCTED WITH THE SPANDREL RETURN RADIUS.
7. EXPANSION JOINTS SHALL BE CONSTRUCTED AS INDICATED ON PLAN. SEE STD S-04.
8. EXPANSION JOINTS SHALL BE 1/2" WIDE FELT PLACED 3/4" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT.
9. DOWELS SHALL BE PROTECTED COATED, A MINIMUM OF #4 BARS, 18" EQUALLY LONG SPACED AT 1.5'.
10. CONCRETE SHALL BE MEDIUM BROOM FINISH.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STANDARD CROSS GUTTER	S-05
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1




*OR AS SHOWN ON PLANS AND DIRECTED BY
THE CITY ENGINEER.

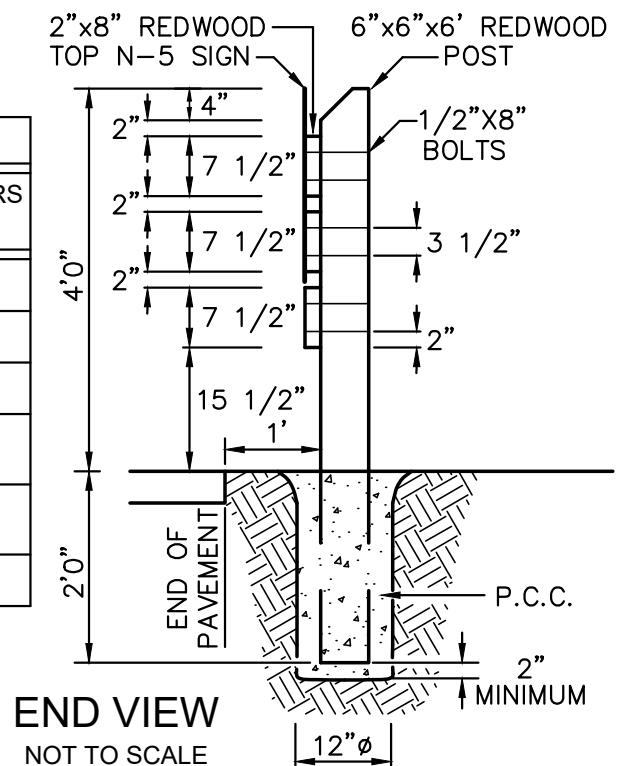


1. BARRICADES SHALL BE CONSTRUCTED WITH ROT RESISTANT WOOD PER THE THE DETAILS HARDWARE SHALL BE CADMIUM PLATED WITH 2 EACH 1/2"x8" LONG BOLTS WITH WASHERS ON BOTH SIDES AND NUTS TO FASTEN EACH END OF 2"x8" BOARD TO POSTS.
2. WOOD POSTS TO BE SET IN 12" HOLES BACKFILLED WITH CLASS 520-C -2500, CONCRETE TO GRADE.
3. MUSHROOM THREADED BOLT ENDS TO PREVENT TAMPERING.
4. ALL EXPOSED WOOD SHALL BE PRIMED AND PAINTED WITH A LATEX-BASE WHITE PAINT. PAINT SHALL CONFORM TO CALTRANS SECTION 91-3. REFLECTIVE TAPE SHALL BE USED ON THE FACE FOR THE ORANGE AND WHITE STRIPING AS SHOWN.
5. N-5 SIGNS SHALL USE REFLECTIVE TAPE INSTEAD OF REFLECTORS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	BARRICADE DETAILS	S-06
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

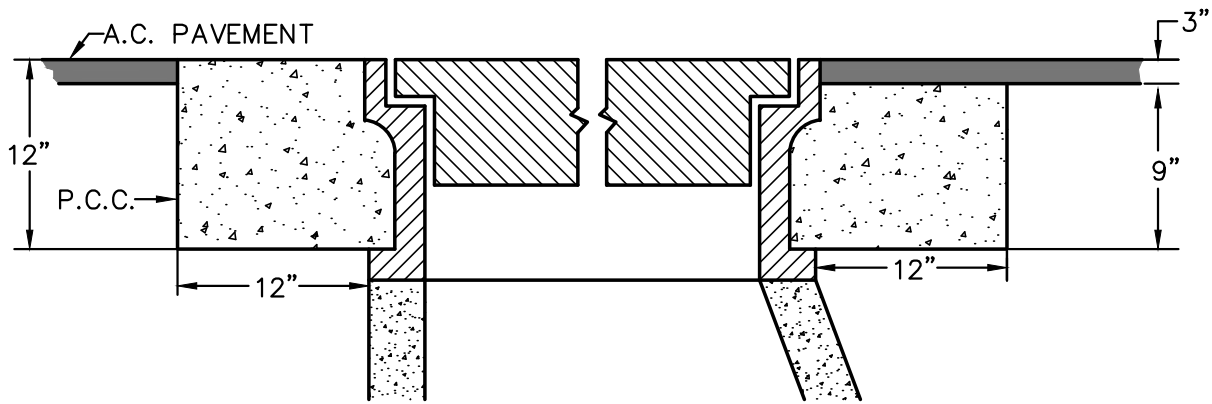

**MANHOLE
COVER AND FRAME SECTION**
NOT TO SCALE

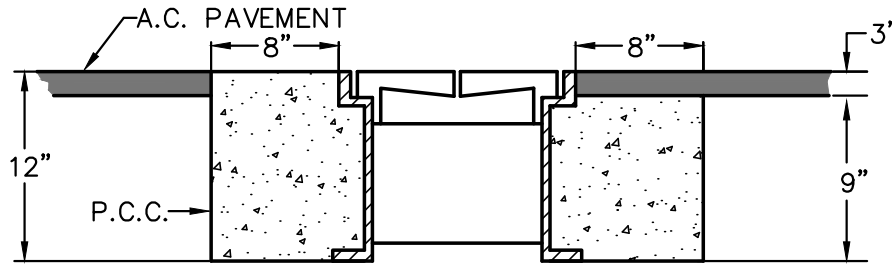

**CLEAN-OUT
COVER AND FRAME SECTION**
NOT TO SCALE

NOTES:

1. CONCRETE SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE PORTLAND CEMENT CONCRETE CLASS PER SECTION 201 SHALL BE 560-C-3250.
3. MANHOLE AND CLEAN-OUT FRAMES SHALL BE ADJUSTED TO GRADE AFTER PLACING SURFACE COURSE OF ASPHALT CONCRETE OR, IF A.C. CAP IS TO BE PLACED OVER CONCRETE RING, THE FRAMES SHALL BE ADJUSTED TO GRADE PRIOR TO PLACING A.C. SURFACE COURSE. FRAMES IN P.C.C. PAVEMENT SHALL BE ADJUSTED TO GRADE JUST PRIOR TO P.C.C. PLACEMENT.
4. MANHOLE AND CLEAN-OUT FRAMES SHALL NOT BE MORE THAN 1/4" OUT OF LEVEL WITH PAVEMENT SURFACE.
5. WHEN ADJUSTING MANHOLE OR CLEAN-OUT TO GRADE THE CONTRACTOR SHALL NOT INTERRUPT THE SERVICE FUNCTION OF THE LINE UNLESS OTHERWISE APPROVED BY THE ENGINEER PRIOR TO SUCH WORK. PRIOR TO CONSTRUCTION ACTIVITIES, THE CONTRACTOR SHALL IMPLEMENT MEASURES TO PREVENT DEBRIS AND FOREIGN MATERIALS FROM ENTERING THE PIPELINE SYSTEM, BY INSTALLING A TEMPORARY FALSE BOTTOM OR OTHER PROTECTIVE BARRIER.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	STANDARD MANHOLE/CLEAN-OUT FRAME AND COVER INSTALLATION	S-07
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1





CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	S-08
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

EXPANSION JOINT

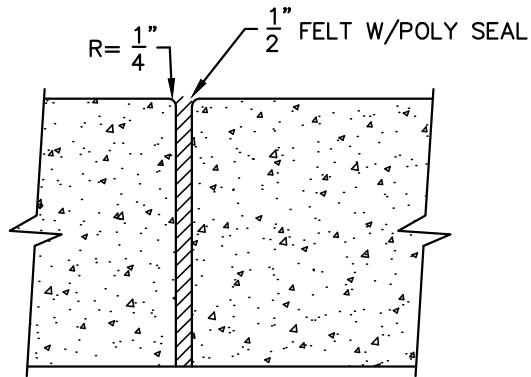

WEAKENED PLANE JOINT

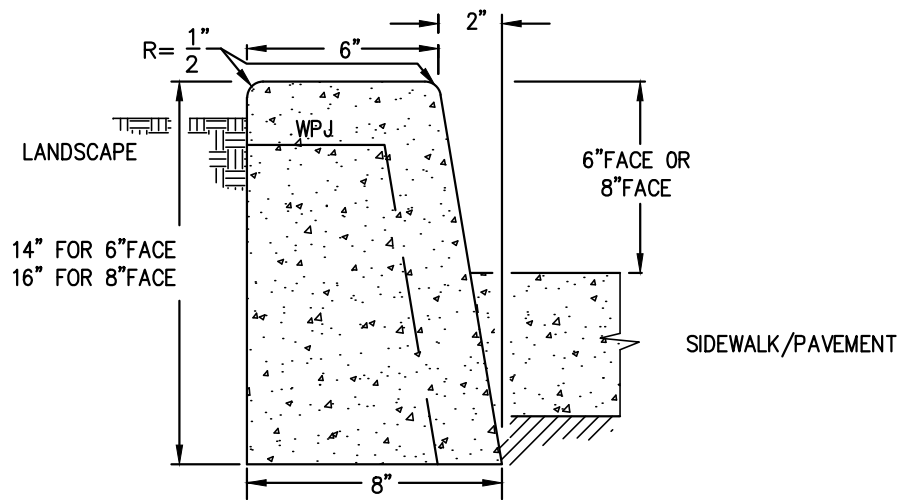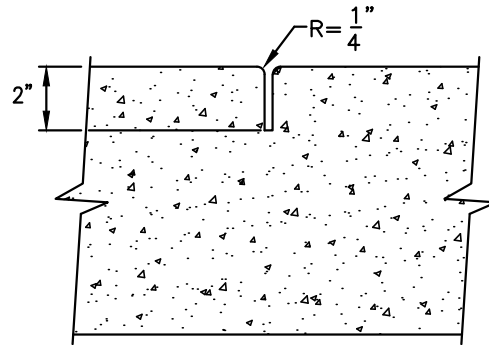

STANDARD CURB

NOT TO SCALE


NOTES:

- CURB SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
- THE PORTLAND CEMENT CONCRETE CLASS PER SECTION 201 SHALL BE 560-C-3250.
- CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
- WHEN USED ADJACENT TO VEHICULAR TRAFFIC, CURB SHALL BE CONSTRUCTED ON MINIMUM 4" NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION.
- CRUSHED AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK SPECIFICATIONS OR 26-102B OF THE CALTRANS SPECIFICATIONS.
- WEAKENED PLANE JOINTS SHALL BE CONSTRUCTED AT 10' INTERVALS. (WPJ)
- WEAKENED PLANE JOINTS SHALL BE AT LEAST 2" DEEP.
- EXPANSION JOINTS SHALL BE CONSTRUCTED AT ALL CURB RETURNS, DRIVEWAY APPROACHES AND AT 60' INTERVALS.
- EXPANSION JOINTS SHALL BE 1/2" WIDE FELT PLACED 3/4" BELOW THE FINISHED SURFACE AND FILLED WITH POLYURETHANE JOINT SEALANT. SEE STD S-04.
- IF EXISTING CURB IS TO BE REMOVED, IT SHALL BE SCORED AT LEAST 1" DEEP WITH A CONCRETE SAW PRIOR TO REMOVAL. IF THE SAWCUT LINE IS CLOSER THAN 2' TO A WEAKENED PLANE JOINT OR EXPANSION JOINT, THE CURB SHALL BE REMOVED TO THE WEAKENED PLANE JOINT OR EXPANSION JOINT.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STANDARD CURB	S-09
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

** FOR ARTERIAL STREETS (4 LANES OR MORE TOTAL), GRIND AND OVERLAY ENTIRE LANE WIDTH OVER THE TRENCH OR AS DIRECTED BY THE ENGINEER. LANE WIDTH MAY VARY BASED ON LANE CONFIGURATION. MINIMUM LANE WIDTH IS 12 FEET OR GREATER INCLUDING A BIKE LANE IF PRESENT. TRENCH REPAIRS AND POT HOLES RESULTING IN A TWO LANE OVERLAP TO MEET THE 24" MINIMUM GRIND REQUIREMENT FROM EDGE OF TRENCH SHALL BE GROUND AND CAPPED THE ENTIRE COMBINED LANE WIDTHS.

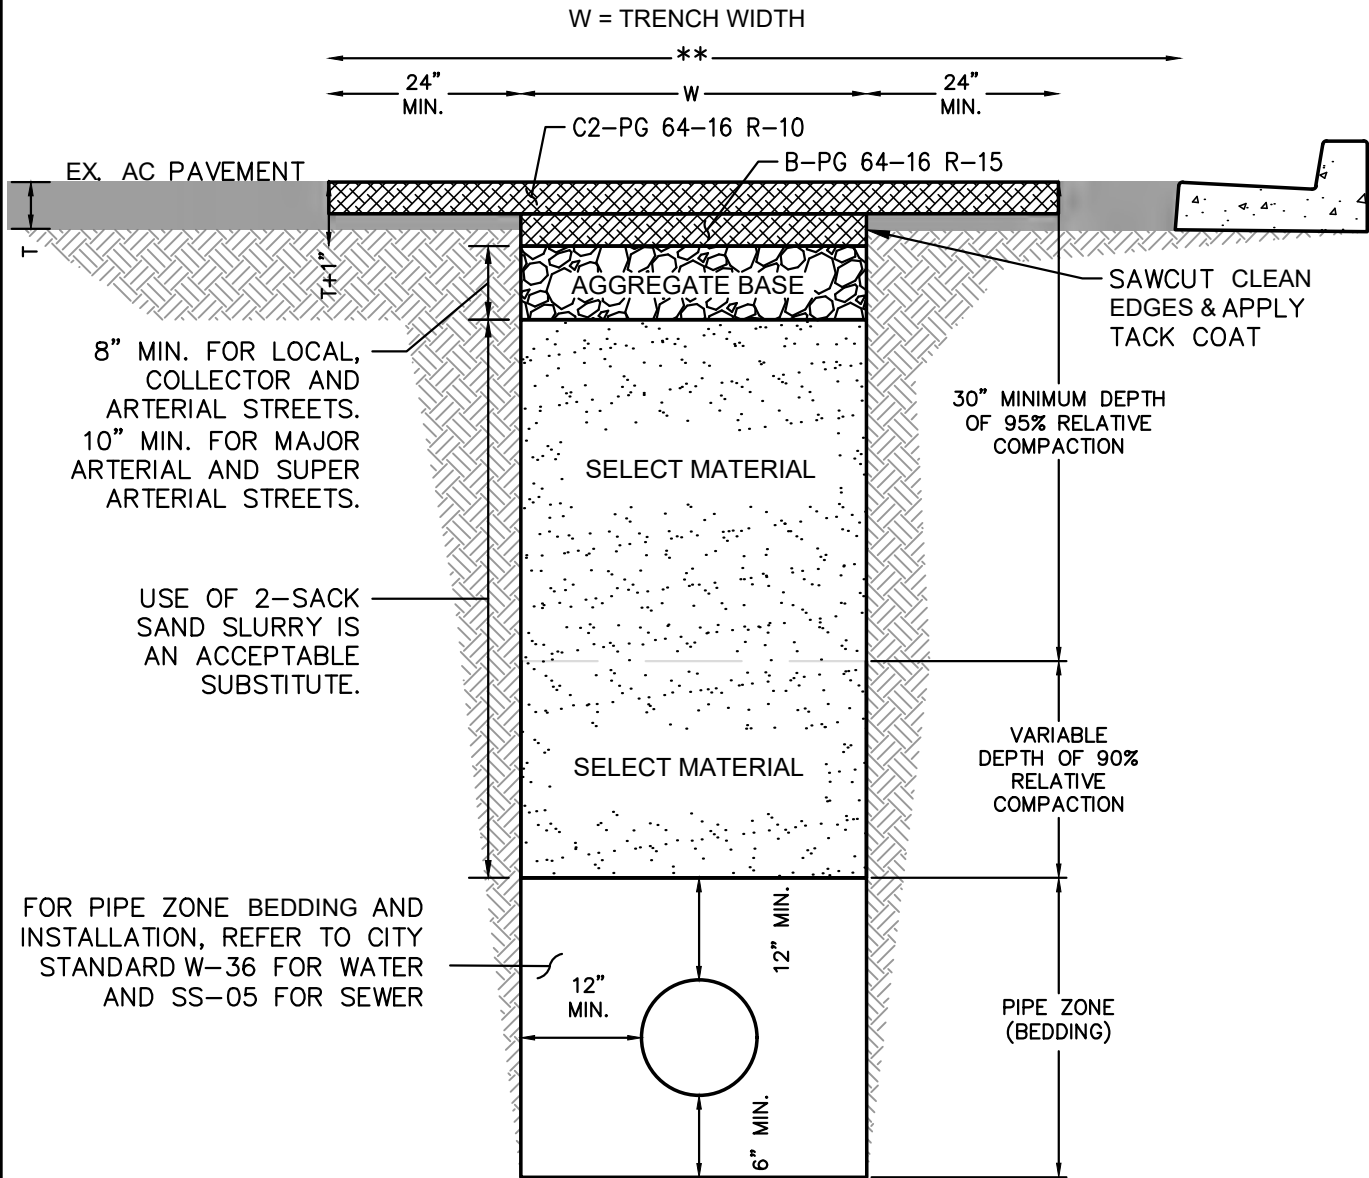

TYPICAL SECTION

NOT TO SCALE

SEE NOTES ON SHEET 2
FOR ADDITIONAL REQUIREMENTS

SPECIAL NOTE

PRIOR TO ANY TRENCH PAVEMENT REPAIRS; FOR RECENTLY PAVED/RESURFACED STREETS WITHIN THE LAST 10 YEARS, SPECIFIC "TRENCH RESURFACING AND REPAIR" REQUIREMENTS APPLY. SEE NOTES 16 ON SHEET 2 OF 2.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	TRENCH BACKFILL AND PAVEMENT REPAIRS	S-10
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 2

NOTES:

1. ALL EXCAVATIONS WITHIN THE CITY RIGHT-OF-WAY REQUIRE A PERMIT FROM THE ENGINEERING DEPARTMENT.
2. NOTIFY UNDERGROUND SERVICE ALERT (DigAlert) 3 WORKING DAYS PRIOR TO START OF EXCAVATION AT 1-800-227-2600.
3. NOTIFY ENGINEERING DEPARTMENT 1 WORKING DAY (24 HOURS) PRIOR TO START OF CONSTRUCTION TO ARRANGE INSPECTIONS BY CITY PUBLIC WORKS INSPECTORS.
4. ALL EXCAVATIONS SHALL BE MADE, PROTECTED AND SUPPORTED AS REQUIRED FOR SAFETY AS PRESCRIBED BY CAL OSHA.
5. TEMPORARY PAVEMENT PERMITTED UNTIL PERMANENT PAVEMENT CAN BE CONSTRUCTED MAY INCLUDE 1) 2-SACK SAND SLURRY; 2) 2-INCH THICK TEMPORARY ASPHALT OVER COMPACTED SUBGRADE; 3) RECESSED AND SECURED 1" MINIMUM THICK SKID RESISTANT STEEL PLATES THAT WILL PROVIDE A SAFE AND SMOOTH TRAVERSABLE SURFACE. PERMANENT PAVEMENT SHALL BE PLACED WITHIN 7 DAYS OF EXCAVATION.
6. ANY STREET PAVED OR RESURFACED IN THE PREVIOUS 36 MONTHS THAT IS TRENCHED FOR 300 FEET OR MORE IN A TRAVELED LANE OR EXTENDS MORE THAN 7 FEET FROM THE CURB FACE / EDGE OF PAVEMENT OR HAS MORE THAN 3 CROSS TRENCHES IN 300 FEET SHALL BE OVERLAID AS DIRECTED BY THE ENGINEER WITH A SELF PROPELLED PAVING MACHINE PER SECTION 302-5 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OR CALTRANS SECTION 39.
7. PERMANENT TRENCH REPAIR PER THIS STANDARD DOES NOT APPLY TO EXISTING PORTLAND CEMENT CONCRETE (P.C.C.) PAVEMENTS. THE P.C.C. PAVEMENT SHALL BE SAWCUT, REMOVED AND RECONSTRUCTED AS FULL PANELS UP TO EXISTING CONSTRUCTION JOINTS, WEAKENED PLANE JOINTS, SCORE LINES, OR AT LEAST 10 FEET WIDE AND AS DIRECTED BY THE ENGINEER IN THE FIELD. THE CONCRETE CLASS SHALL BE 560-C-3250 MINIMUM.
8. IF THE EDGE OF THE TRENCH REPAIR (W+4 FEET) IS 2 FEET OR LESS FROM THE LIP OF THE GUTTER OR 3' OR LESS FROM THE EDGE OF PAVEMENT WITHOUT CURB AND GUTTER, THE REMAINING EXISTING PAVEMENT SHALL BE REMOVED AND REPLACED PER THE TYPICAL SECTION.
9. THE GRIND AND OVERLAY OF EXISTING ASPHALT CONCRETE PAVEMENT SHALL BE A MINIMUM OF 1.5 INCHES FOR LOCAL STREETS AND 2.0 INCHES FOR ALL OTHER STREET CLASSIFICATIONS.
10. THE PERMITTED CLASS AND PERFORMANCE GRADE OF ASPHALT CONCRETE PAVEMENT (AC) SHALL BE A CAP (1.5" TO 2.0" THICK) OF C2-PG 64-16-R10 AND A BASE COURSE OF B-PG 64-16-R15 PER THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION UNLESS OTHERWISE DIRECTED BY ENGINEERING. PERFORMANCE GRADES INCLUDING PG PG 70-10, PG 64-28PM, PG 76-22PM MAY BE REQUIRED AT THE DIRECTION OF THE CITY ENGINEER DEPENDING ON LOCATION. TYPE III ASPHALT CONCRETE MIXTURES ARE NOT PERMITTED. NEW ASPHALT CONCRETE SHALL NOT BE LESS THAN 3-INCHES THICK.
11. AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK) OR SECTION 26-1.02B OF THE CALTRANS SPECIFICATIONS.
12. SELECT MATERIAL SHALL BE FREE FROM SHALE, SOD, ROOTS, RUBBISH, TRASH, LUMBER, ORGANIC MATERIAL, ASHES AND OTHER DEBRIS, UNUSUAL COLOR, CONTAMINATION, SULFIDE ODOR, NOT CONTAIN ROCKS WITH THE GREATEST DIMENSION EXCEEDING 6" AND HAVE A SAND EQUIVALENT NOT LESS THAN 20. ROCKS, INCLUDING PIECES OF BROKEN CONCRETE OR BITUMINOUS PAVEMENT, ORIGINATING FROM THE NATIVE MATERIAL AND SHALL BE DISPERSED WITHIN, OR MIXED WITH, THE BACKFILL MATERIAL SUCH THAT VOIDS OR POCKETS OF LARGE PIECES ARE NOT CREATED. SELECT MATERIAL SHALL BE PRE-APPROVED PRIOR TO USE.
13. SEAL COAT PAVEMENT 6 INCHES BEYOND PAVEMENT REPAIR AREA.
14. COMPACTION TESTING FOR EVERY 1.0' OF SELECT MATERIAL FILL AND AGGREGATE BASE SHALL BE ACCOMPANIED BY A COMPACTION REPORT OF TRENCH BACKFILL FROM A LICENSED ENGINEER PRIOR TO PLACEMENT OF PERMANENT PAVEMENT.
15. FOR NOMINAL PIPE DIAMETERS OF 12" OR LESS, TYPICAL COVER IS 36" UNLESS CIRCUMSTANCES WARRANT DIFFERENTLY OR OTHERWISE APPROVED BY THE CITY ENGINEER.
16. TO PRESERVE THE INTEGRITY OF THE NEWLY PAVED/RESURFACED STREETS AND TO FORESTALL DETERIORATION BY PREVENTING WATER INTRUSION, DIFFERENTIAL SETTLEMENT AND MULTIPLE CUTS THAT ARE OFTEN ASSOCIATED WITH STREET PATCHES; SPECIFIC TRENCH RESURFACING AND REPAIR METHODS WERE ADOPTED ON 6-11-2018. PRIOR TO MAKING CUTS/REPAIRS, CONTRACTOR OR DEVELOPER SHALL CONFIRM WITH CITY INSPECTOR IF SPECIFIC TRENCH RESURFACING AND REPAIR ARE APPLICABLE. THE TRENCH RESURFACING AND REPAIR DOCUMENT CAN BE FOUND ON THE CITY WEBSITE.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	TRENCH BACKFILL AND PAVEMENT REPAIRS	S-10
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2

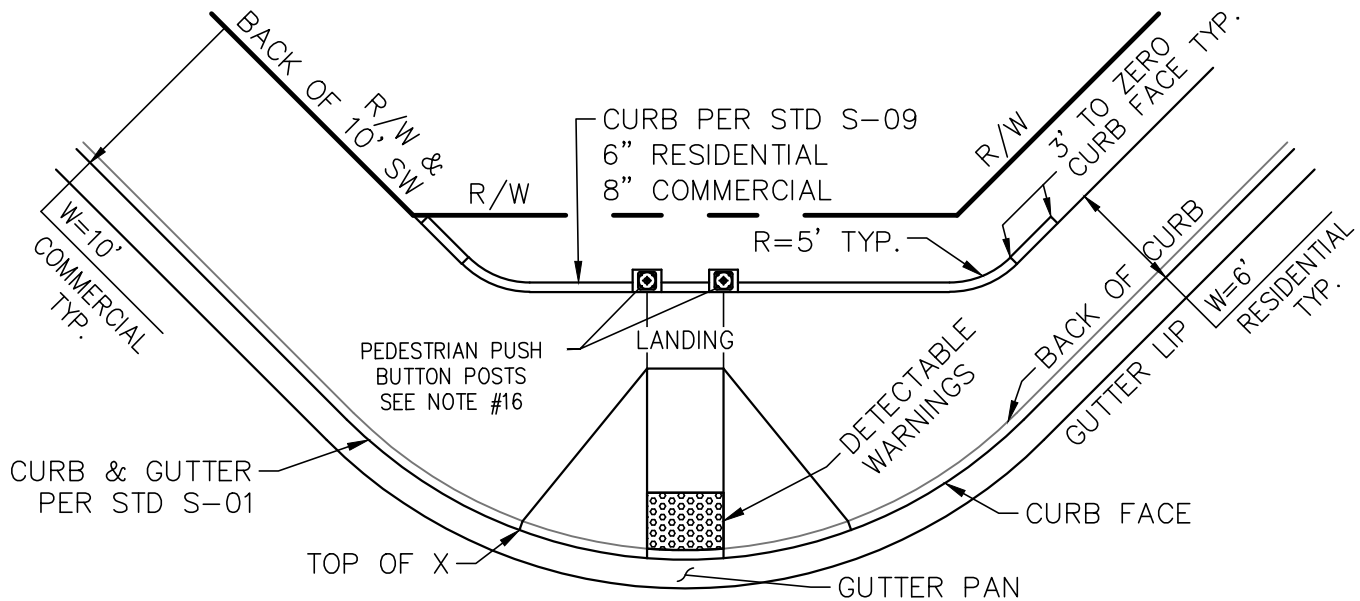


CURB RETURN WITH RAMP

NOT TO SCALE
(CURB RAMP TYPE A SHOWN)

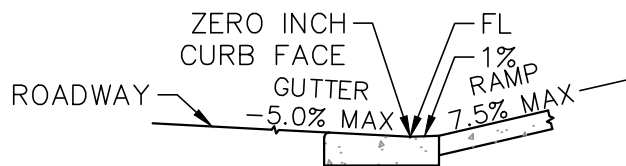


LIP DETAIL

NOT TO SCALE

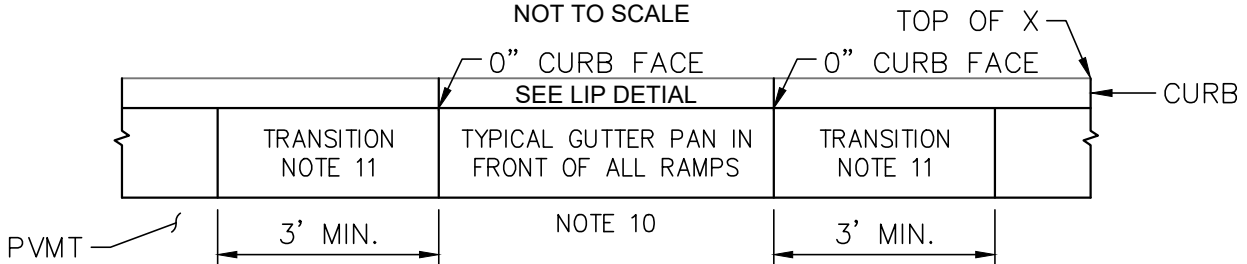

GUTTER PAN TRANSITION


NOT TO SCALE

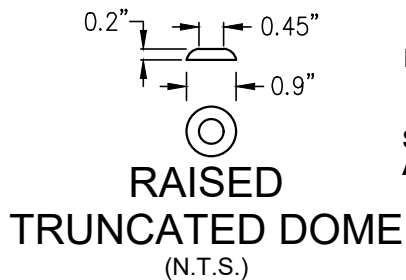

RAISED TRUNCATED DOME

(N.T.S.)

DETECTABLE WARNING SURFACE OF TRUNCATED DOMES SHALL BE YELLOW AND APPROXIMATE 33538 OF SAE AMSSTD-595A

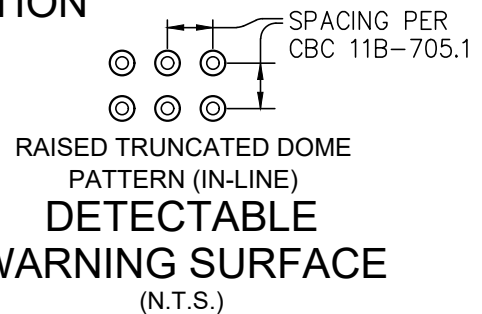

DETECTABLE WARNING SURFACE


(N.T.S.)

NOTE:

1. ALL CURB RAMPS SHALL INCORPORATE GUTTER TRANSITIONS & DETECTABLE WARNING SURFACES ADJACENT TO THE BACK FACE OF CURBS AND OR GUTTERS.
2. TYPE A THROUGH F CURB RAMPS MAY BE MODIFIED TO BE PLACED ON CURB RETURN RADIUS AS INDICATED PER PROJECT PLANS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CURB RAMP	S-11
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 8

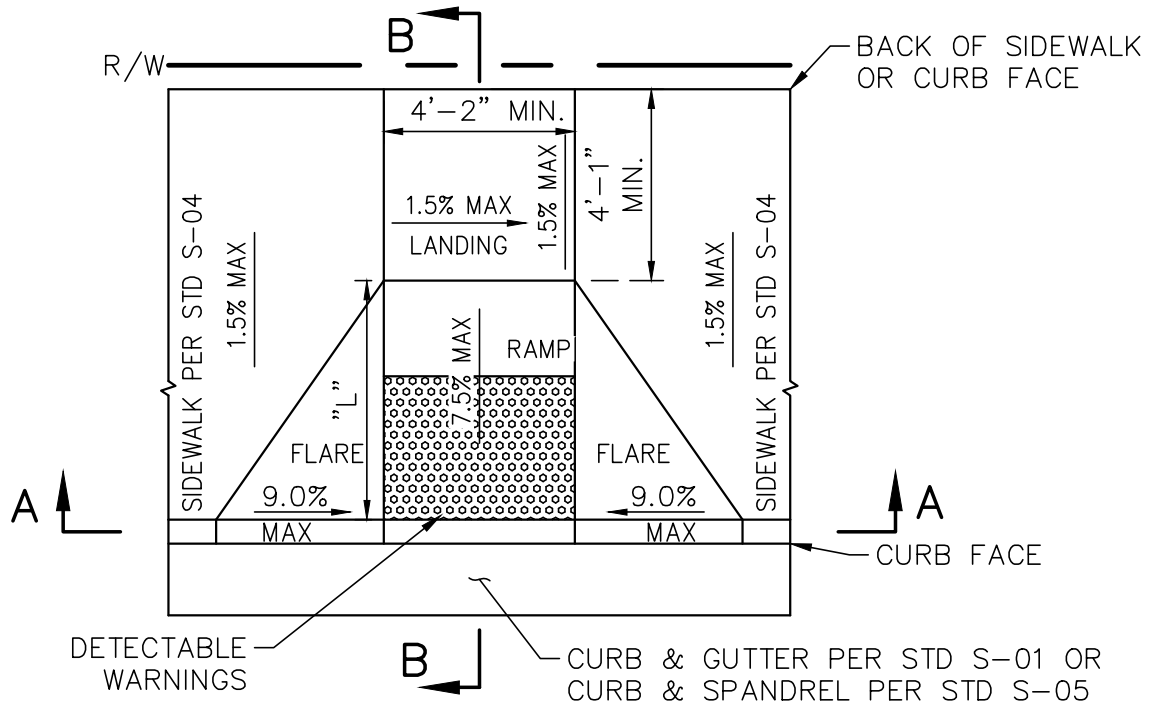


CURB RAMP TYPE A

NOT TO SCALE


H	X	L
6"	5.0'	7.5'
8"	6.5'	10.0'

MINIMUM

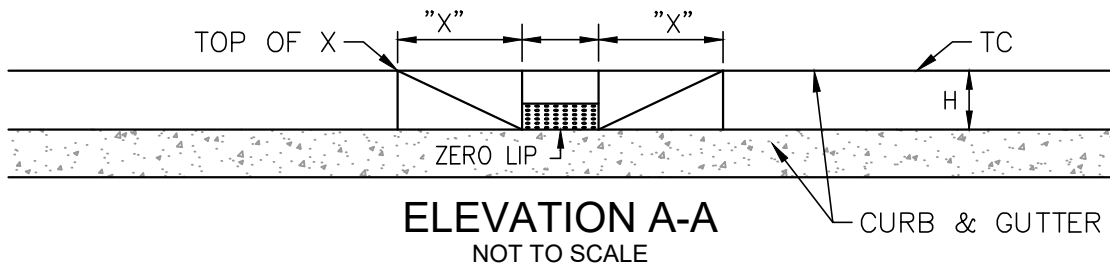

ELEVATION A-A

NOT TO SCALE

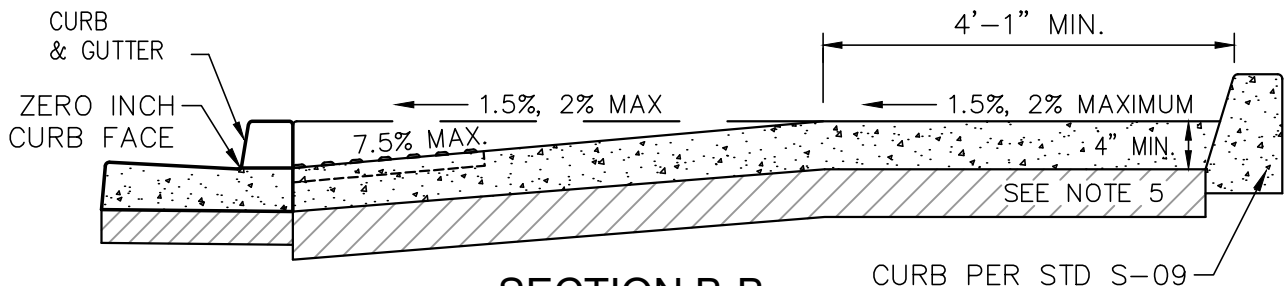


SECTION B-B

NOT TO SCALE



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CURB RAMP	S-11
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 8

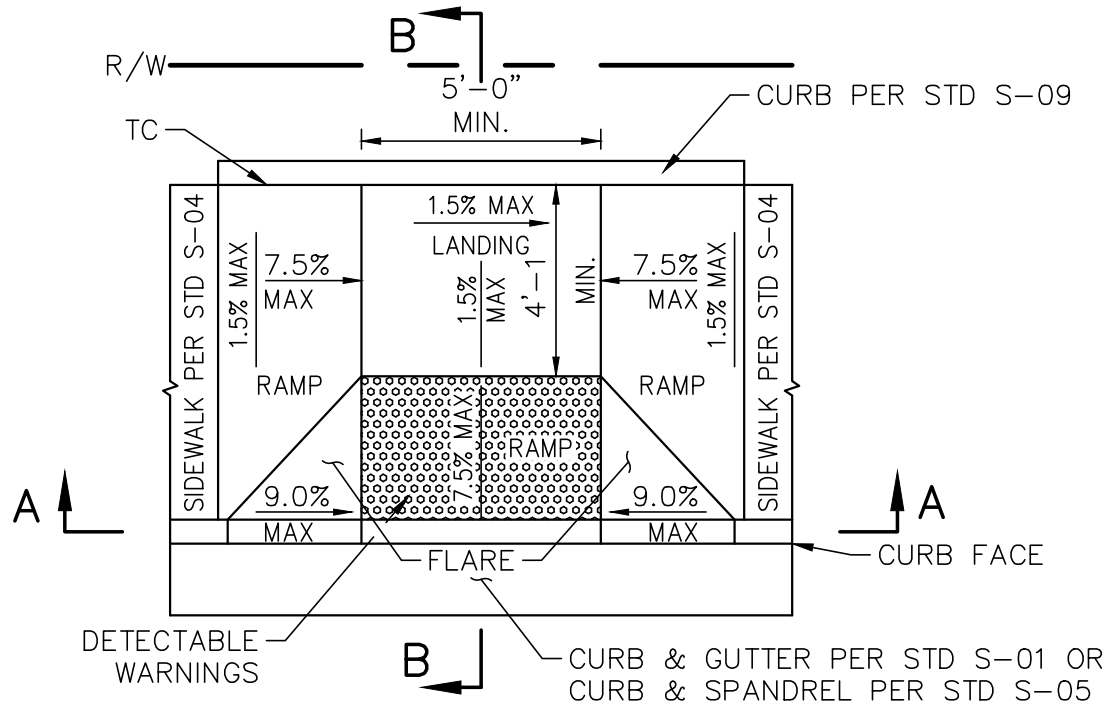


CURB RAMP TYPE B

NOT TO SCALE

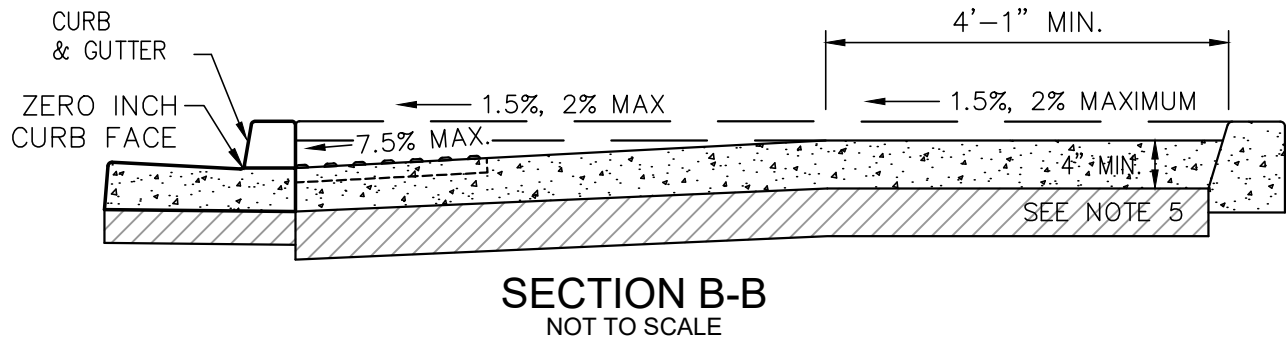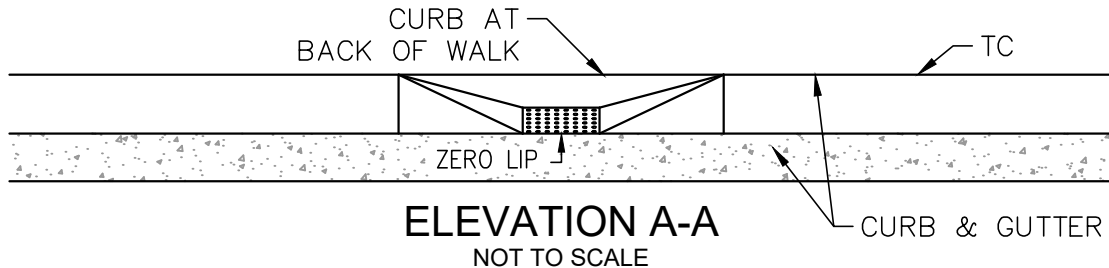


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	CURB RAMP	S-11
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 3 OF 8

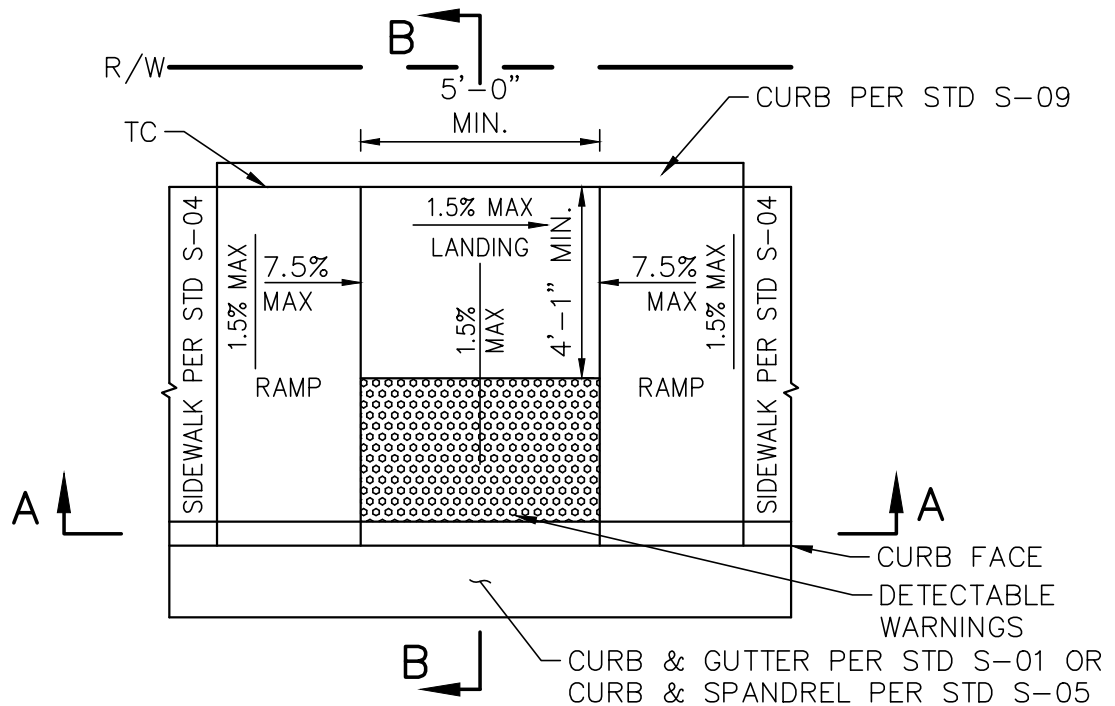

CURB RAMP TYPE C
NOT TO SCALE

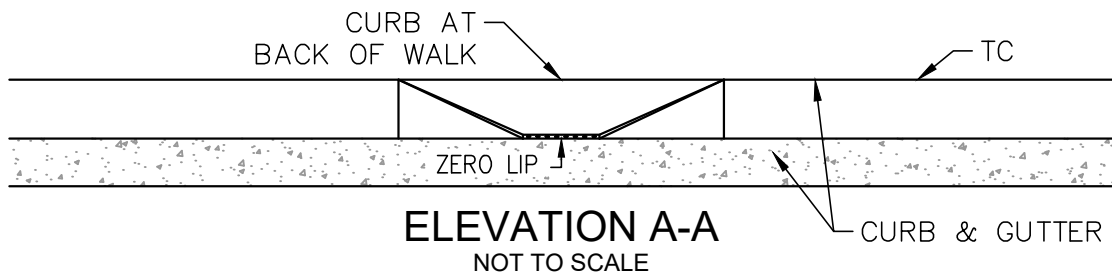


ELEVATION A-A
NOT TO SCALE

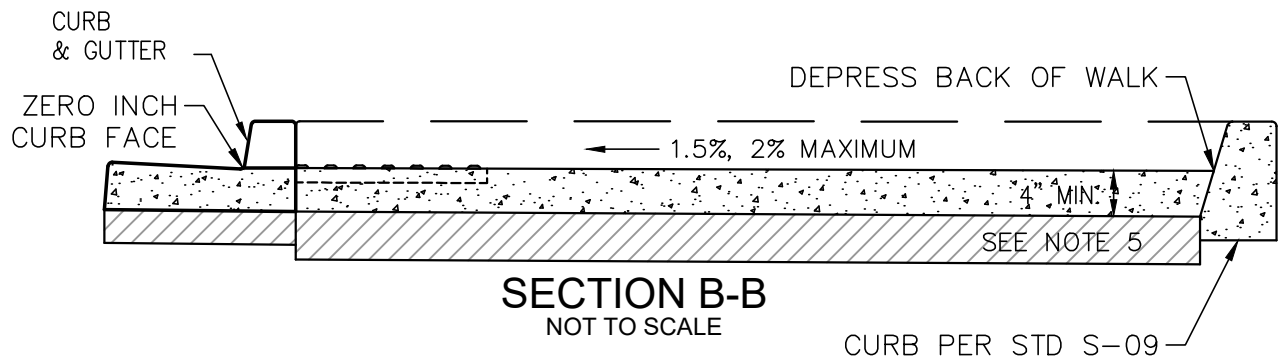


SECTION B-B
NOT TO SCALE

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CURB RAMP	S-11
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 4 OF 8

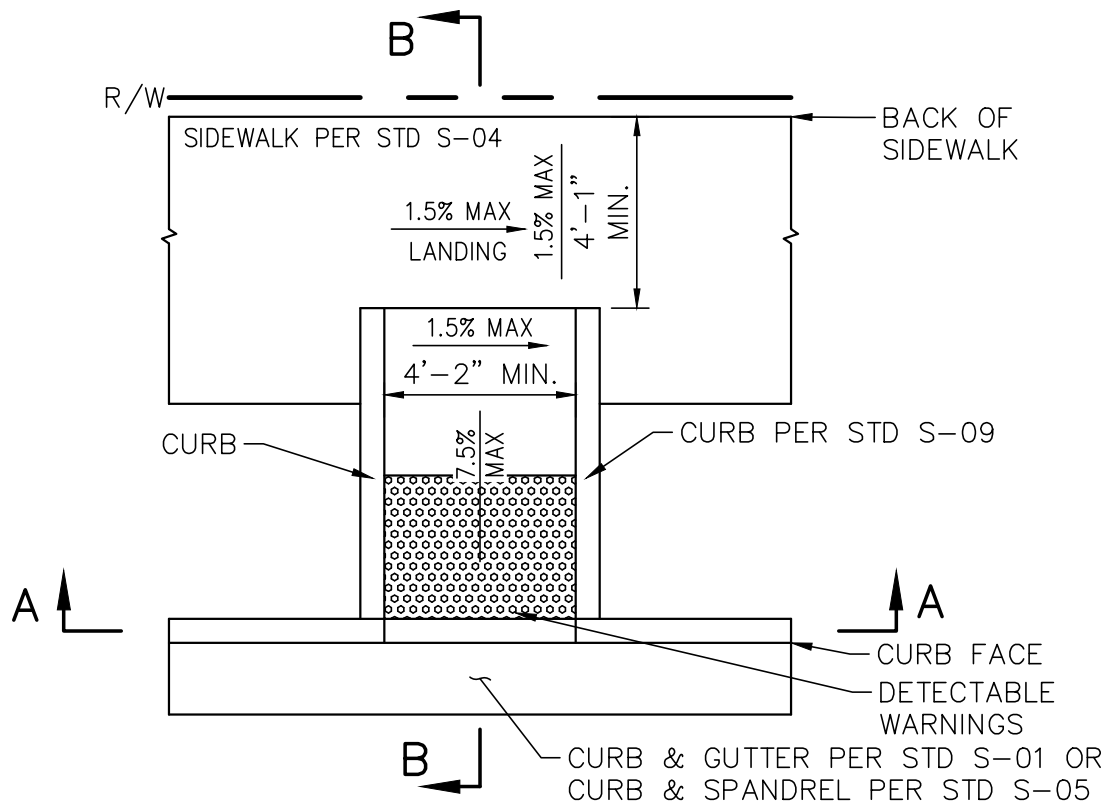

CURB RAMP TYPE D
NOT TO SCALE

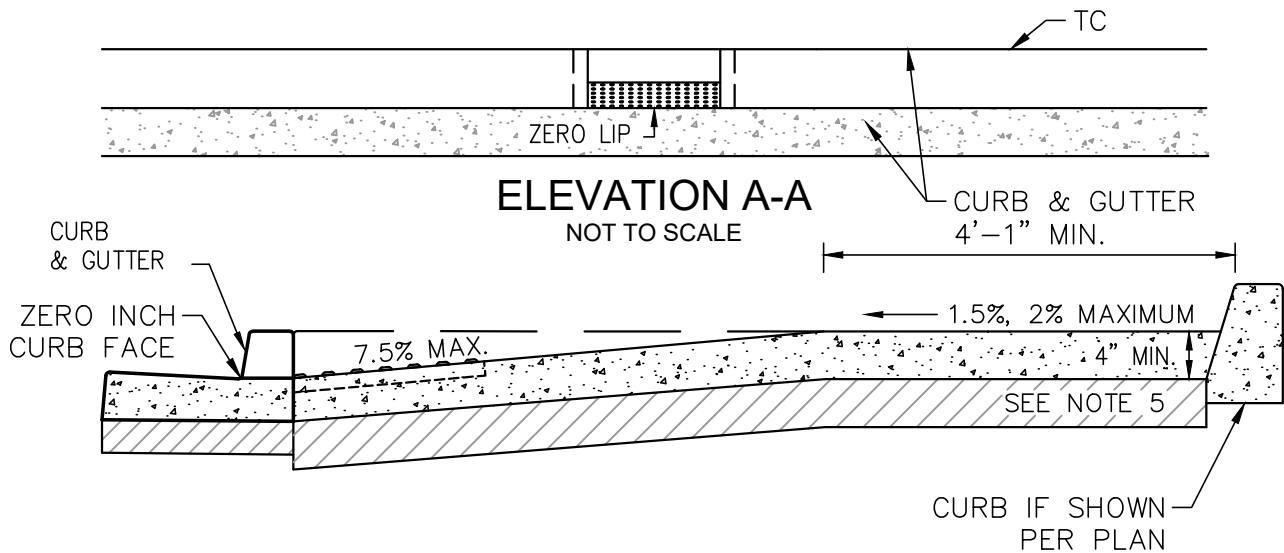


NOTE:


1. TYPE D RAMPS MAY BE PLACED PERPENDICULAR OR PARALLEL TO THE RIGHT OF WAY.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	CURB RAMP	S-11
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 5 OF 8

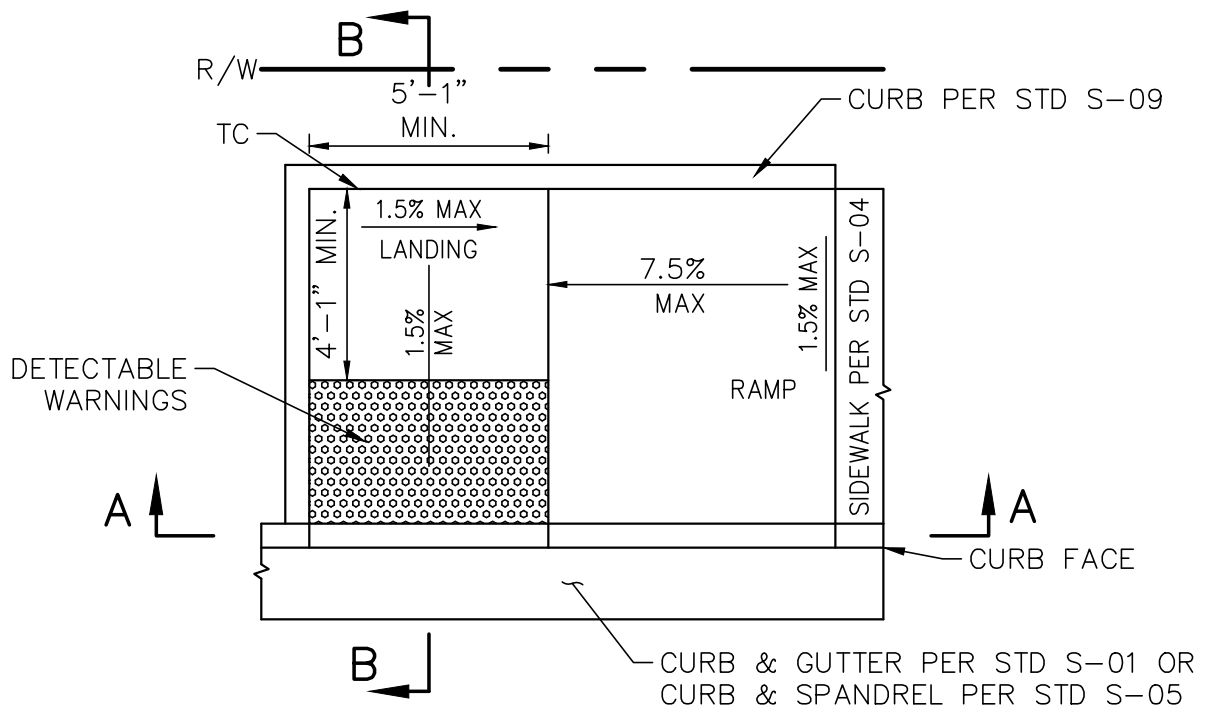

CURB RAMP TYPE E
NOT TO SCALE

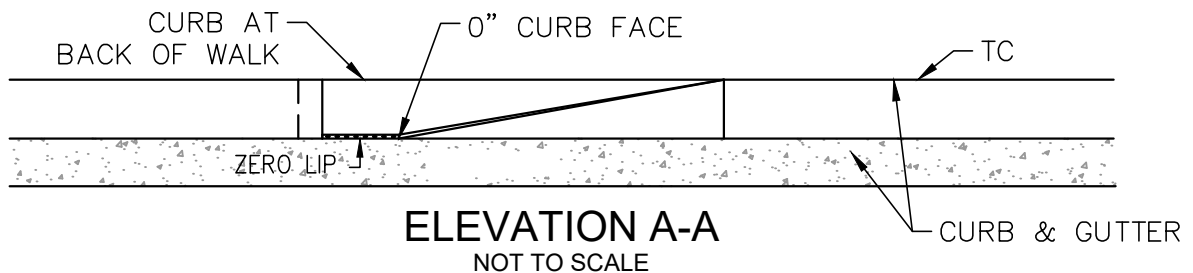


ELEVATION A-A
NOT TO SCALE

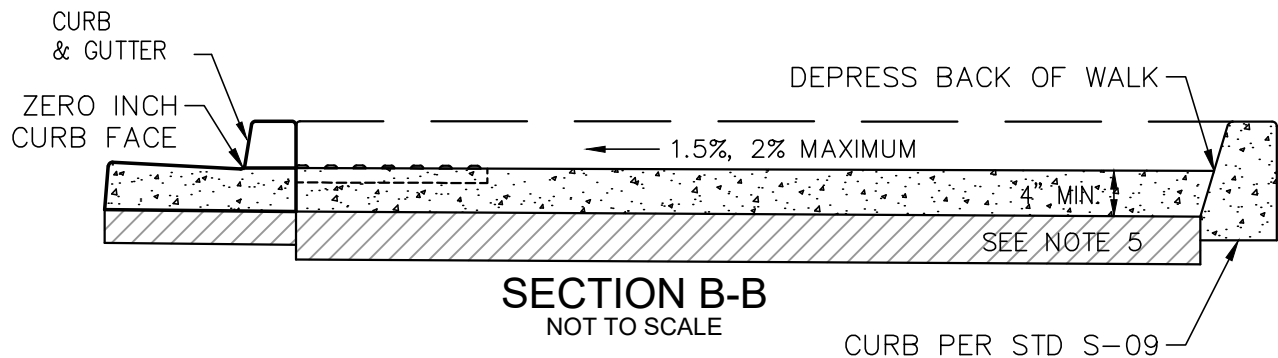



SECTION B-B
NOT TO SCALE

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CURB RAMP	S-11
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 6 OF 8

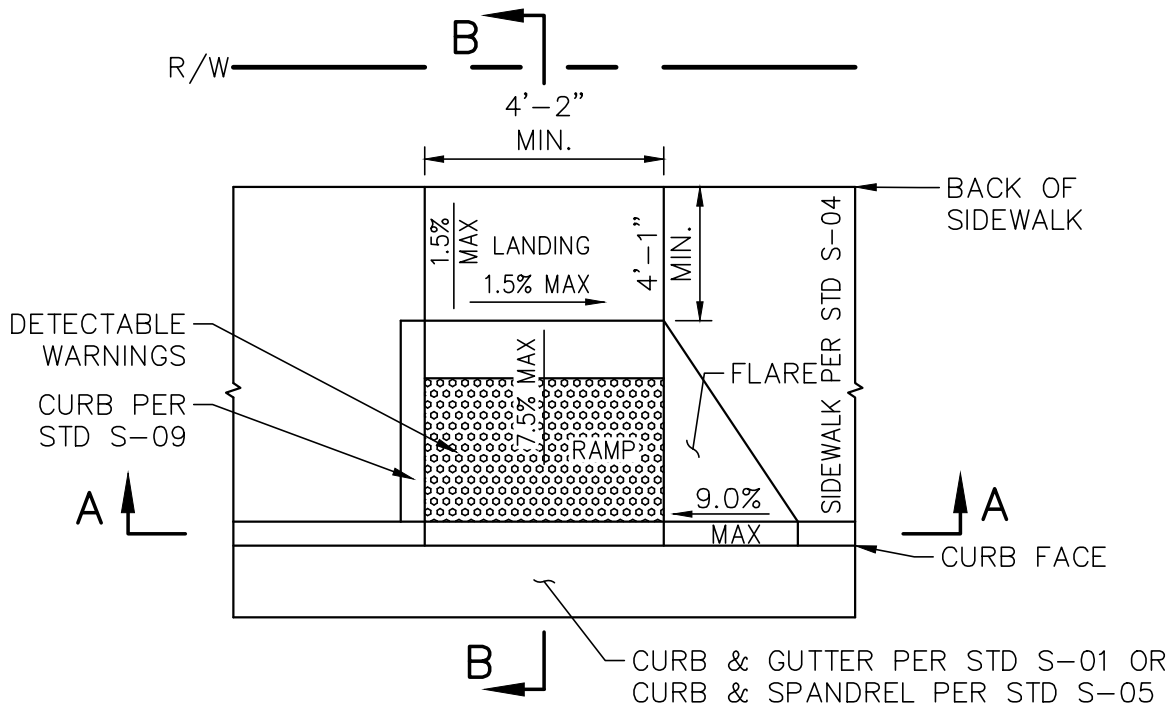

CURB RAMP TYPE F
NOT TO SCALE

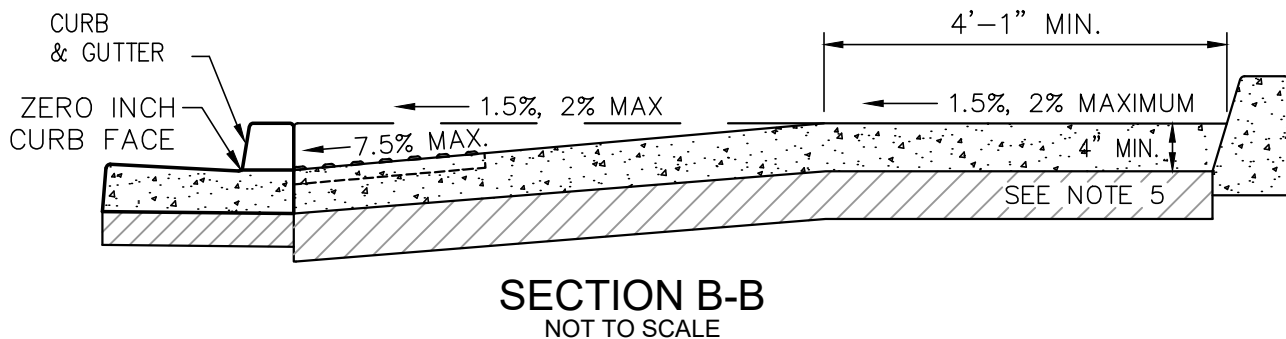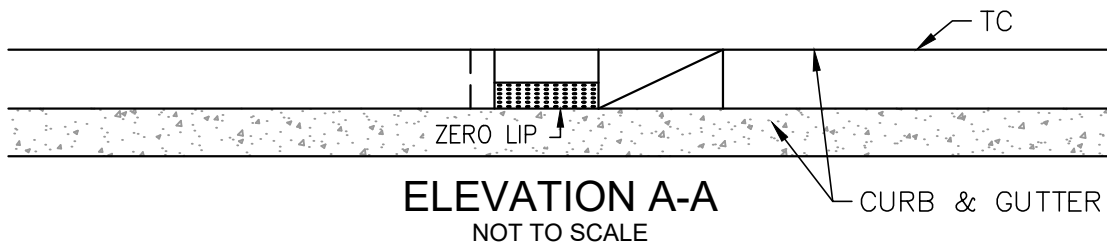

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	CURB RAMP	S-11
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 7 OF 8

NOTES:

1. THE CURB RAMP SHALL BE CONSTRUCTED PER SECTION 303 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE CONCRETE CLASS PER SECTION 201 SHALL BE 560-C-3250 PER THE GREENBOOK.
3. CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND.
4. THE CURB RAMP SHALL BE MEDIUM BROOM FINISH.
5. THE CURB RAMP SHALL BE CONSTRUCTED ON A MINIMUM 4" THICK LAYER OF NATURAL CRUSHED AGGREGATE BASE COMPACTED TO 95% RELATIVE COMPACTION OVER 8" MINIMUM 90% RELATIVE COMPACTION NATIVE SUBGRADE.
6. AGGREGATE BASE SHALL BE NATURAL MATERIAL CONFORMING TO SECTION 200-2.2 OF THE GREENBOOK OR SECTION 26-1.02B OF THE CALTRANS SPECIFICATIONS.
7. IF A CURB RAMP IS TO BE INSTALLED IN AN EXISTING SIDEWALK, CURB AND GUTTER, THE EXISTING SIDEWALK, CURB AND GUTTER SHALL BE SAWCUT AND REMOVED TO THE NEAREST SCORELINE, WEAKENED PLANE JOINT OR EXPANSION JOINT.
8. CONSTRUCT RAMP IN THE MIDDLE OF THE CURB RETURN OR AT THE END OF THE CURB RETURN AWAY FROM THE CROSS GUTTER. RAMP MAY BE MOVED INTO THE TANGENT CURB SECTION AT INTERSECTIONS TO AVOID DISRUPTION OF HEAVY DRAINAGE FLOW. IN LOCATING RAMPS IN CURB RETURN, CONSIDERATION SHOULD BE GIVEN TO THE LOCATION OF EXISTING PAINTED PEDESTRIAN CROSS WALKS AND TRAFFIC SIGNALS.
9. DETECTABLE WARNINGS SHALL CONSIST OF A SURFACE OF TRUNCATED DOMES AND COMPLY WITH SECTION 11B-705 OF THE LATEST EDITION OF THE CALIFORNIA BUILDING CODE (CBC).
10. THE DETECTABLE WARNING SURFACE SHALL BE RECTANGULAR AS SHOWN AT THE BACK OF CURB, UNLESS MODIFIED IN THE PROJECT PLAN DETAILS. CURB RAMPS SHALL HAVE A DETECTABLE WARNING SURFACE THAT EXTENDS THE FULL WIDTH AND 3'-0" DEPTH OF THE RAMP EXCEPT FOR A MAXIMUM GAP OF 1 INCH IS ALLOWED ON EACH SIDE. TRUNCATED DOMES SHALL BE CAST IN CONCRETE, OR RECESSED IN PLACE TILES. SURFACE APPLIED MOUNTED UNITS ARE PROHIBITED.
11. SLOPES OF CURB & GUTTER PANS AND PAVEMENT SURFACES IMMEDIATELY ADJACENT TO AND WITHIN 24 INCHES OF THE CURB RAMP SHALL NOT BE STEEPER THAN 1V:20H (5%). GUTTER PAN SLOPE SHALL NOT EXCEED 1" OF DEPTH FOR 2' EACH OF WIDTH.
12. TRANSITION GUTTER PAN SLOPE FROM 1" OF DEPTH FOR EACH 2' OF WIDTH TO MATCH TYPICAL GUTTER SLOPE PER STD S-01 OR S-05.
13. ADJACENT SURFACES TO RAMPS & FLARES SHALL BE THE SAME LEVEL.
14. RAMPS SHALL NOT BE CONSTRUCTED MONOLITHICALLY WITH CURBS.
15. THE CLEAR WIDTH FOR RAMPS SHALL BE 48 INCHES MINIMUM.
16. IN CASES WHERE INTERSECTION IS SIGNALIZED, RELOCATE/INSTALL PUSH BUTTON POSTS TO THE BACK OF LANDING PER CITY STD T-9.
17. THE CLEAR SPACE FOR LANDINGS SHALL BE 48"X48" MINIMUM.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CURB RAMP	S-11
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 8 OF 8

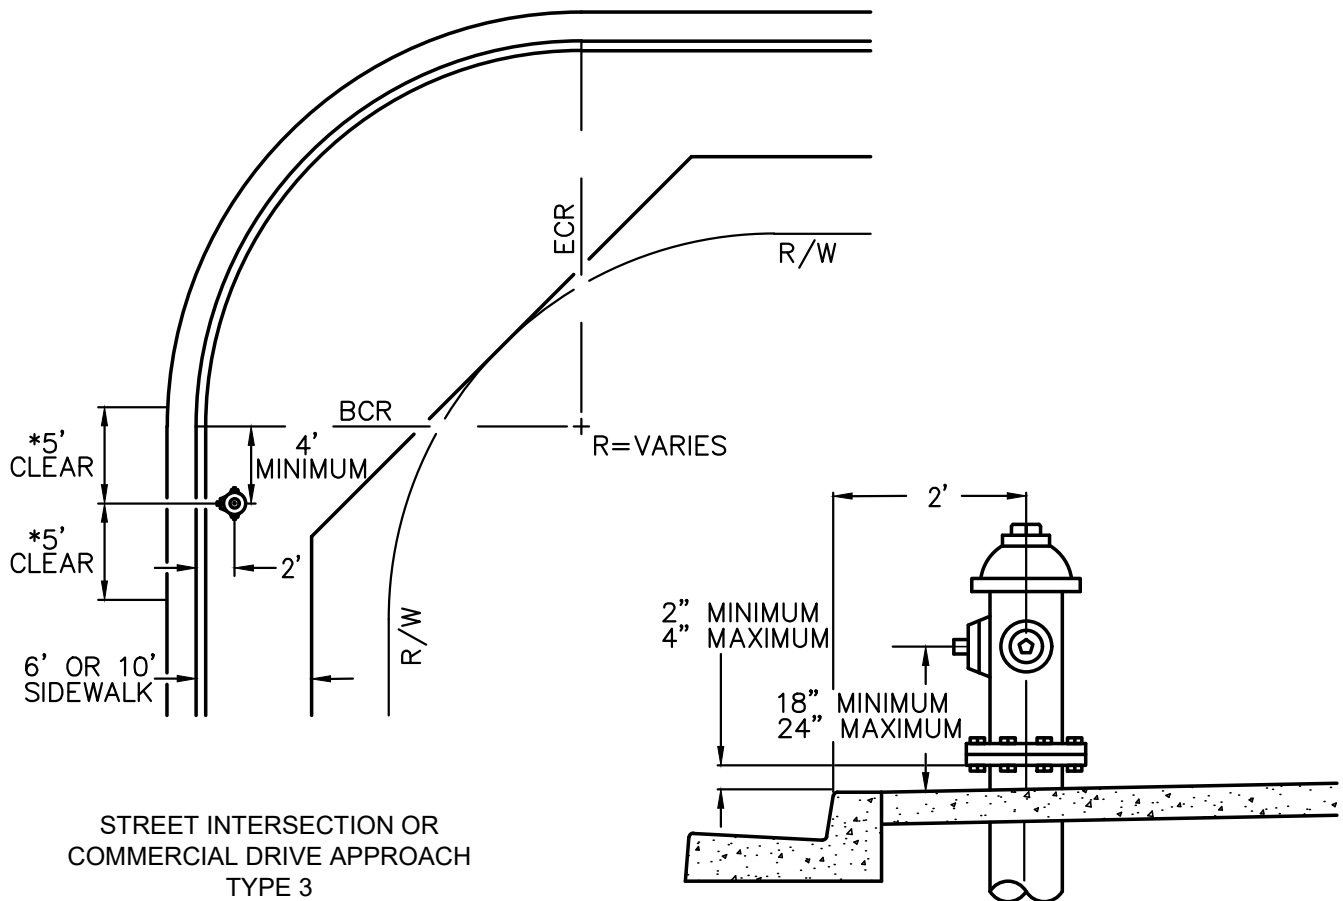


NOT TO SCALE

NOTES:

1. FIRE HYDRANTS ARE TO HAVE 6 INCH BARRELS WITH 2 EACH 2 INCH AND 2 1 EACH 4 INCH OUTLETS WITH NATIONAL STANDARD THREADS. HYDRANTS SHALL BE OF THE DRY BARREL, SELF DRAINING TYPE AND PAINTED SAFETY YELLOW AND BE APPROVED BY THE FIRE CHIEF.
2. FIRE HYDRANTS SHALL BE LOCATED AT STREET INTERSECTIONS AS SHOWN AT EITHER THE ECR OR BCR AND ELSEWHERE AS REQUIRED AT PROPERTY LINES. HYDRANTS SHALL BE PLACED PER CITY OF VICTORVILLE FIRE DEPARTMENT SPACING REQUIREMENTS.
3. A CLEAR WORKING AREA OF 5 FEET EITHER SIDE OF THE HYDRANT SHALL BE MAINTAINED. NO STRUCTURE; INCLUDING STREET LIGHTS, POWER POLES, UTILITY CABINETS OR MAILBOXES, SHALL BE ERECTED IN THIS AREA THAT PROJECT ABOVE THE TOP OF SIDEWALK.
4. PAINT TOP AND FACE OF CURB 15 FEET EITHER SIDE OF A FIRE HYDRANT RED (IE. NO PARKING). THE CURB IN A CURB RETURN OR DRIVEWAY APPROACH NEED NOT BE PAINTED.
5. RETROFITTED FIRE HYDRANTS SHALL HAVE THE SIDEWALK AND CURB & GUTTER SAWCUT, REMOVED AND REPLACED AT THE NEAREST SCORE LINE PER CITY STANDARDS AND AS DIRECTED BY THE ENGINEER IN THE FIELD.
6. FIRE HYDRANTS SHALL NOT BE LOCATED WITHIN 2 FEET OF A WING OF A DRIVEWAY.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	FIRE HYDRANT LOCATION	S-12
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

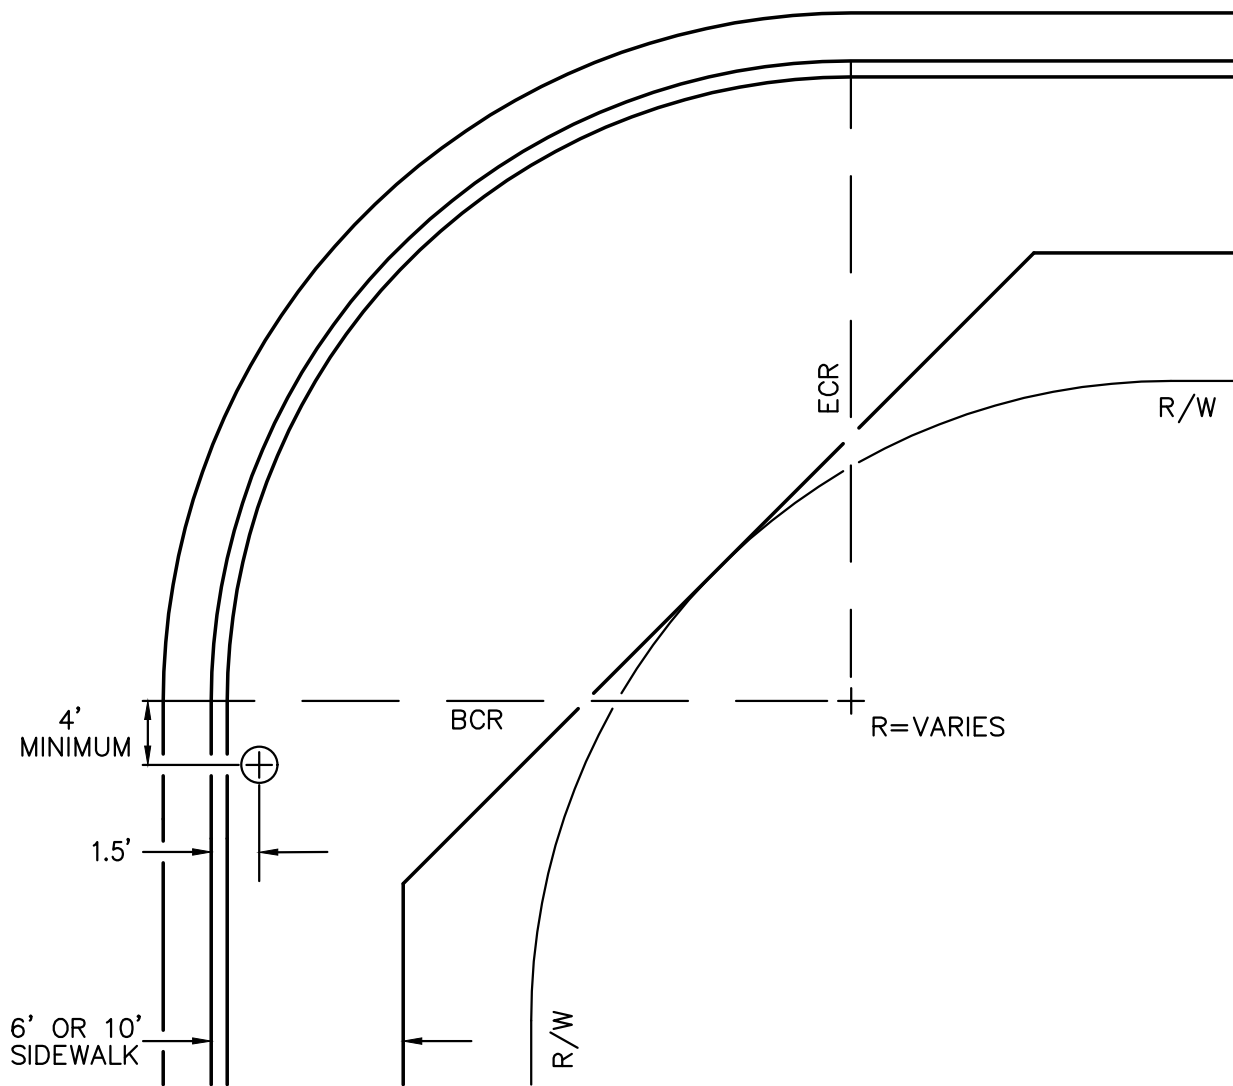

LOCATION






NOT TO SCALE

NOTES:

1. CORNER UTILITY LOCATION MAY BE BY EITHER THE BCR OR ECR AS SHOWN FOR POWER POLES AND STREET LIGHTS. NO UTILITY, EXCEPT SIGNALS SHALL BE LOCATED ON THE SIDEWALK IN THE CURB RETURN.
2. UTILITIES SHALL MAINTAIN 5 FEET CLEAR OF EXISTING AND PROPOSED FIRE HYDRANTS PER CITY STANDARD S-12.
3. RETROFITTED UTILITY SHALL HAVE THE SIDEWALK AND CURB & GUTTER SAWCUT, REMOVED AND REPLACED TO THE NEAREST SCORE LINE.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CORNER UTILITY LOCATION	S-13
4/20/26	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

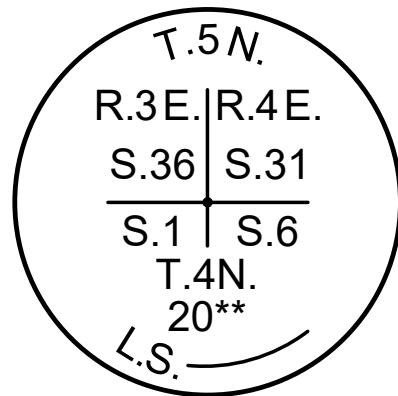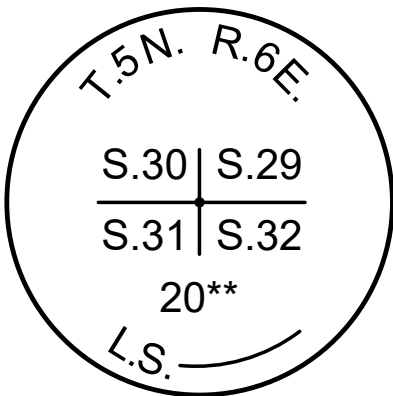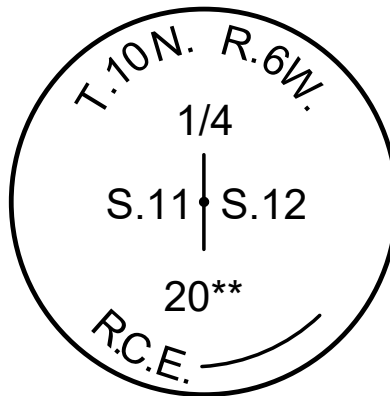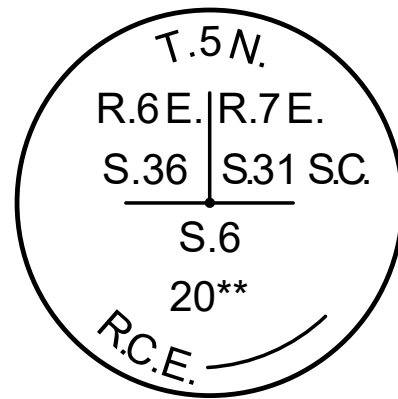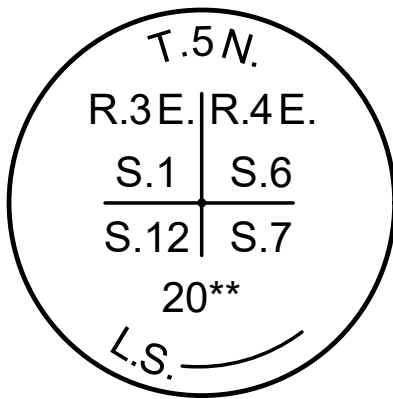

EXAMPLES OF BRASS CAP MONUMENTATION AT SECTIONAL CORNERS

NOTES:


1. FOR REPLACEMENT OF P.L.S.S. CORNERS SUCH AS SECTION CORNERS OR QUARTER CORNERS, USE A 2" IRON PIPE WITH A BRASS CAP STAMPED AS SHOWN ABOVE. ALL OTHER SURVEY MONUMENTS TO BE PER VICTORVILLE MUNICIPAL CODE TITLE 17.
2. ** - DENOTES YEAR NUMBER OF MONUMENTATION.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	P.L.S.S SURVEY MONUMENTATION REPLACEMENT	S-14
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	S-15
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

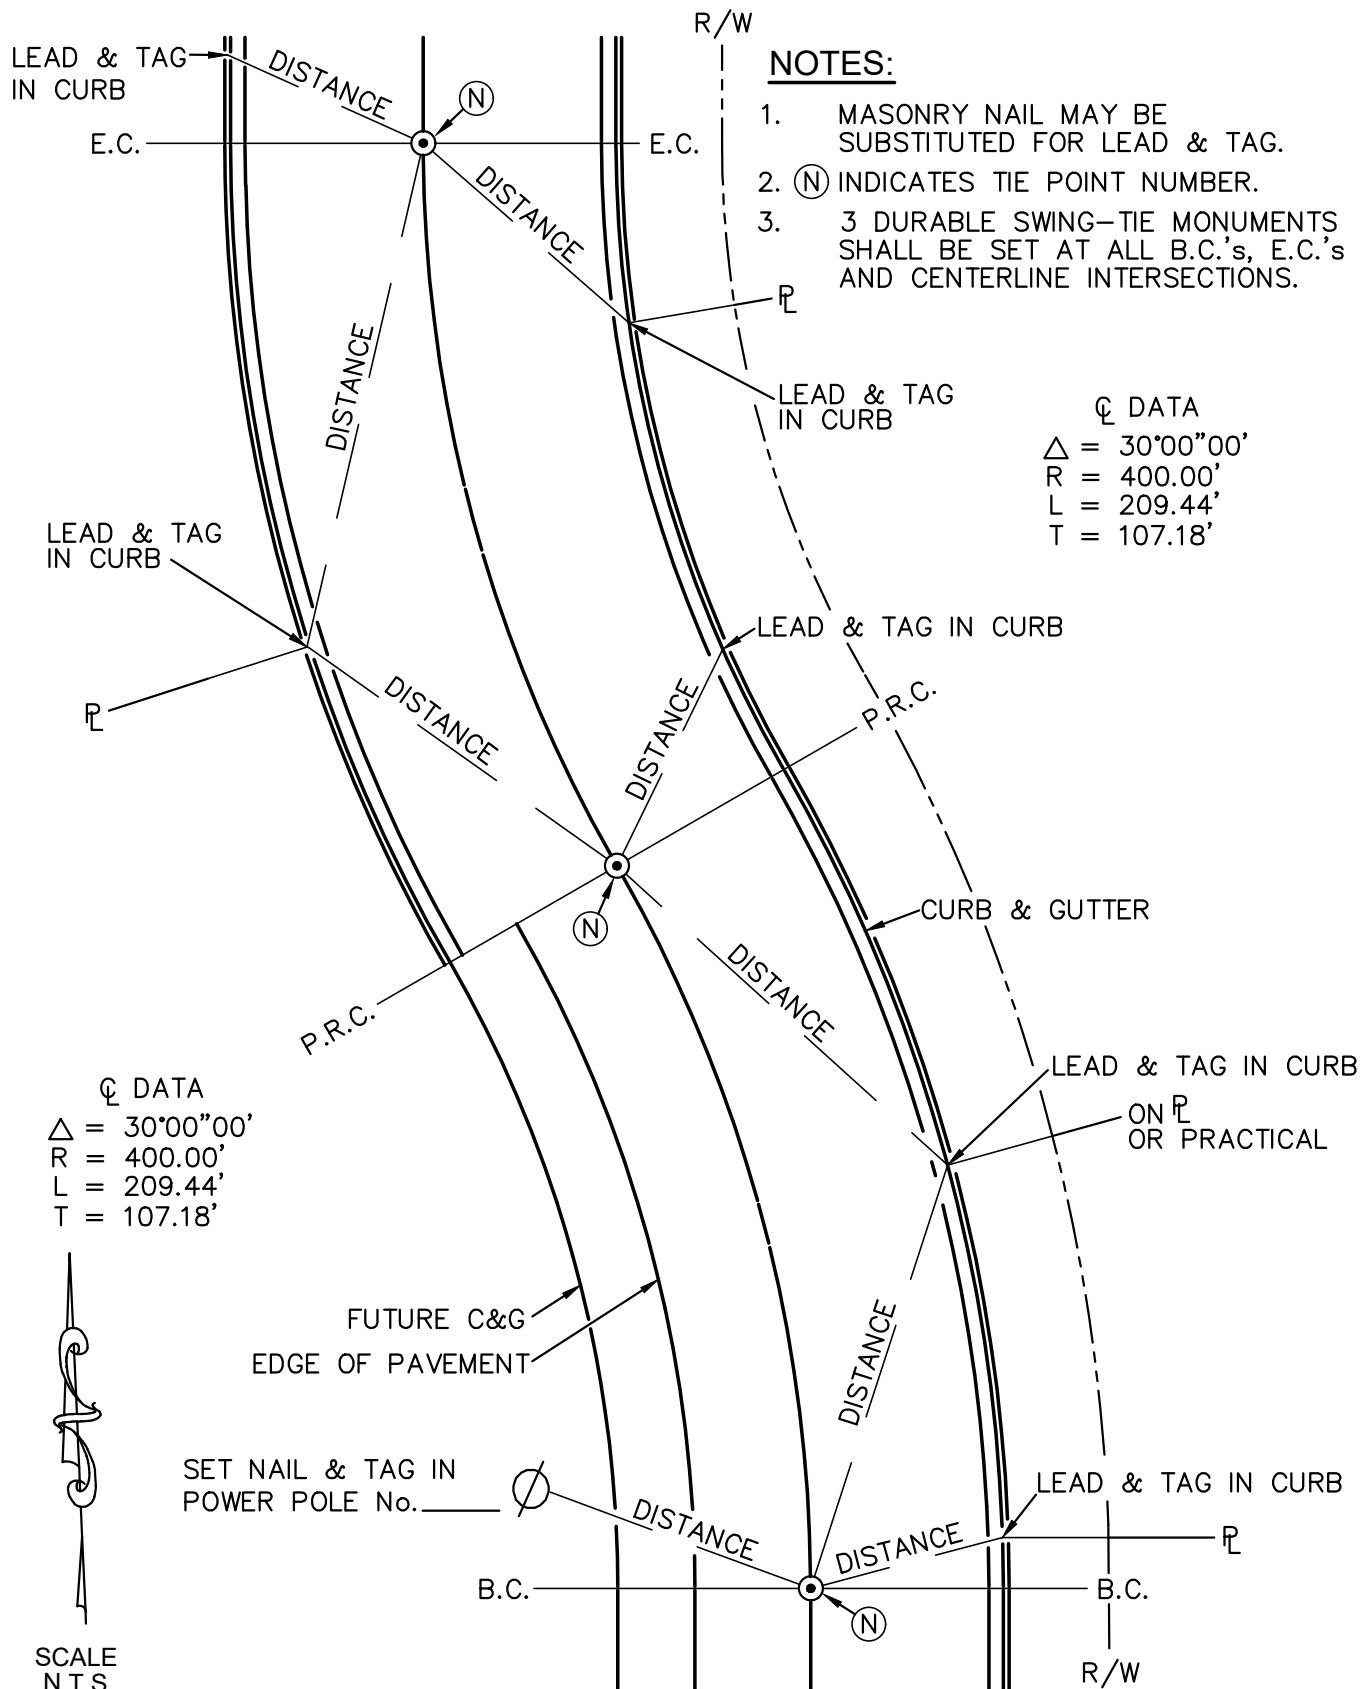


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE		BY	CENTERLINE SURVEY TIES STANDARD 1	S-16
		STAFF		
04/24/2026			FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

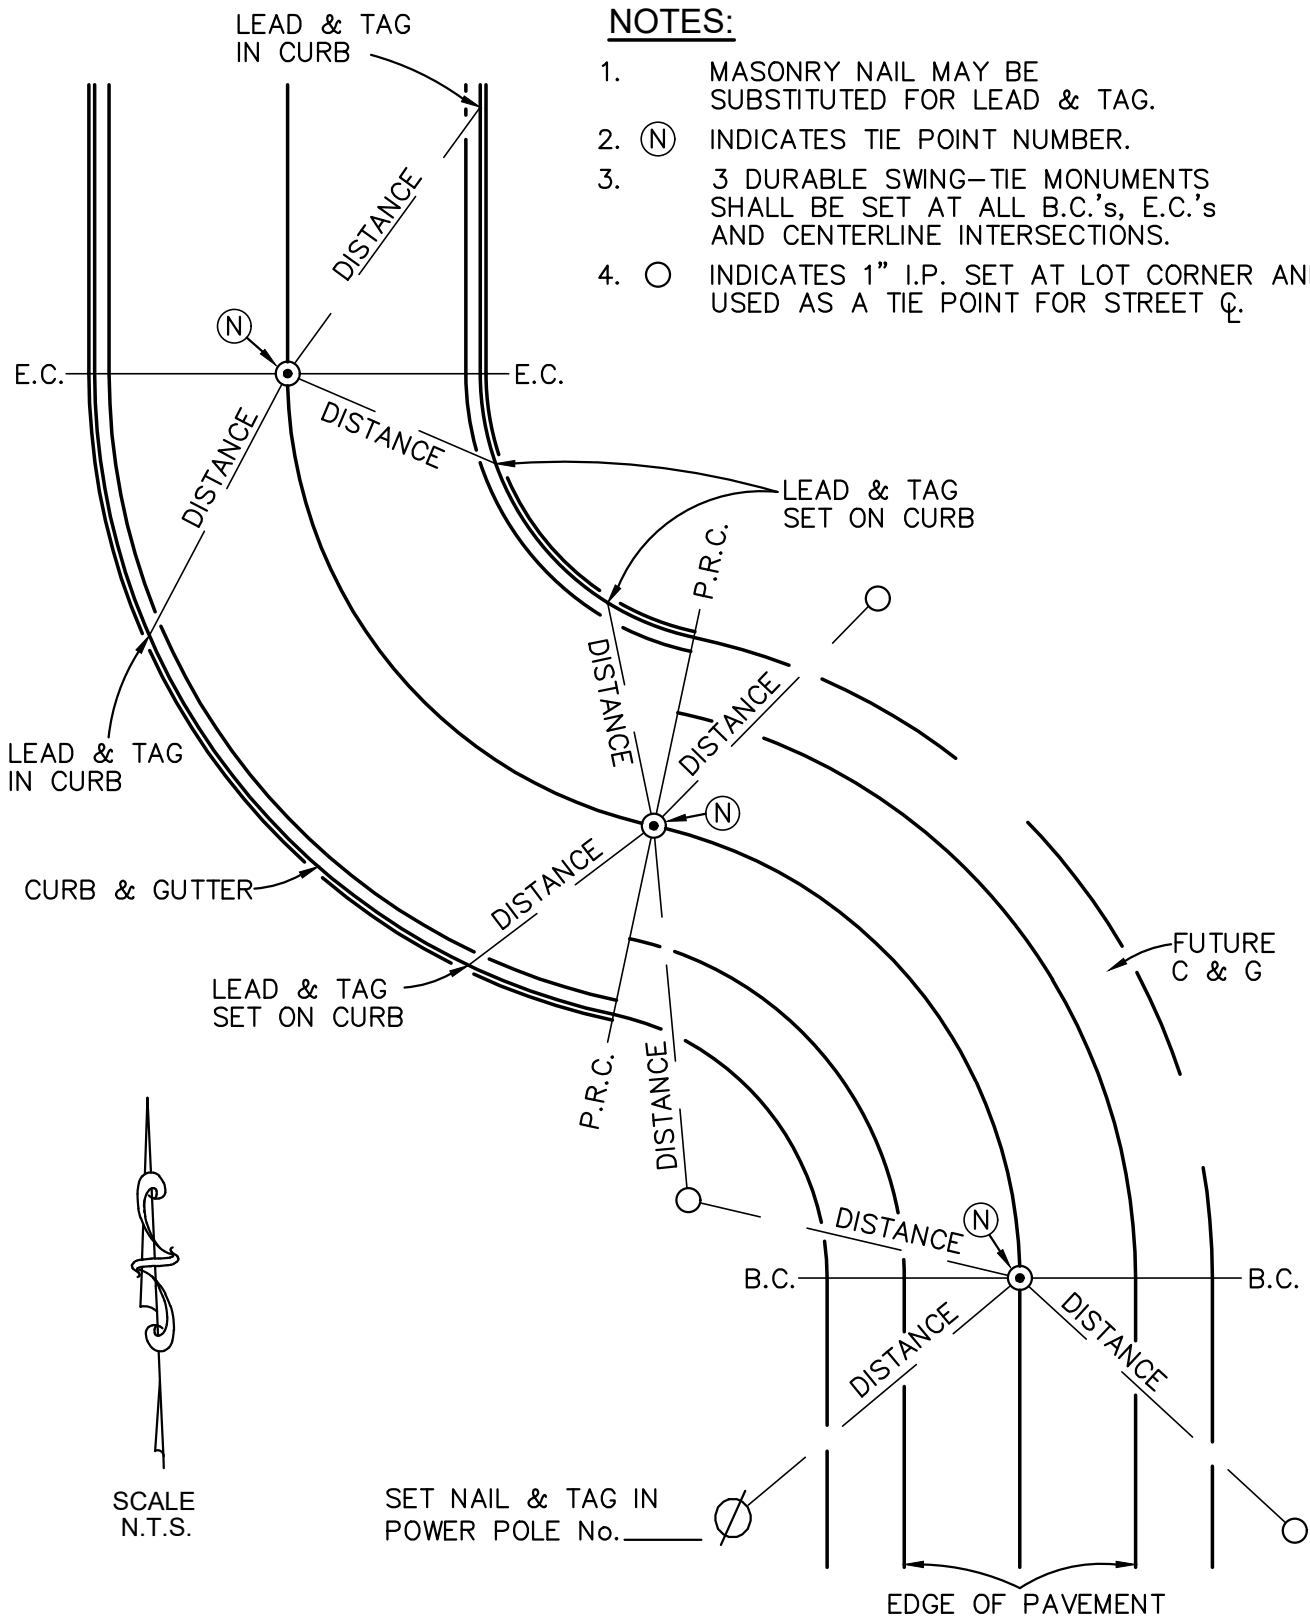


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CENTERLINE SURVEY TIES STANDARD 2	S-17
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

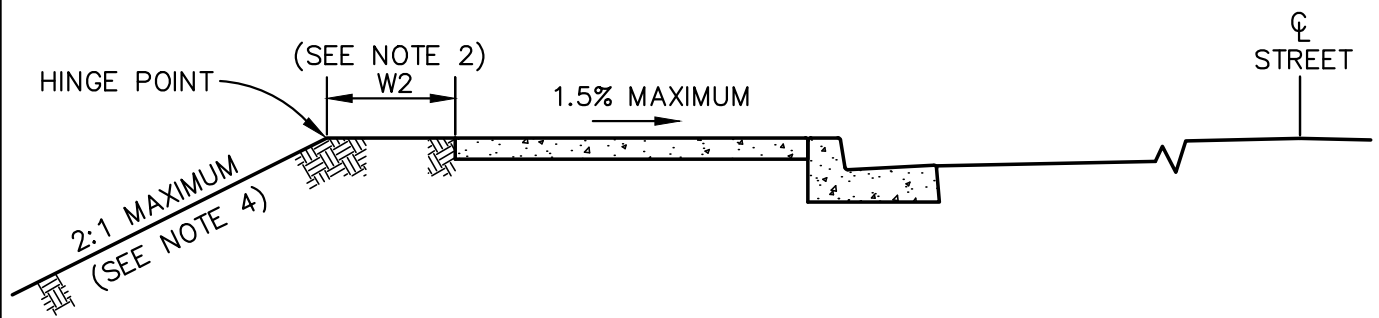

EXISTING OR FUTURE SIDEWALK
NOT TO SCALE

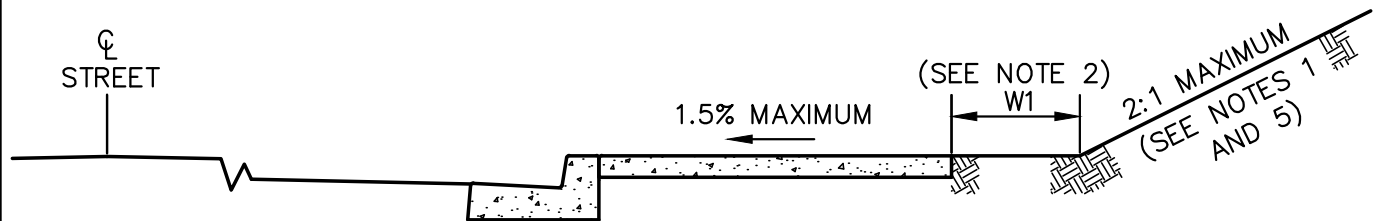

EXISTING OR FUTURE SIDEWALK
NOT TO SCALE

NOTES:

1. STEEPER SLOPES IN CUT SECTIONS MAY BE PERMITTED UP TO AN ABSOLUTE MAXIMUM OF 1½:1 PROVIDED REMEDIAL MEASURES AND/OR SOIL TESTS TOGETHER WITH THE RECOMMENDATIONS OF A QUALIFIED SOILS ENGINEER ARE PROVIDED SUBSTANTIATING THE PROPOSED SLOPE DESIGN.
2. W1 = 4 FEET MINIMUM FOR RESIDENTIAL ZONES.
W1 = 0 (ZERO) FEET FOR COMMERCIAL ZONES. REQUIRES PLACEMENT OF LANDSCAPE CURB PER CITY STANDARD S-09.
W2 = DEPENDENT ON RIGHT OF WAY WIDTH IN RESIDENTIAL ZONES, 4 FEET MINIMUM (HINGE POINT SHALL BE AT RIGHT OF WAY LINE.)
W2 = 2 FOOT FOR COMMERCIAL ZONES.
3. DEVIATION FROM THIS STANDARD MAY BE PERMITTED BASED ON ENGINEERED DESIGN TO ADEQUATELY PROVIDE FOR SUPPORT OF THE SIDEWALK AREA.
4. FOR COMMERCIAL ZONES, SLOPE EASEMENTS MAY BE REQUIRED AS DIRECTED BY THE CITY ENGINEER.
5. MAXIMUM OF 3:1 SLOPE IF INSIDE LANDSCAPE MAINTENANCE ASSESSMENT DISTRICT.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SLOPE AND PARKWAY GRADING REQUIREMENTS	S-18
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	BLANK INTENTIONALLY	S-19
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

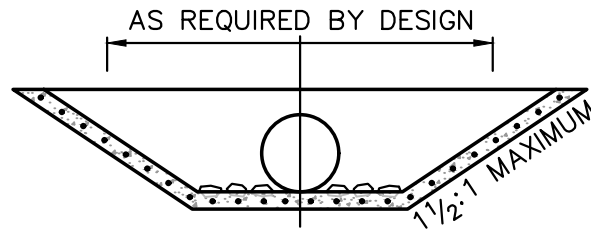


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	STANDARD CUTOFF WALL FOR DRAINAGE CHANNEL	S-20
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

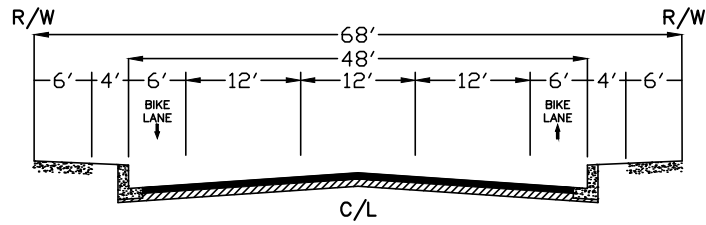


COLLECTOR

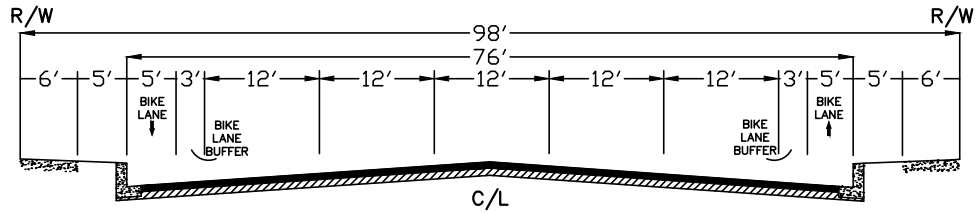


ARTERIAL

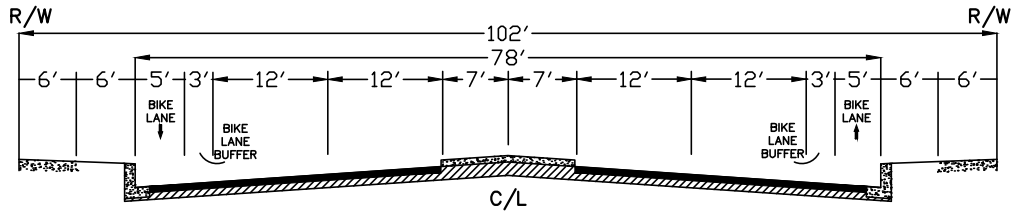

MAJOR ARTERIAL

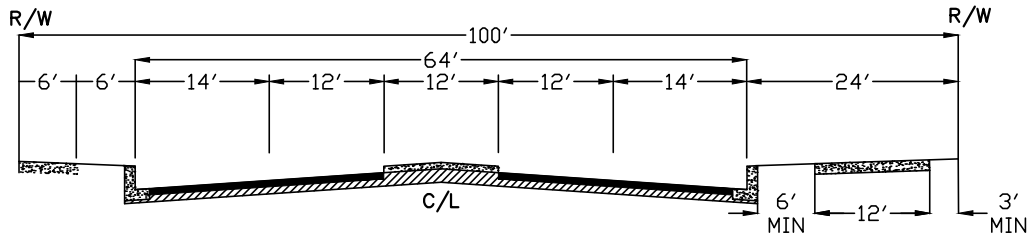

RESIDENTIAL ARTERIAL

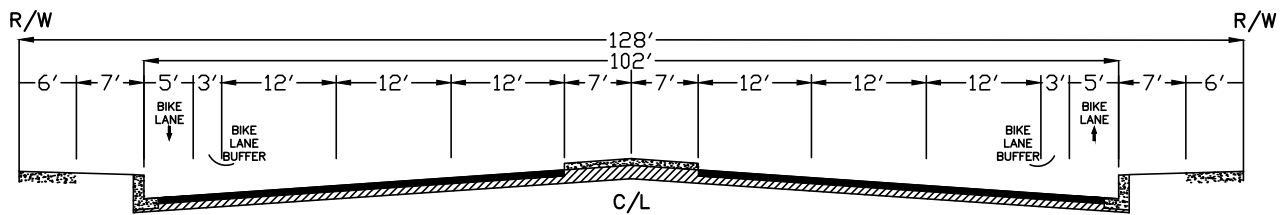

SUPER ARTERIAL

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE
04/24/2026

BY
STAFF


**STANDARD STREET GEOMETRIC
CROSS-SECTIONS**

FAB


FREDY A. BONILLA CITY ENGINEER

S-21


SHEET 1 OF 4

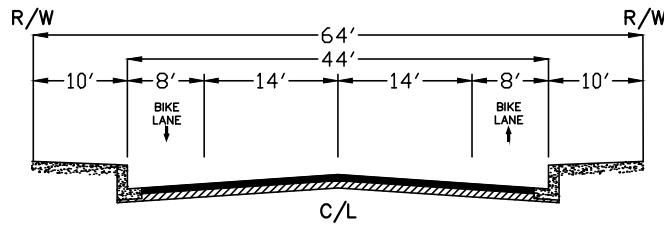


COLLECTOR

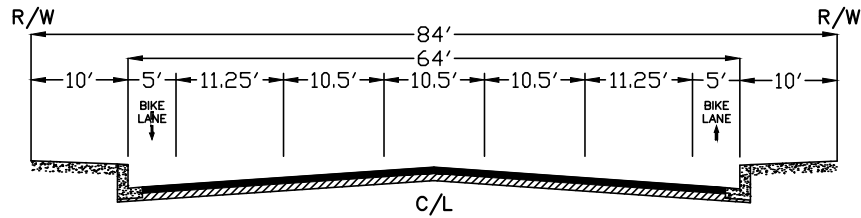


ARTERIAL

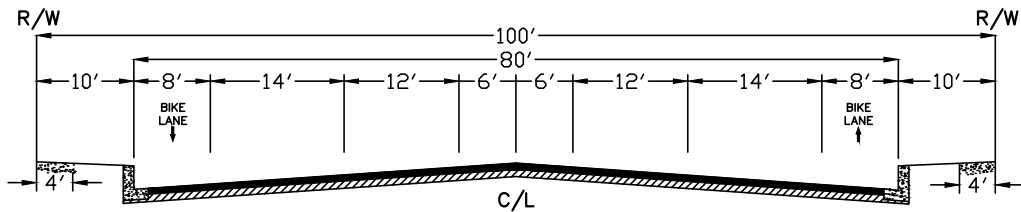

MAJOR ARTERIAL

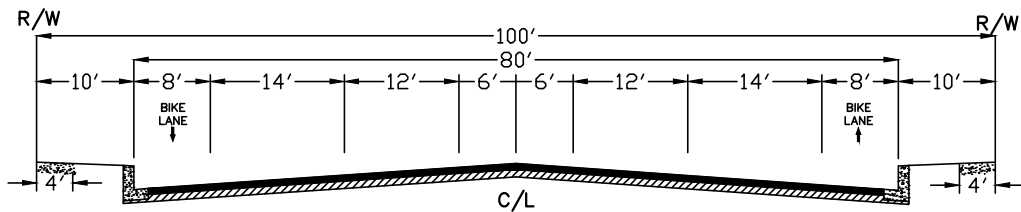


RESIDENTIAL ARTERIAL

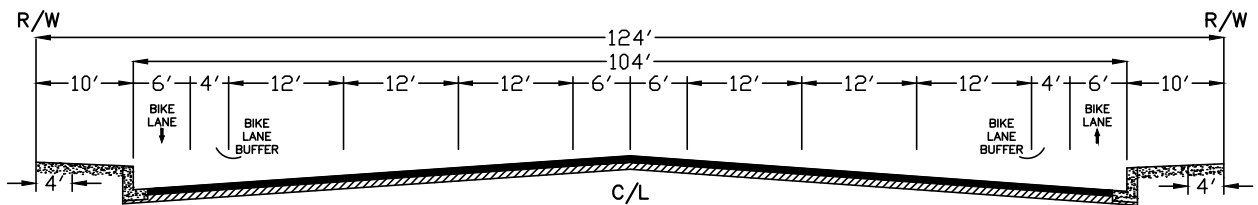


SUPER ARTERIAL

* USE OF RETROFIT STREET SECTIONS REQUIRE THE WRITTEN APPROVAL OF THE CITY ENGINEER


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	RETROFIT STREET GEOMETRIC CROSS-SECTIONS	S-21
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 4

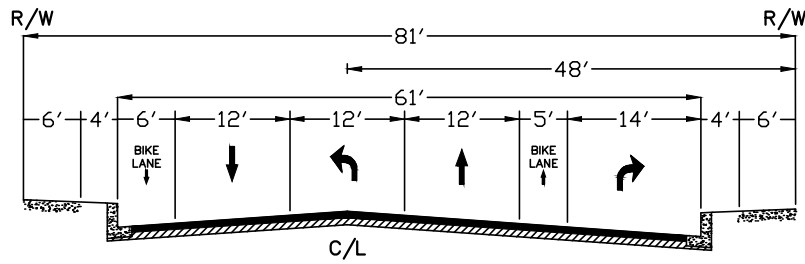


COLLECTOR

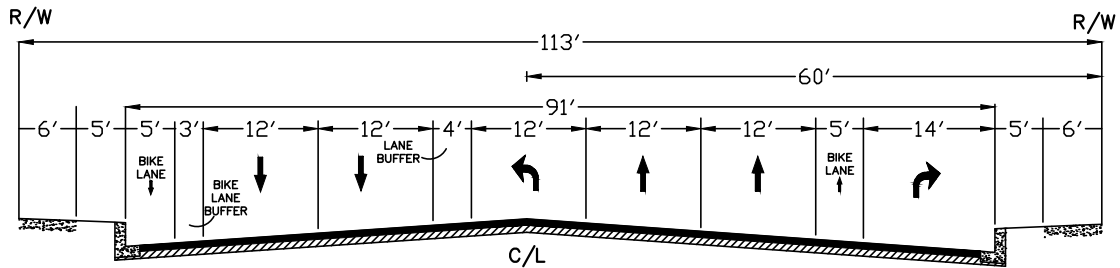


ARTERIAL

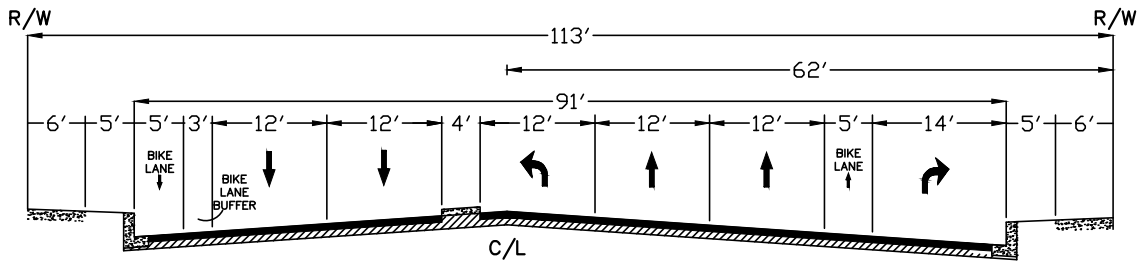

MAJOR ARTERIAL

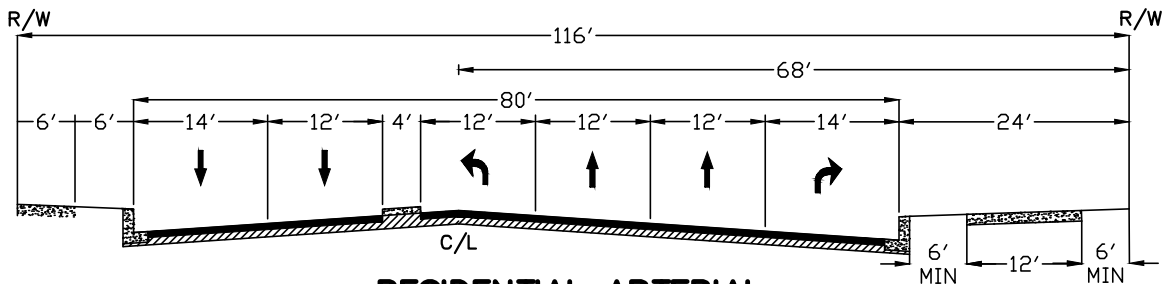


RESIDENTIAL ARTERIAL

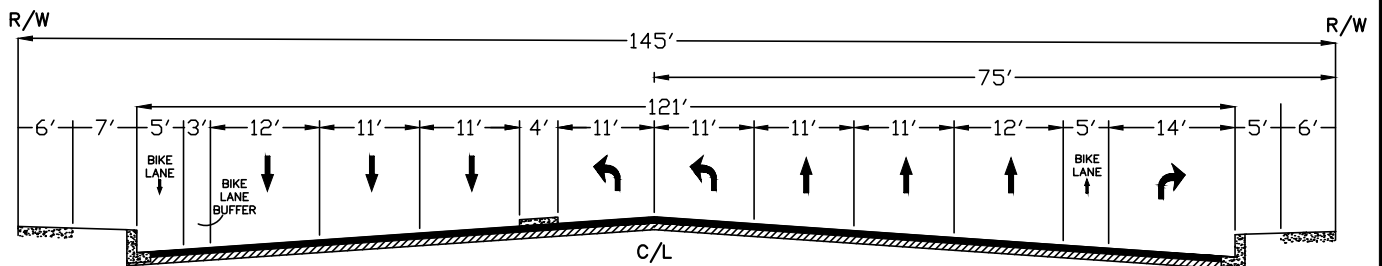


SUPER ARTERIAL

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	MASTER PLANNED SECTIONS	S-21
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 3 OF 4

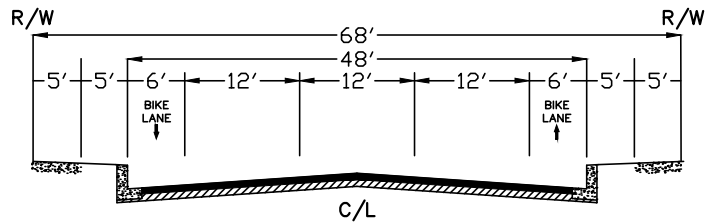

COLLECTOR

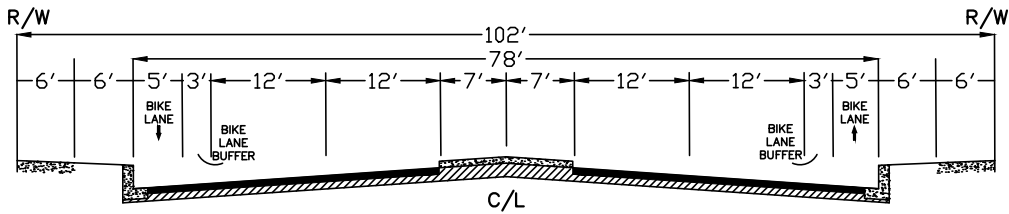

MAJOR ARTERIAL

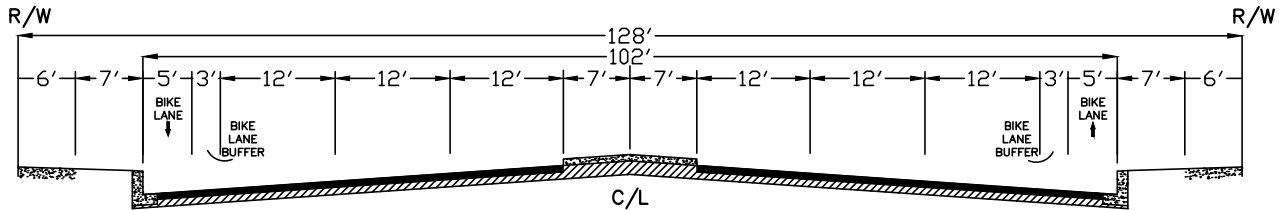

SUPER ARTERIAL




NOTES:

MODIFIED SUPER ARTERIAL:

1. THE CENTERLINE SHOWN ON THIS STANDARD IS THE CENTERLINE OF THE STREET IMPROVEMENTS, NOT THE CENTERLINE OF RIGHT-OF-WAY.
2. LANE, SIDEWALK, AND RIGHT-OF-WAY WIDTHS ARE SHOWN AT THE MINIMUM REQUIRED WIDTHS TO FIT WITHIN RESTRICTED RIGHT-OF-WAY OUTSIDE OF THE DEVELOPMENT.
3. THE STANDARD SUPER ARTERIAL DEDICATION WIDTH AND STREET IMPROVEMENT WIDTHS SHALL BE REQUIRED ALONG THE DEVELOPMENT FRONTAGE.
4. EXCEPTIONS TO DEDICATING THE STANDARD SUPER ARTERIAL WIDTH AND IMPROVING FRONTAGE OF A DEVELOPMENT TO THE STANDARD SUPER ARTERIAL STREET WIDTH REQUIRE CITY ENGINEER APPROVAL.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SCLA STREET GEOMETRIC CROSS-SECTIONS	S-21
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 4 OF 4

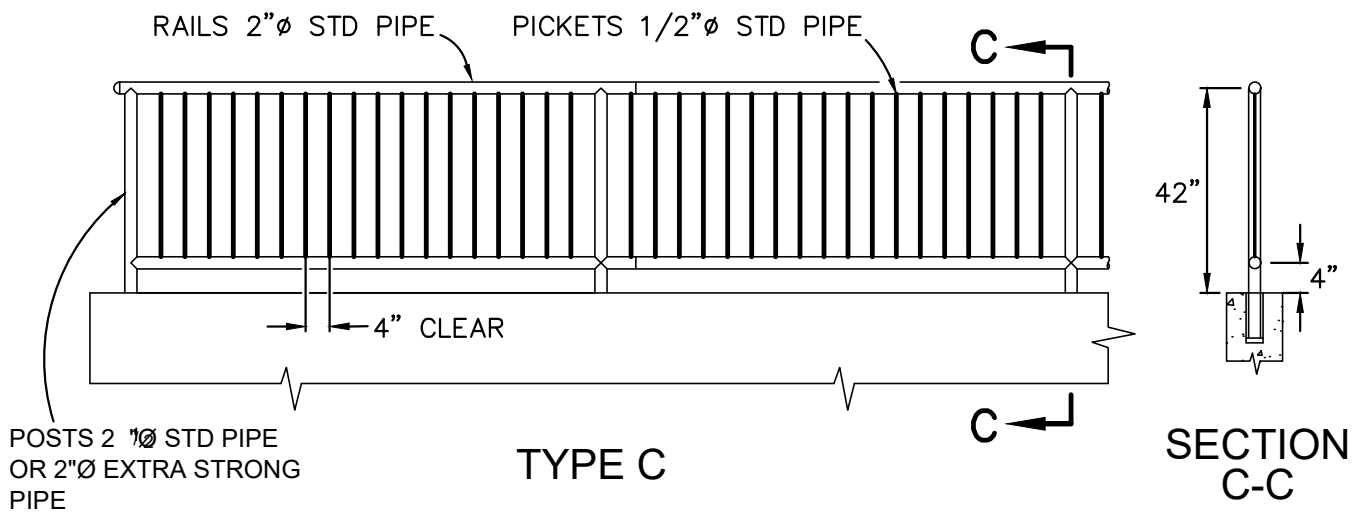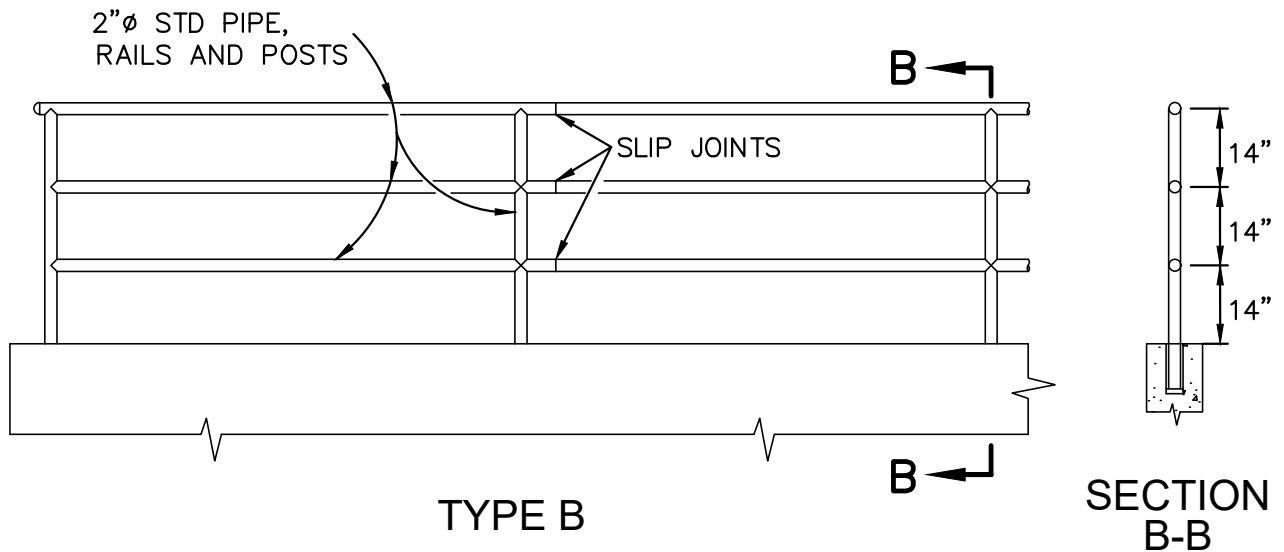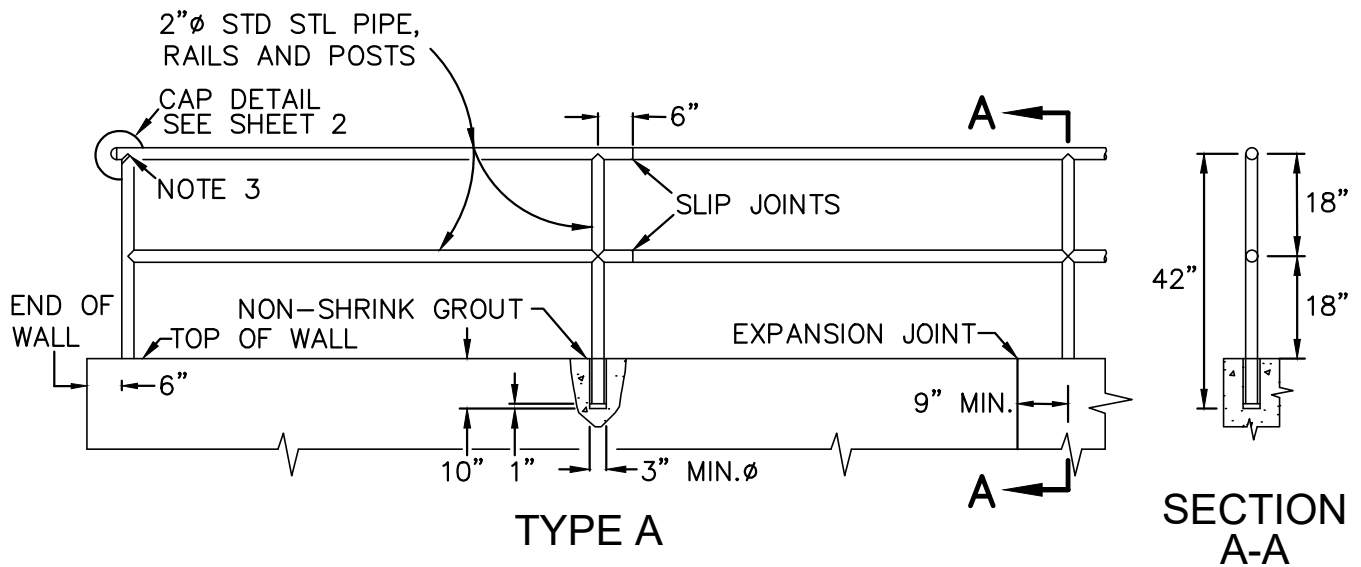


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	METAL HAND RAILINGS	S-22
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 2

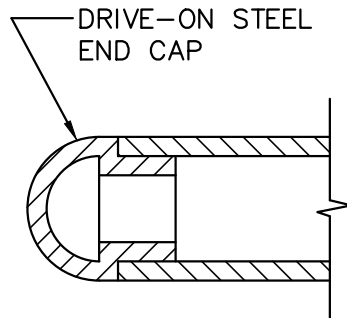

CAP DETAIL FOR RAIL END

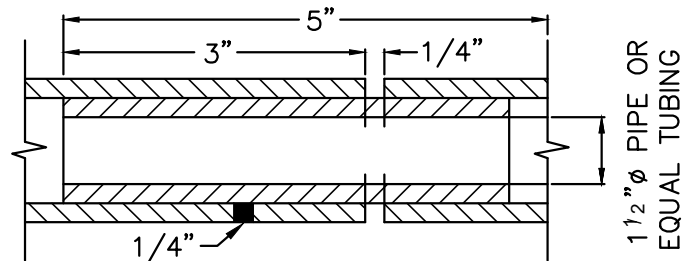

SLIP JOINT DETAIL

NOTES:


1. RAILS, POSTS AND PICKETS SHALL BE GALVANIZED STEEL PIPE.
2. MAXIMUM SPACING OF POSTS SHALL BE 8' ON STRAIGHT ALIGNMENTS AND 6' ON CURVED ALIGNMENTS WITH LESS THAN 30' RADIUS. MAKE SPACING UNIFORM BETWEEN CHANGES IN ALIGNMENT.
3. WELDS SHALL BE SLOT OR FILLET WELDS EQUAL TO THICKNESS OF PIPE. WELD ALL JOINTS ALL AROUND.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	METAL HAND RAILINGS	S-22
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	S-23
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

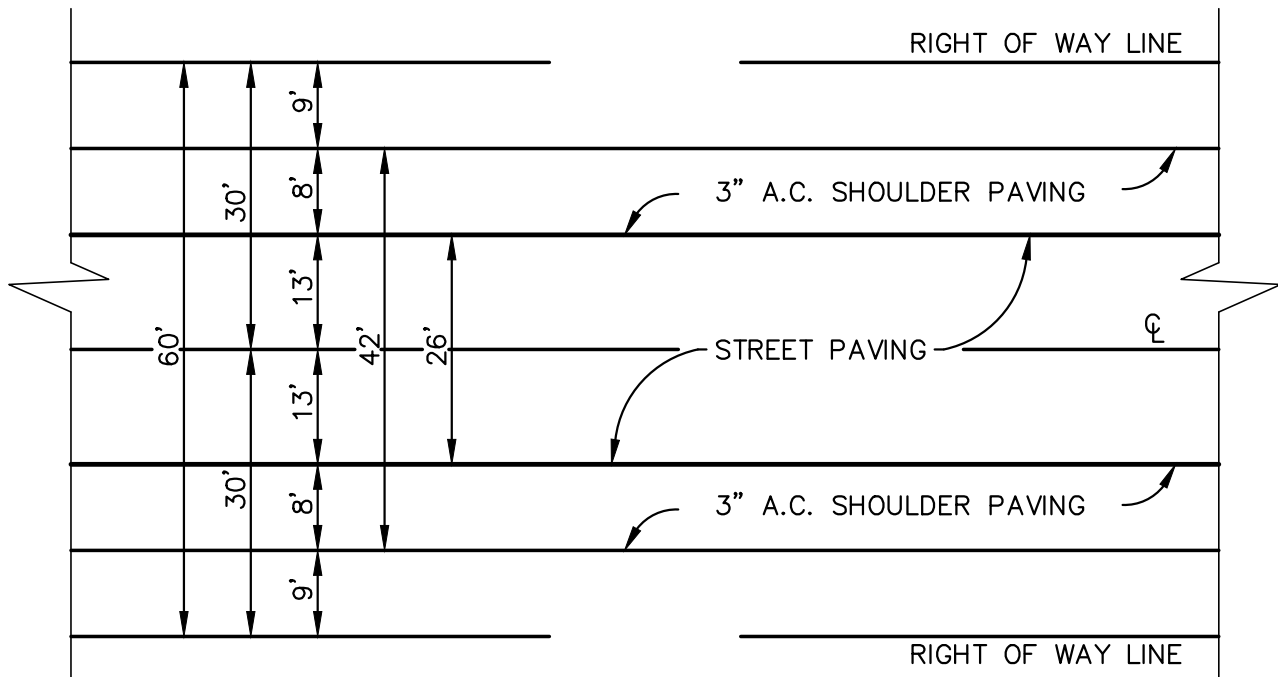

PLAN
NOT TO SCALE

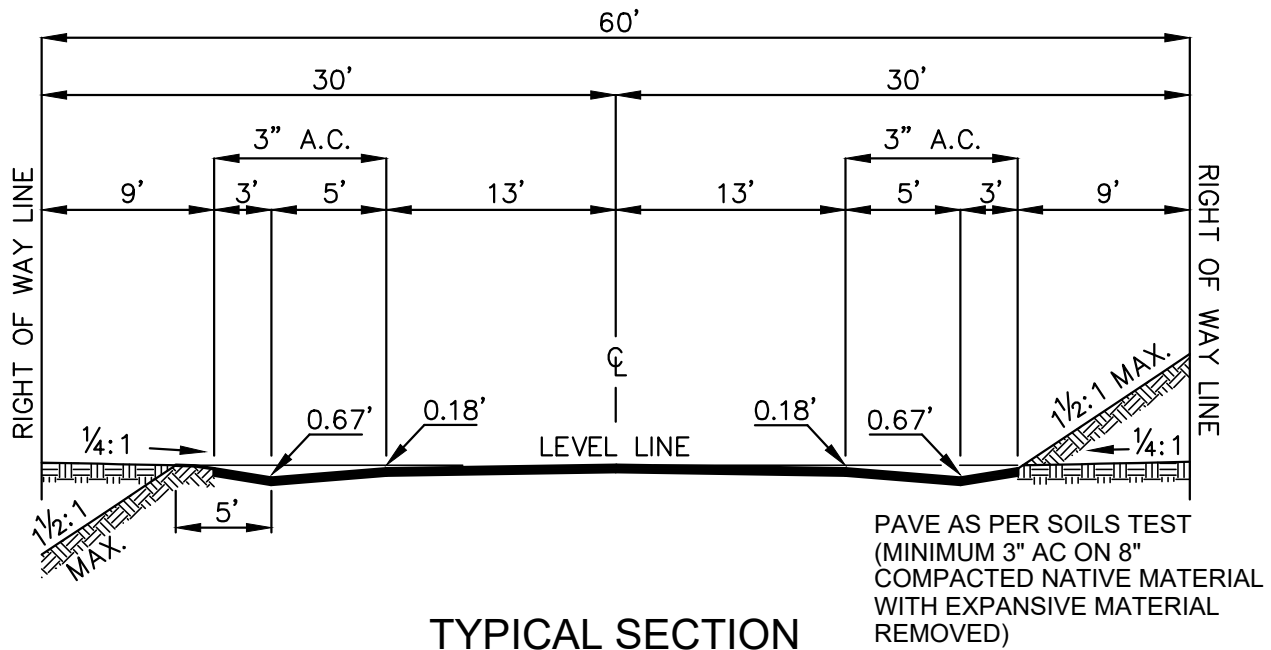

TYPICAL SECTION
NOT TO SCALE

NOTES:

1. ADDITIONAL DRAINAGE IMPROVEMENTS TO BE INSTALLED AS REQUIRED.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	RURAL STREET SECTION	S-24
04/24/2026	STAFF	FOR RESIDENTIAL AREAS WITH LOTS OF 1 ACRE OR MORE	
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

STREET CLASSIFICATION	RIGHT OF WAY WIDTH (FEET)	DESIGN SPEED (MPH)	CENTERLINE RADIUS (FT. MINIMUM)	GRADE (% MAXIMUM)	TRAFFIC INDEX (MINIMUM)	PAVEMENT SECTION EQUIVALENT (AC/BASE, INCHES MINIMUM)
LOCAL	60	25	300	10%	6	3"/8"
COLLECTOR	64-68	40	600	7%	8	3.5"/8"
ARTERIAL	84-98	50		7%	10	5.5"/8"
MAJOR ARTERIAL	100-102	55			11	6"/10"
SUPER ARTERIAL	124-128	65			12*	7"/10"

NOTES:

1. REQUIRED RIGHT OF WAY WIDTH MAY BE INCREASED FOR SPECIAL REQUIREMENTS AS DETERMINED BY THE CITY ENGINEER.
2. MINIMUM CENTERLINE RADIUS FOR ALL STREETS SHALL COMPLY WITH THE HIGHWAY DESIGN MANUAL. (MINIMUM 300' RESIDENTIAL STREETS AND MINIMUM 600' COLLECTOR STREETS).
3. CENTERLINE RADIUS MAY HAVE TO BE INCREASED TO MEET MINIMUM SIGHT DISTANCE STANDARDS.
4. * TRAFFIC INDEX FOR BEAR VALLEY ROAD AND AIR EXPRESSWAY IS 13.
5. PAVEMENT SECTION IS BASED ON AN ASSUMED R-VALUE OF 50. PAVEMENT SECTION DESIGN IS DETERMINED BY TI AND R-VALUE PER THE HIGHWAY DESIGN MANUAL.

CURB RETURN RADIUS (FEET)					
STREET CLASSIFICATION	LOCAL	COLLECTOR	ARTERIAL	MAJOR ARTERIAL	SUPER ARTERIAL
LOCAL	20				
COLLECTOR	25	25			
ARTERIAL	30	30	35		
MAJOR ARTERIAL	30	30	35	40	
SUPER ARTERIAL	35	40	50	50	50

NOTES:

1. CALTRANS REQUIRES A 50 FOOT RADIUS FOR STREET CONNECTIONS TO STATE ROUTES.



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STREET DESIGN STANDARDS	S-25
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 5

MINIMUM TANGENT LENGTH AT INTERSECTIONS (FEET)*					
STREET CLASSIFICATION	ON A LOCAL CONNECTING TO A	ON A COLLECTOR CONNECTING TO A	ON AN ARTERIAL CONNECTING TO A	ON A MAJOR ARTERIAL CONNECTING TO A	ON A SUPER ARTERIAL CONNECTING TO A
LOCAL	60				
COLLECTOR	65	100			
ARTERIAL	75	120	160		
MAJOR ARTERIAL	85	140	200	260	
SUPER ARTERIAL	100	160	240	320	400

*LENGTH IS FROM CENTERLINE OF INTERSECTION

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	STREET DESIGN STANDARDS	S-25
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 5

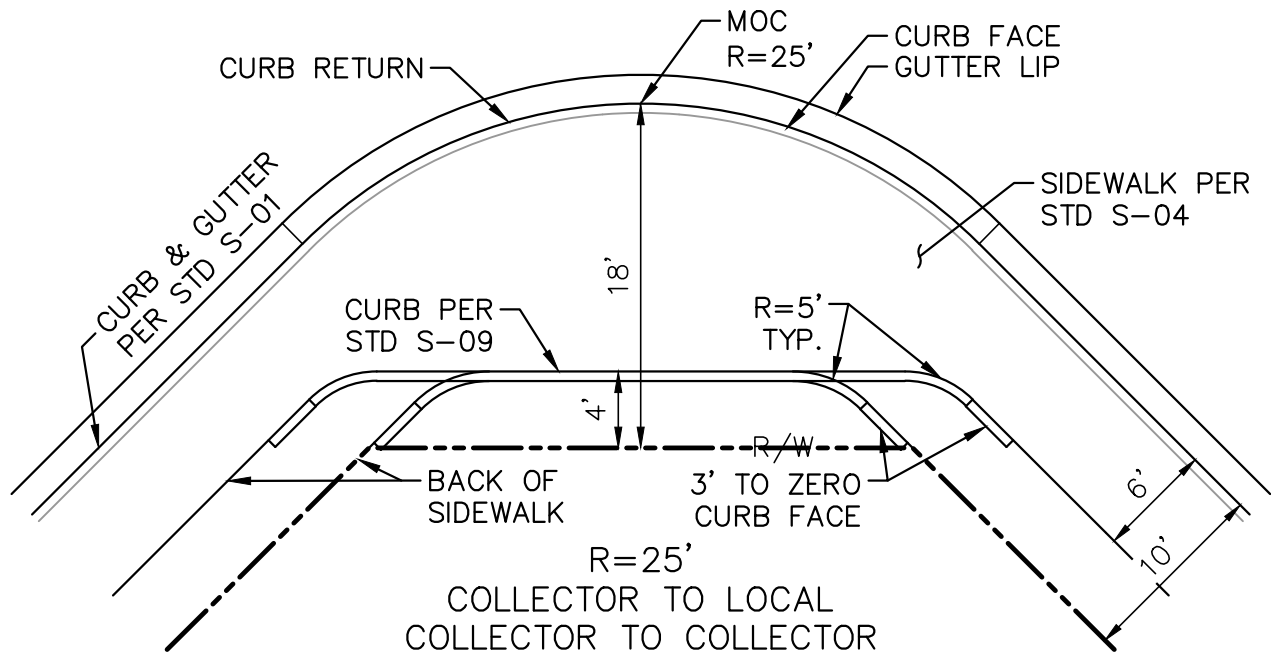
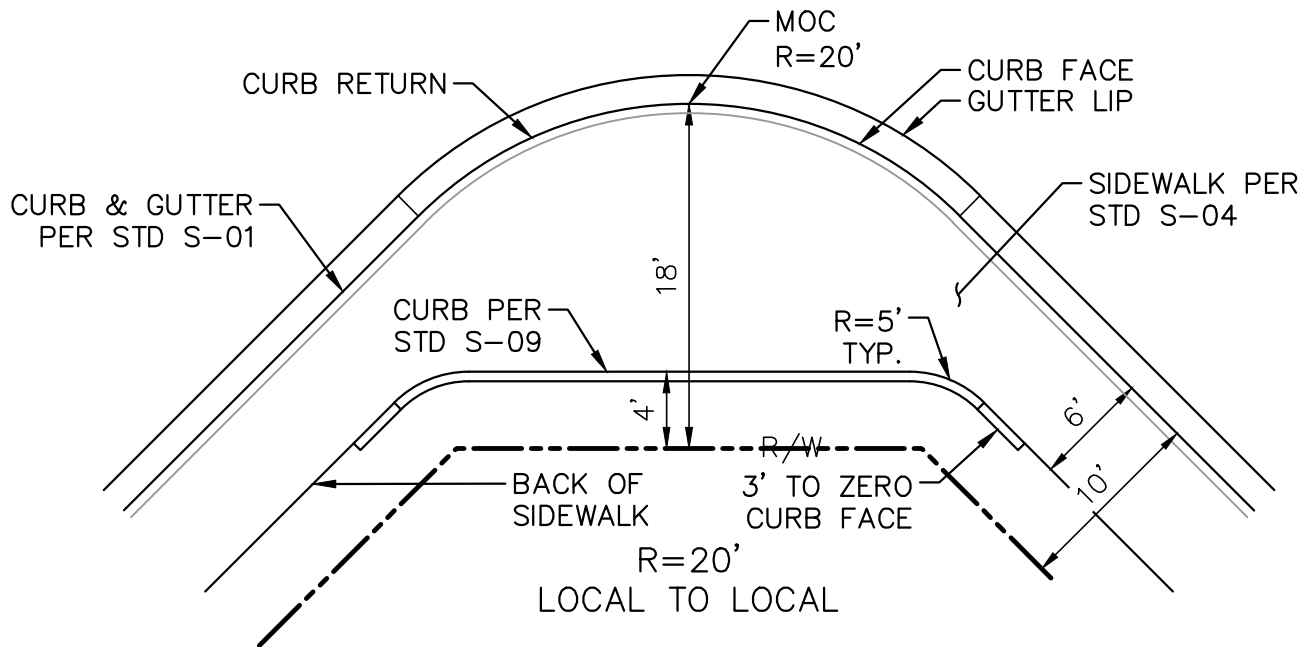


NOTES:

1. THE CURB RETURN SHALL BE CONSTRUCTED OF A CURB AND GUTTER PER CITY STD S-01 OR A CURB AND SPANDREL PER CITY STD S-05.
2. SIDEWALK APPROACHING THE CURB RETURN SHALL BE 6' WIDE FOR RESIDENTIAL OR 10' WIDE FOR COMMERCIAL AND INDUSTRIAL PER CITY STD S-04.
3. CURB RAMPS SHALL BE CONSTRUCTED PER CITY STD S-11.
4. A CURB PER CITY STD S-09 SHALL BE CONSTRUCTED AT THE BACK OF THE RETURN.
5. THE CORNER CUT OFF FOR THE PUBLIC RIGHT OF WAY DEDICATION SHALL BE OFFSET 18' FROM THE CURB FACE RADIUS TANGENT TO A RADIAL LINE AT THE MIDPOINT OF CURVE (MOC).



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STREET DESIGN STANDARDS	S-25
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 3 OF 5

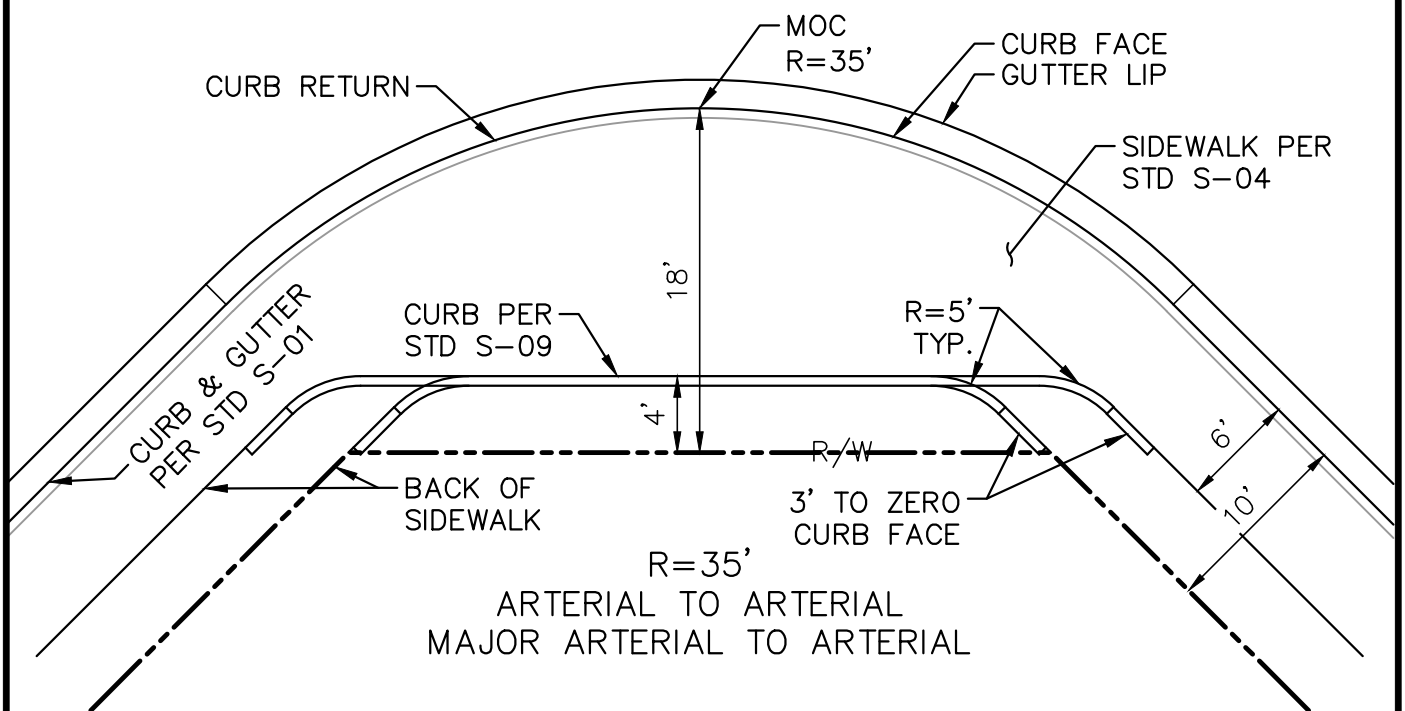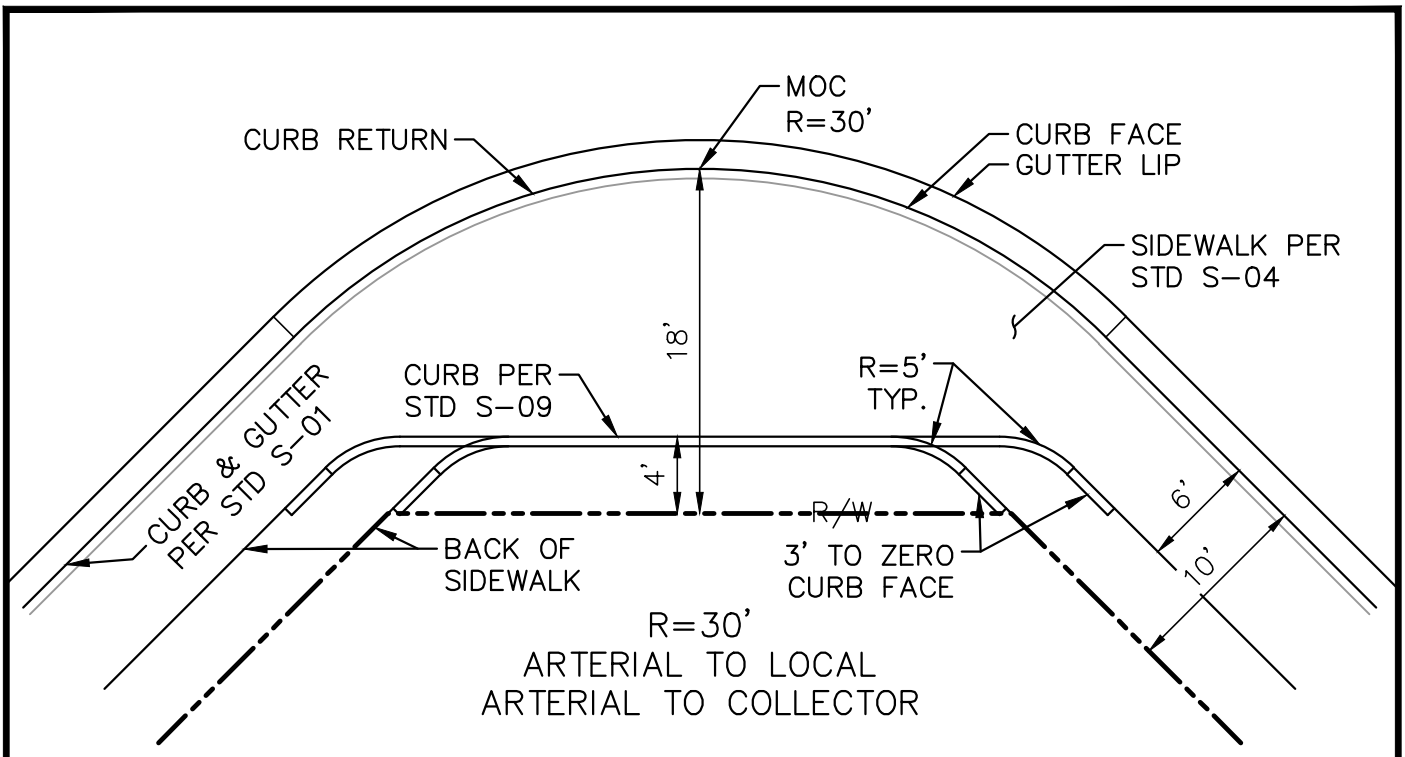


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STREET DESIGN STANDARDS	S-25
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 4 OF 5

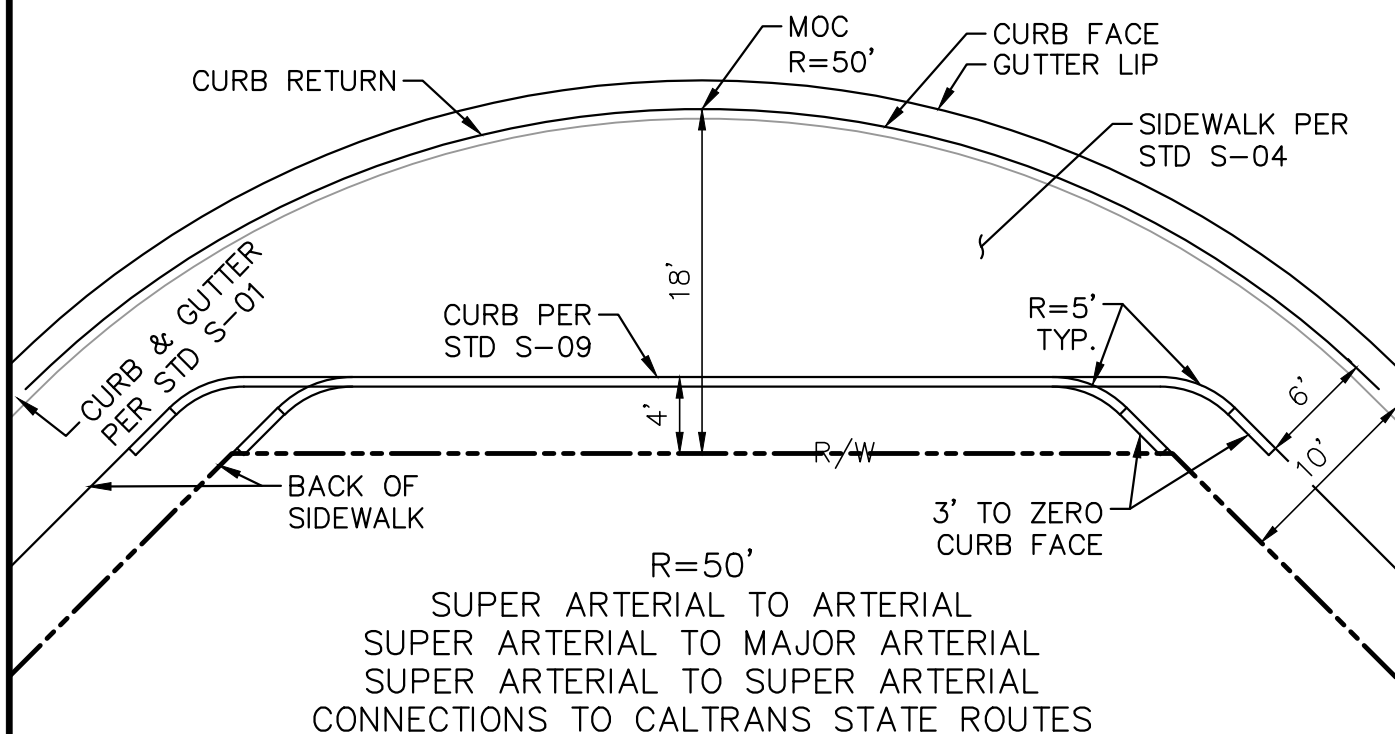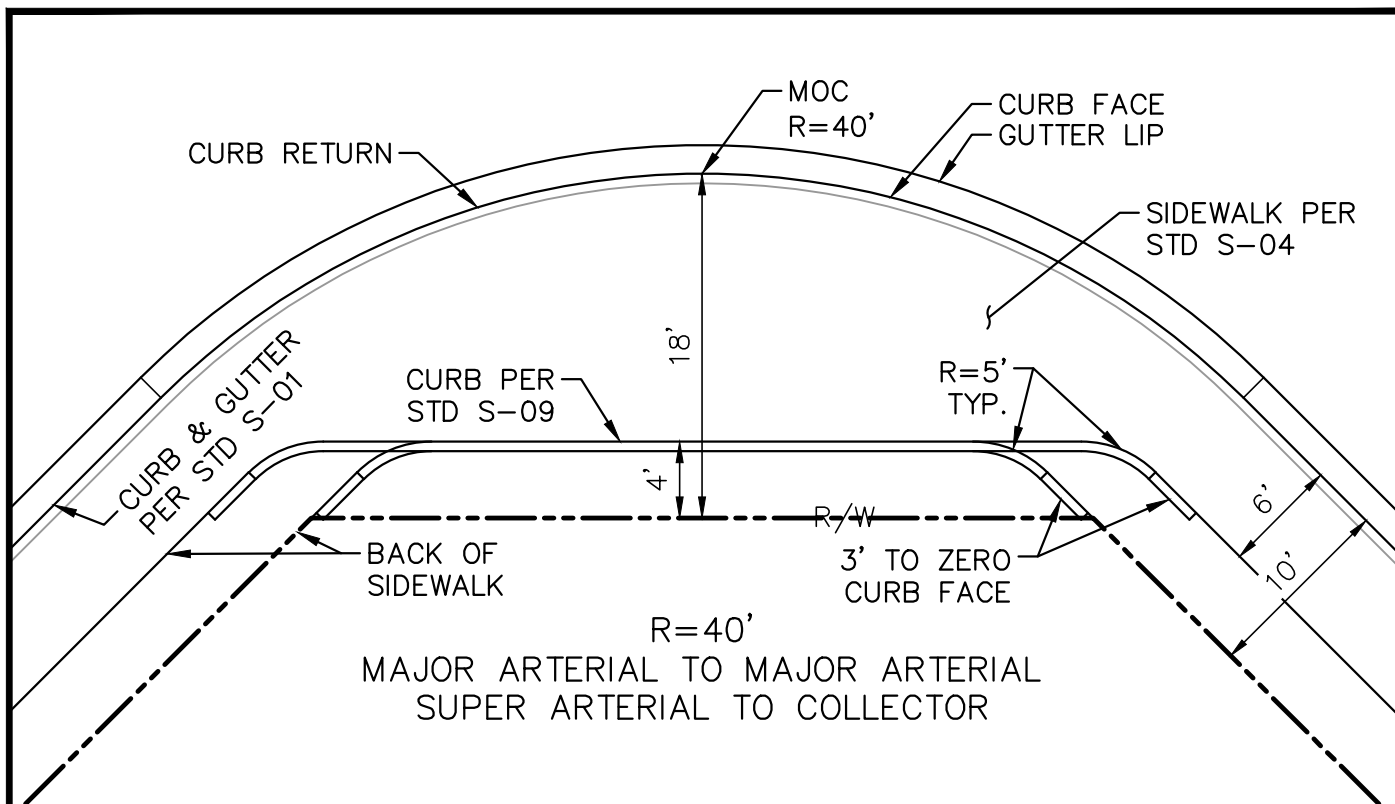

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STREET DESIGN STANDARDS	S-25
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 5 OF 5

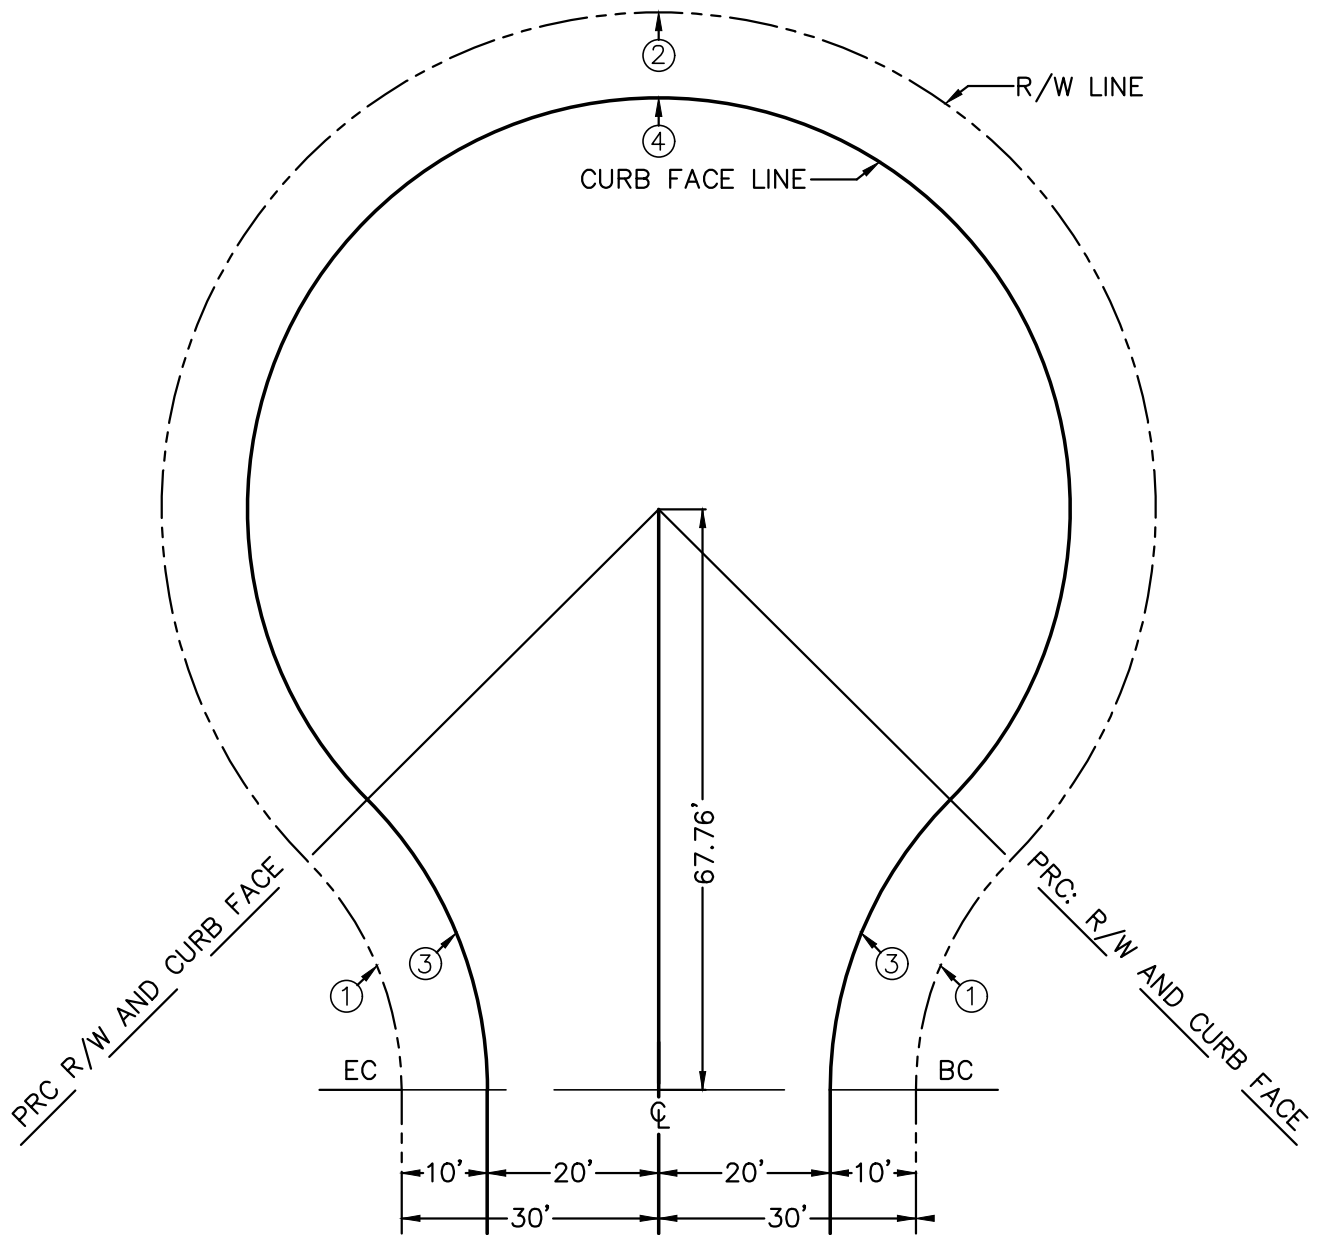


PLAN
NOT TO SCALE

	DELTA	RADIUS	LENGTH	TANGENT
①	44°53'47"	38.00	29.78	16.67
②	269°48'04"	58.00	273.12	58.21
③	44°53'47"	48.00	37.61	17.92
④	269°48'04"	48.00	226.03	48.17

CURVE TABLE

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	TYPICAL CUL-DE-SAC	S-26
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

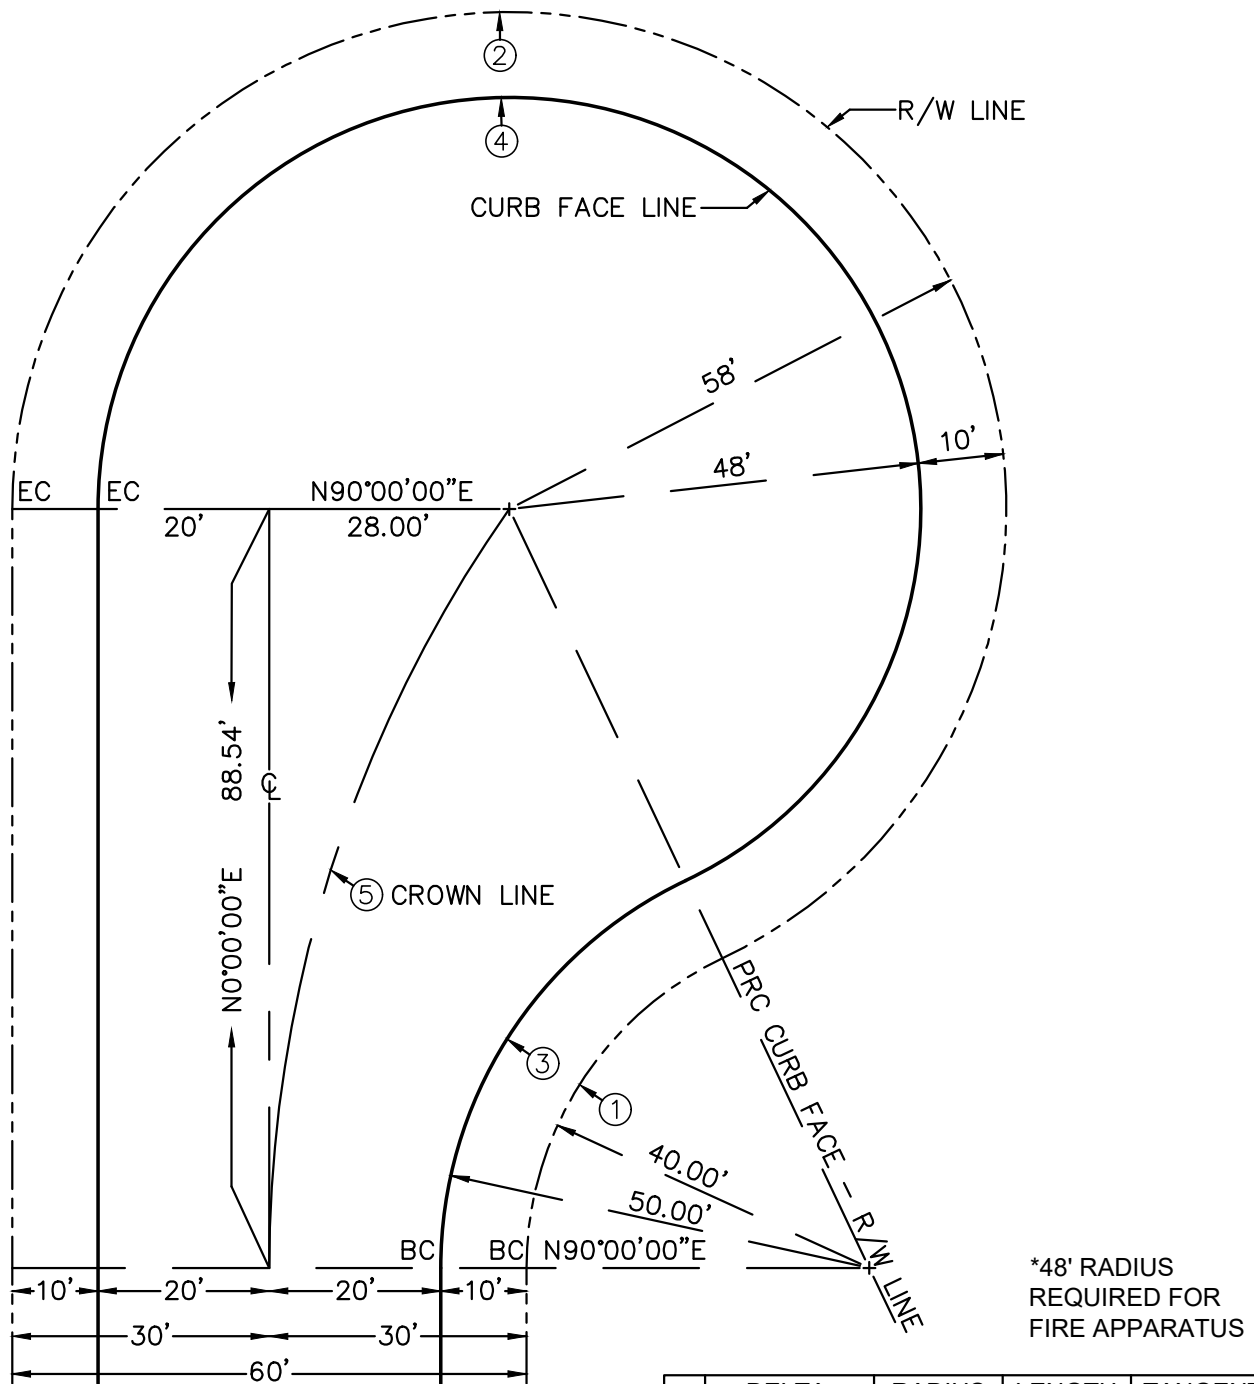


PLAN
NOT TO SCALE

	DELTA	RADIUS	LENGTH	TANGENT
①	64°37'27"	40.00	45.12	25.30
②	244°37'27"	58.00	247.63	91.70
③	64°37'27"	50.00	56.40	31.62
④	244°37'27"	*48.00	204.94	75.89
⑤	35°05'47"	154.00	94.33	48.70

CURVE TABLE

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	OFFSET CUL-DE-SAC	S-27
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

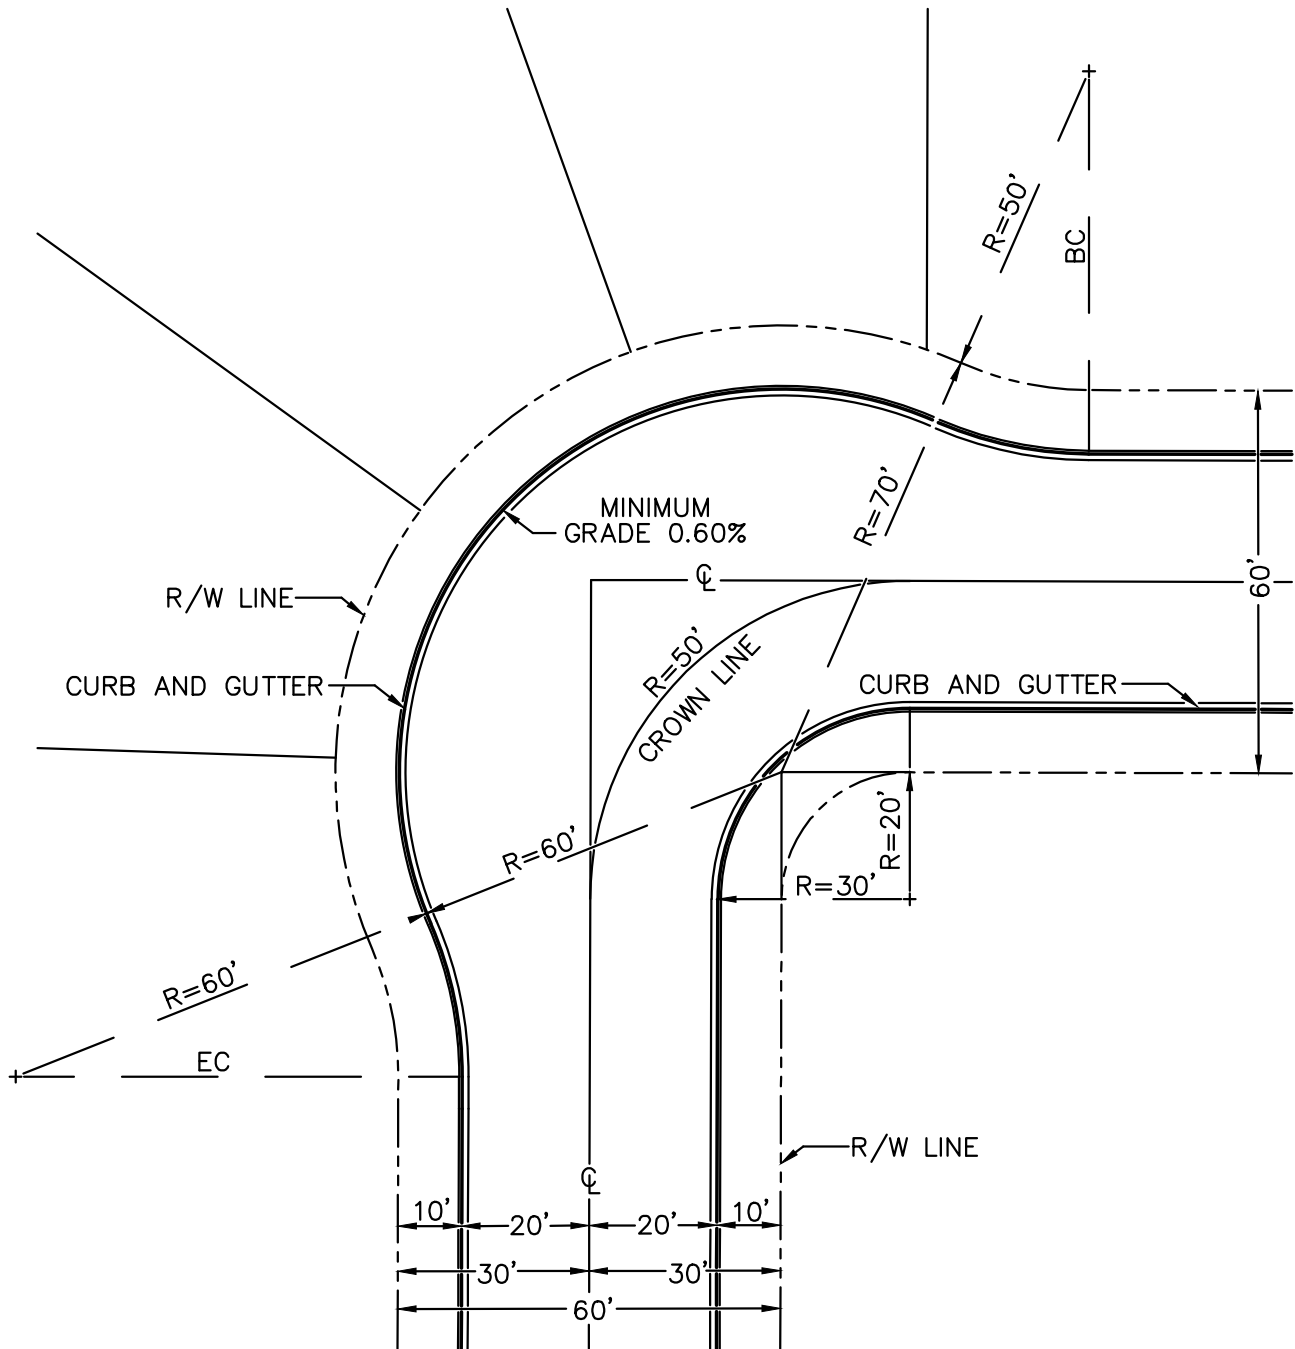


PLAN
NOT TO SCALE

NOTES:

1. ANGLE BETWEEN CENTERLINES TO BE 90° ± 10° MAXIMUM.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	STANDARD KNUCKLE	S-28
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

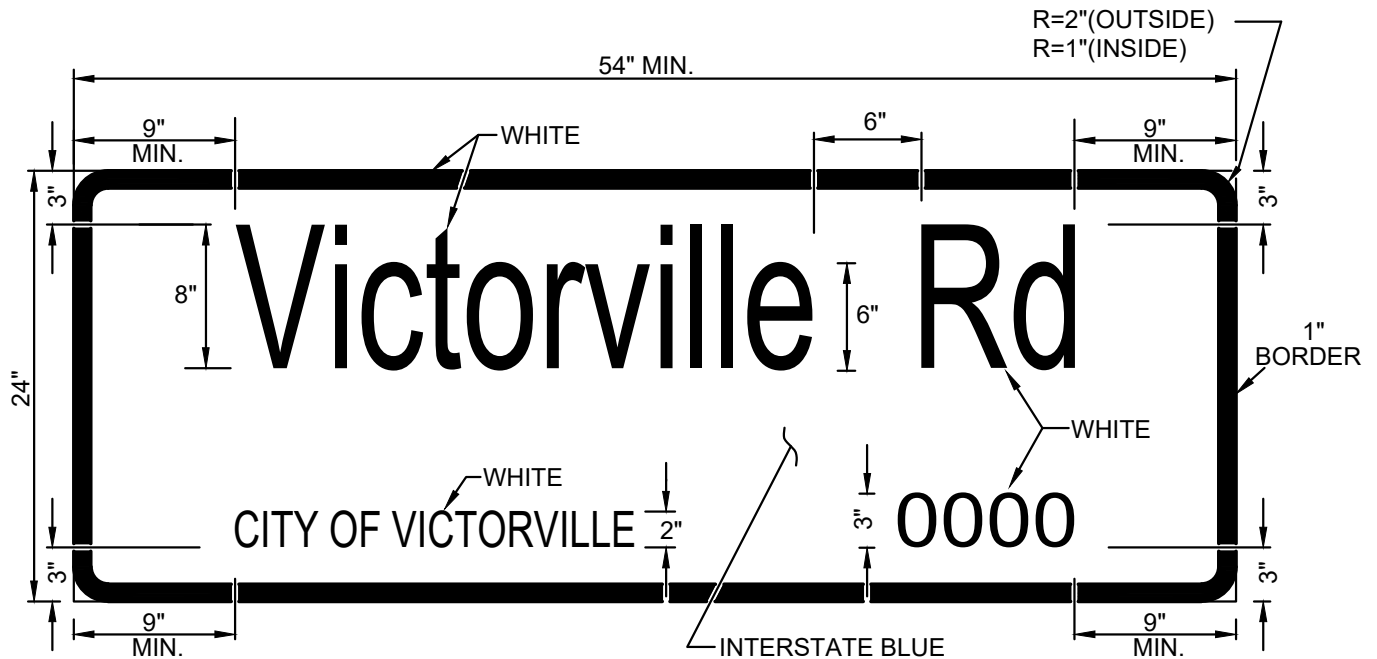

NOTES:

1. SIGN LENGTH SHALL NOT BE LESS THAN 54" WITH A MINIMUM OF 9" RIGHT AND LEFT MARGINS.
2. ONE INCH WHITE BORDER SHALL BE PROVIDED ALONG THE SIGN PERIMETER WITH 1" INSIDE RADIUS AND 2" OUTSIDE RADIUS.
3. LINE 1 LETTERING SHALL BE 8" UPPER CASE AND 6" LOWER CASE TEXT, SERIES D. LINE 2 LETTERING SHALL BE 2" UPPER CASE TEXT, SERIES C. BLOCK NUMBERS SHALL BE 3", SERIES D OR C.
4. COLORS SHALL BE WHITE ON INTERSTATE BLUE.
5. CONTRACTOR SHALL VERIFY BLOCK NUMBER WITH CITY STAFF PRIOR TO ORDERING STREET NAME SIGN.
6. I.I.S.N.S. SIGN TYPE SHALL BE TYPE A.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	INTERNALLY ILLUMINATED STREET	S-29
04/24/2026	STAFF	NAME SIGN (I.I.S.N.S)	
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

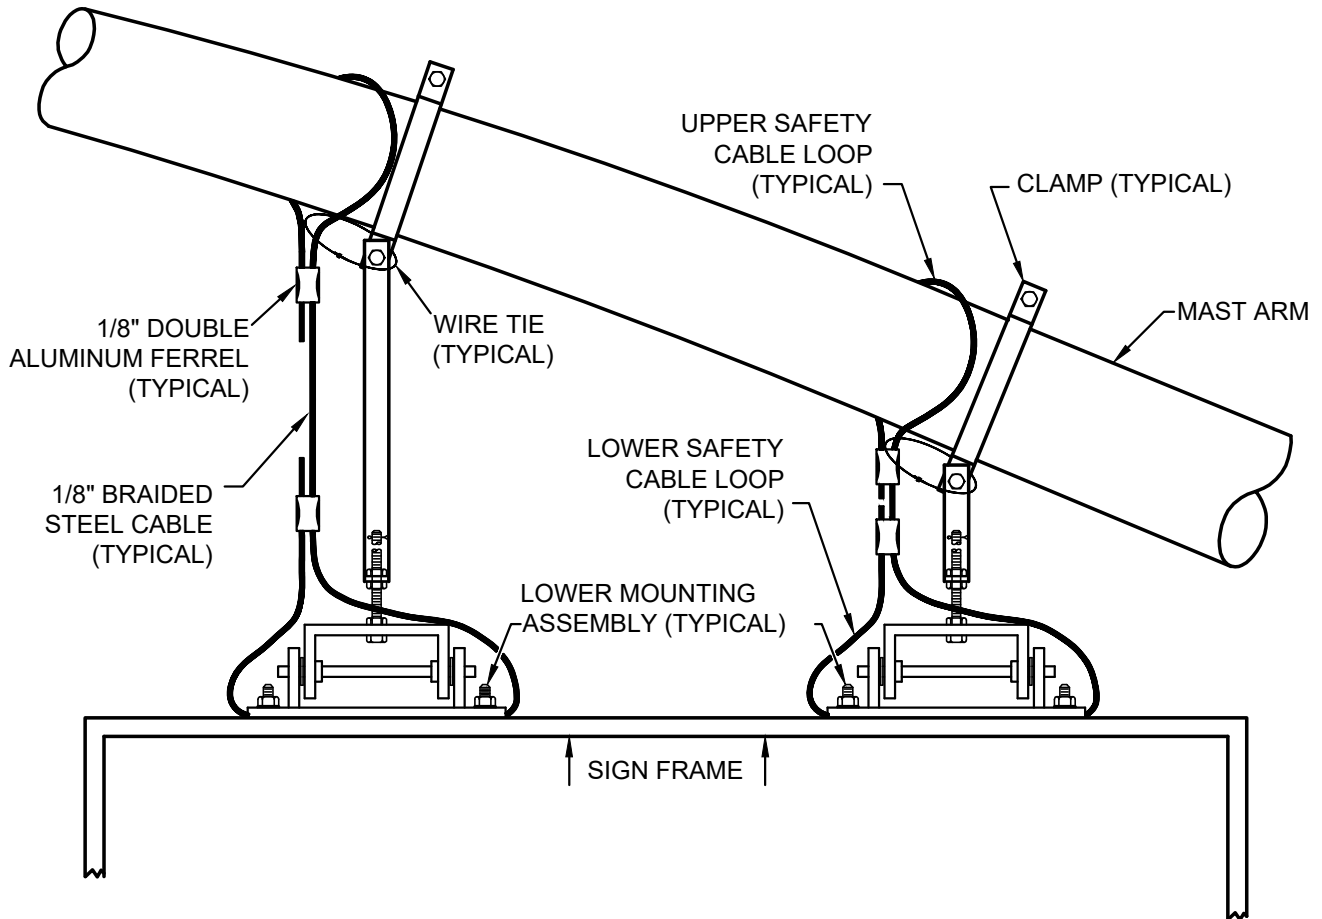


NOTES:

1. BOTH LOWER ASSEMBLIES SHALL HAVE A SAFETY CABLE INSTALLED.
2. MANUFACTURE EACH SAFETY CABLE FROM ONE CONTINUOUS LENGTH OF 1/8" BRAIDED ZINC COATED STEEL CABLE.
3. UPPER SAFETY CABLE LOOP AROUND MAST ARM SHALL BE ON THE UPPER SIDE OF CLAMP. SECURE UPPER SAFETY CABLE LOOP TO CLAMP WITH A WIRE TIE.
4. LOWER SAFETY CABLE LOOP SHALL BE INSTALLED BETWEEN LOWER MOUNTING ASSEMBLY AND SIGN FRAME.
5. INSTALL 1/8" DOUBLE ALUMINUM FERRULE ON UPPER AND LOWER LOOP ENDS. EACH FERRULE SHALL BE CRIMPED WITH AWG 1 DIE.
6. INSTALLED SAFETY CABLE SHALL NOT ALLOW SIGN TO FALL IN EXCESS OF ONE INCH.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	INTERNALLY ILLUMINATED STREET	S-30
04/24/2026	STAFF	NAME SIGN (I.I.S.N.S.) SAFETY CABLE	
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

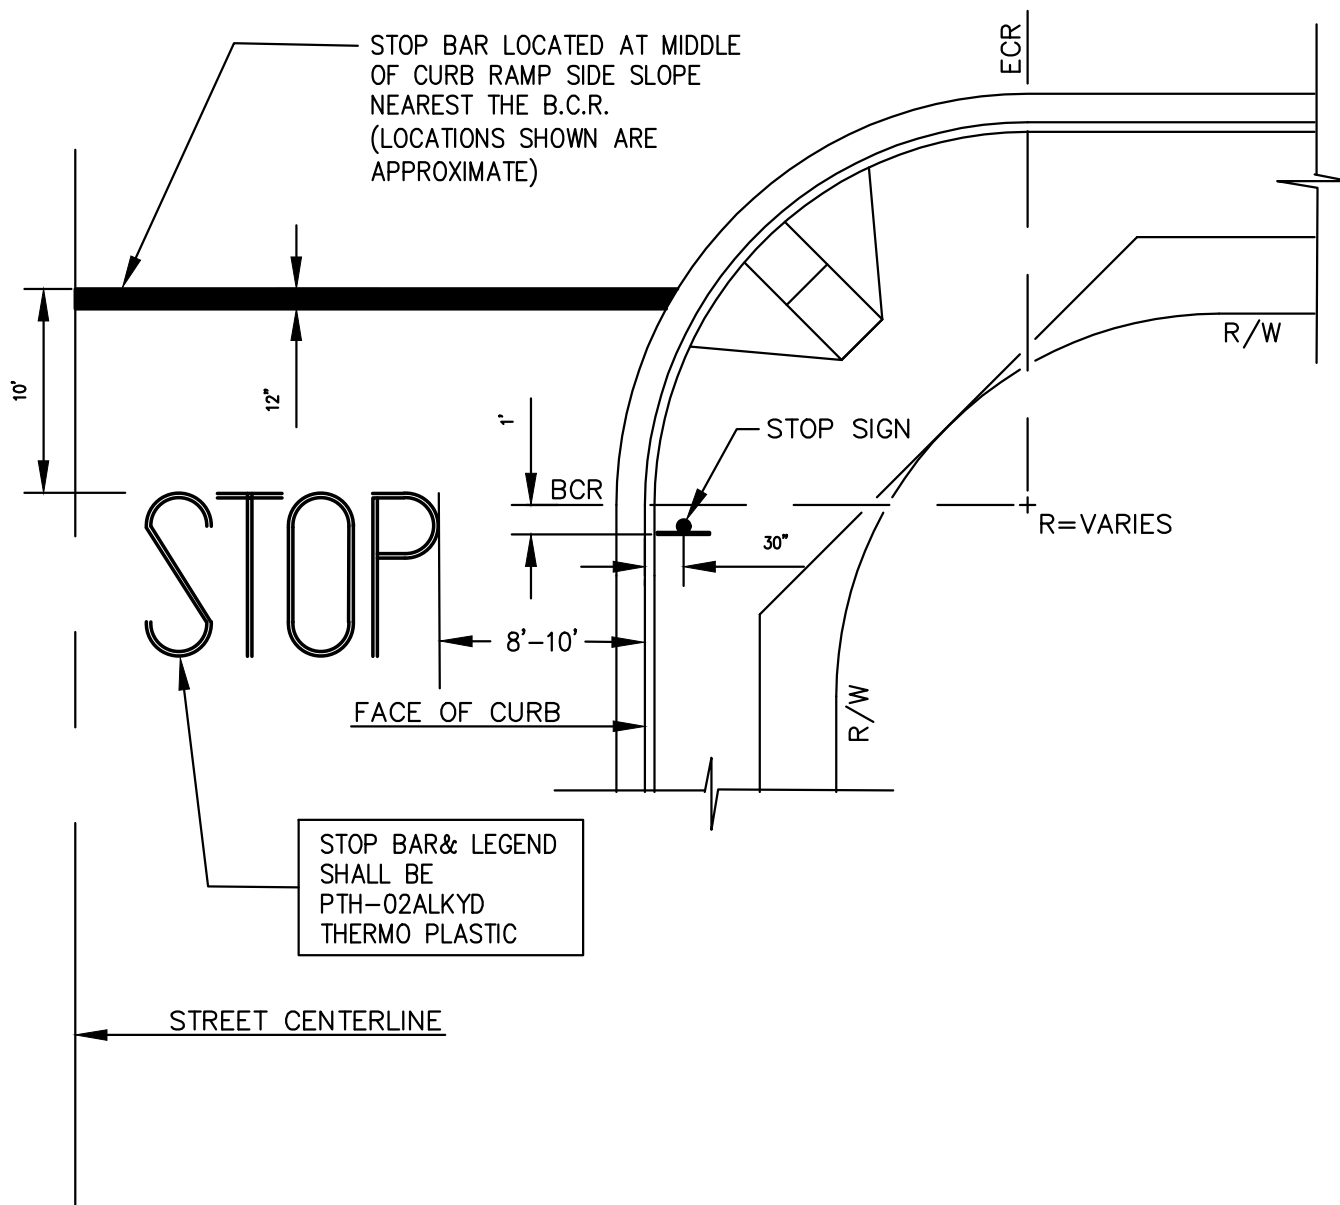

NOTE:


ALL STENCILS TO BE CALTRANS (METRIC)
 ALL STOP BAR, LEGENDS, & STOP SIGN LOCATIONS MUST BE APPROVED BY THE TRAFFIC DIVISION PRIOR TO INSTALLATION

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	STOP BAR, LEGEND DETAIL, AND STOP SIGN LOCATION	S-31
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

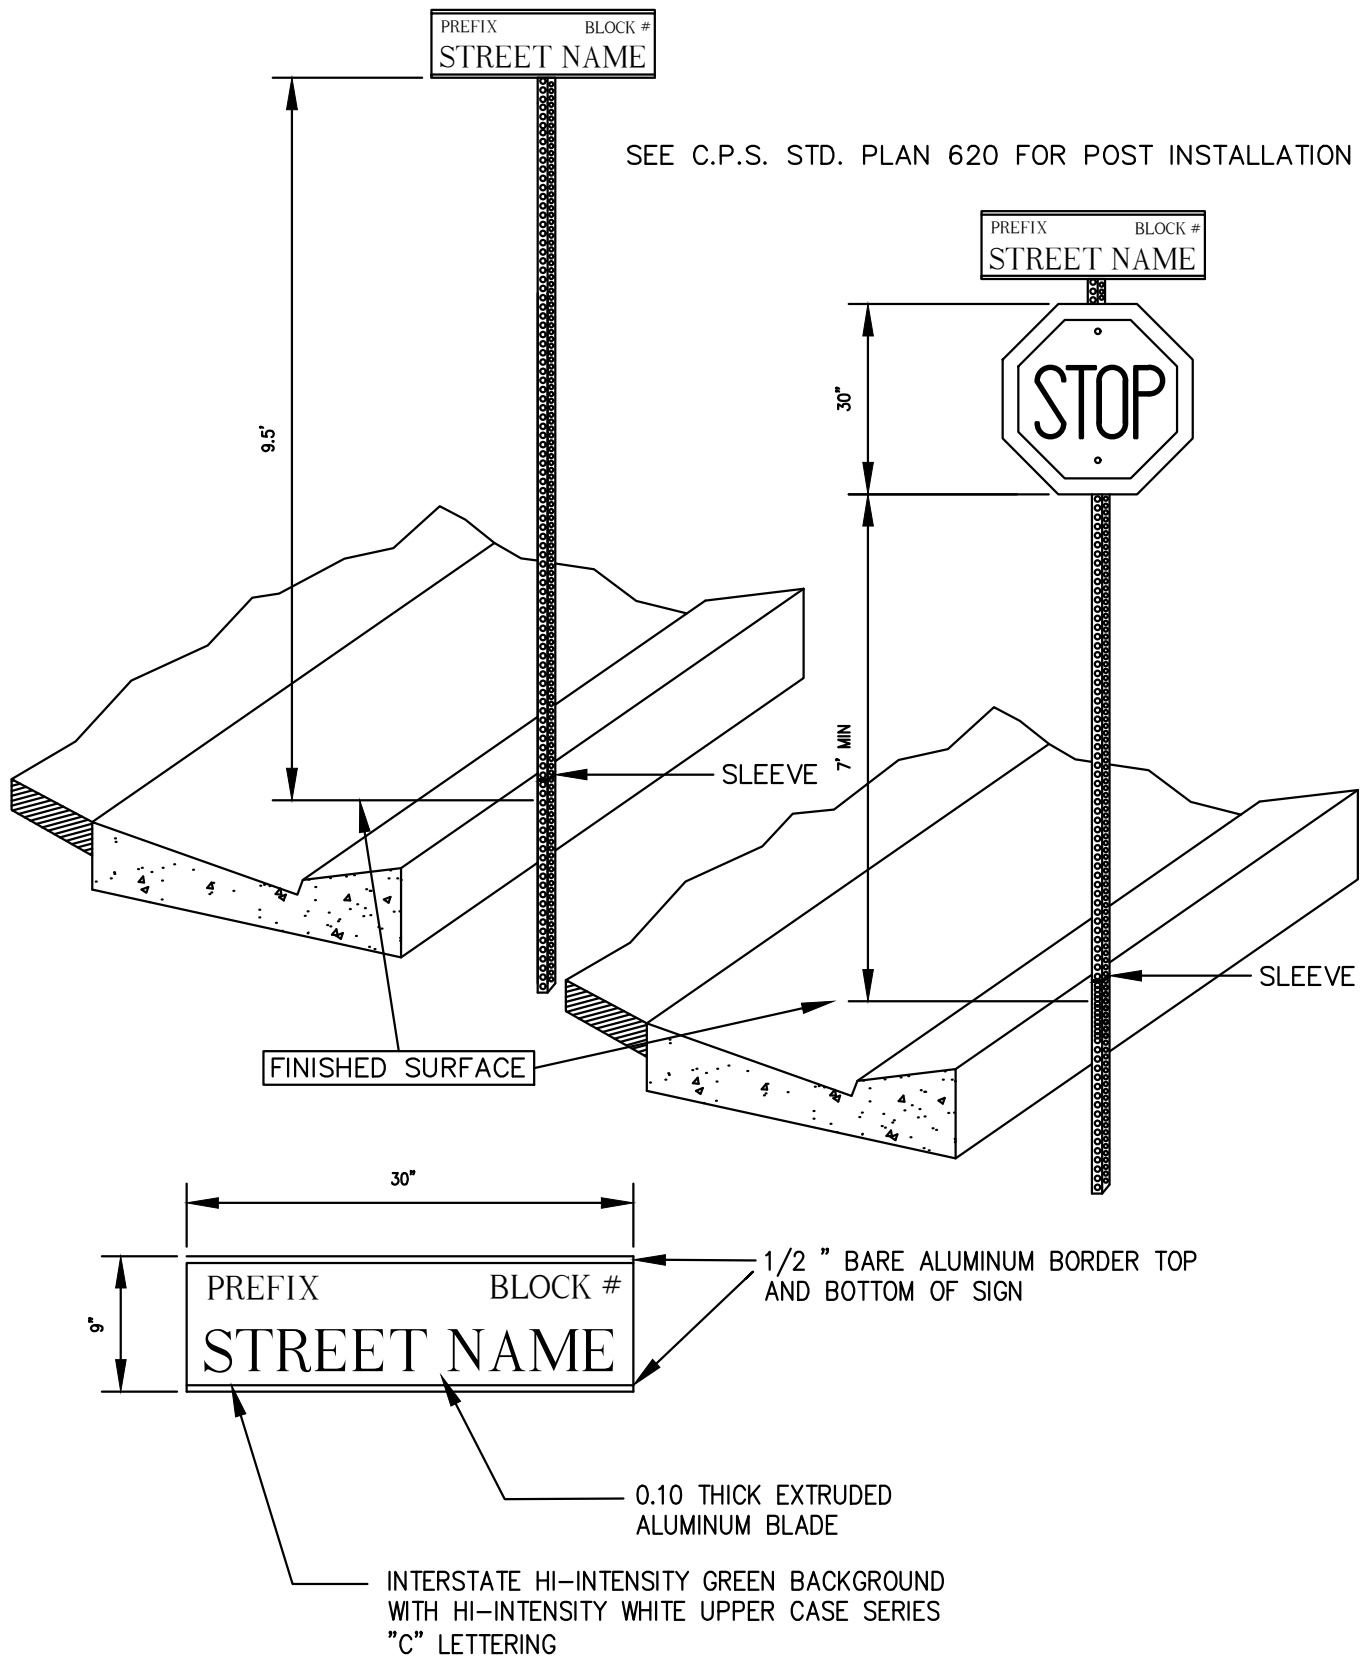

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STREET NAME SIGN INSTALLATION	S-32
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

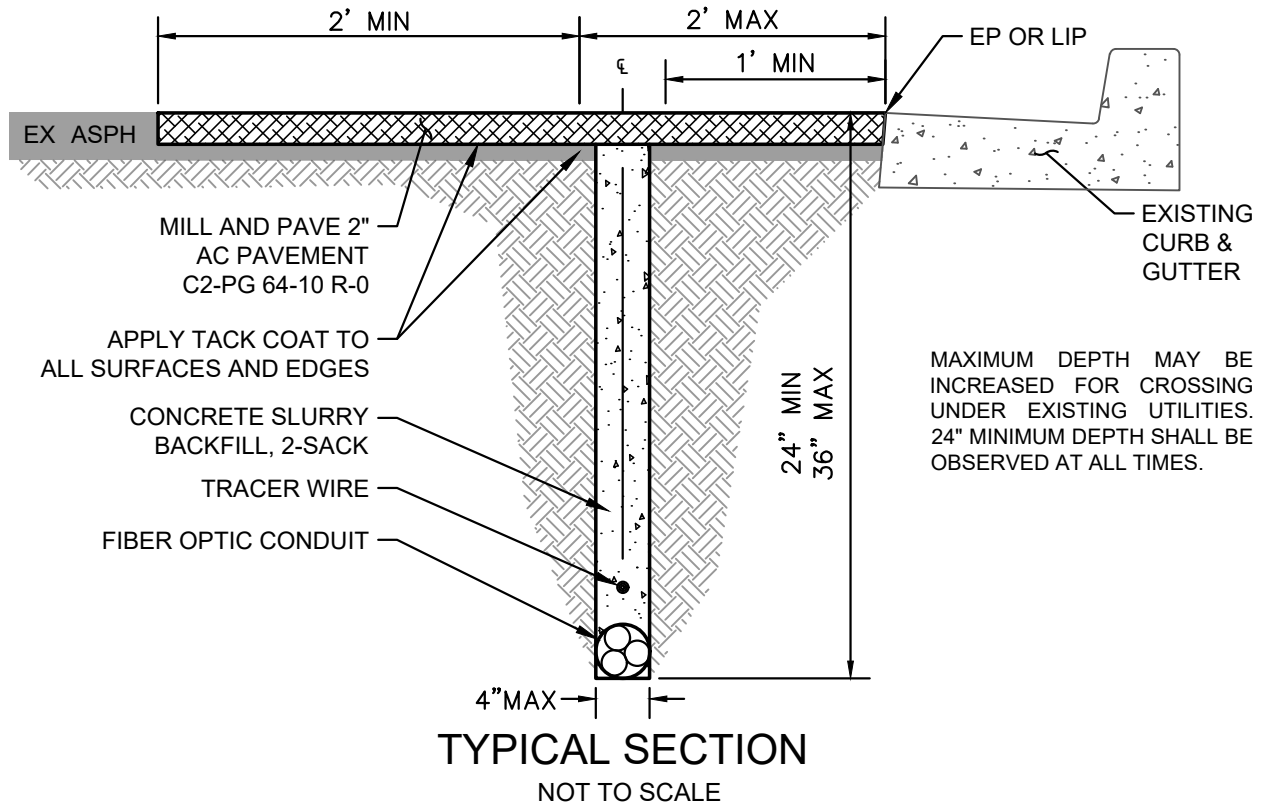


NOTES:


1. MICRO-TRENCHING SHALL ONLY BE USED TO INSTALL UNDERGROUND FIBER OPTIC CONDUIT.
2. ALL WORK SHALL CONFORM TO THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.
3. ALL MICRO-TRENCHING IN THE PUBLIC RIGHT-OF-WAY SHALL REQUIRE A UTILITY PERMIT. A REVIEW OF PROPOSED MICRO-TRENCHING IS REQUIRED PRIOR TO APPROVAL OF A PERMIT.
4. THE CONTRACTOR SHALL NOTIFY UNDERGROUND SERVICE ALERT (DigAlert) 3 WORKING DAYS PRIOR TO START OF EXCAVATION AT 1-800-227-2600 AND POT HOLE ALL UTILITY CROSSINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRING ANY DAMAGED UTILITIES AT THEIR OWN EXPENSE.
5. THE CONTRACTOR SHALL SCHEDULE AN INSPECTION A MINIMUM OF ONE (1) WORKING DAY (24 HOURS) PRIOR TO START OF TRENCHING.
6. CONDUIT SHALL BE SECURED PROHIBITING ANY FLOATING PRIOR TO SLURRY PLACEMENT AND CURE.
7. PRIOR TO PLACEMENT OF ASPHALT PAVEMENT, TRENCH EDGES SHALL BE CUT STRAIGHT AND VERTICAL.
10. TACK COAT SHALL BE APPLIED TO ALL SURFACES AND EDGES PRIOR TO PLACEMENT OF ASPHALT.
11. THE PERMITTED CLASS AND PERFORMANCE GRADE OF ASPHALT CONCRETE (AC) PAVEMENT SHALL BE 2.0" THICK OF C2-PG 64-10-R0 UNLESS OTHERWISE DIRECTED BY ENGINEERING. PERFORMANCE GRADES INCLUDING PG 64-16, PG 70-10, PG 64-28PM, PG 76-22PM MAY BE REQUIRED AT THE DIRECTION OF THE CITY ENGINEER DEPENDING ON LOCATION. TYPE III ASPHALT CONCRETE MIXTURES ARE NOT PERMITTED.
12. THE TOP 6 INCHES OF CONCRETE SLURRY SHALL BE COLORED A CONTRASTING SHADE OF BLACK, RED OR ORANGE COMPARED TO THE NATIVE SOILS.
13. THE ENTIRE CONDUIT RUN SHALL BE TRACEABLE BY #8 AWG COPPER TRACING WIRE EXTENDED INTO EACH VAULT, BOX, OR OTHER FIXTURE AT EACH END OF THE CONDUIT RUN.
14. IF A MICRO-TRENCH EXISTS, NEW MICRO-TRENCHING SHALL BE SEPARATED A MINIMUM OF ONE (1) FOOT FROM EXISTING.
15. THE CONTRACTOR SHALL RESTORE ALL PAVEMENT MARKINGS AND REPAIR ALL DAMAGED CONCRETE STRUCTURES UPON COMPLETION OF WORK.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	MICRO-UTILITY TRENCHING FOR FIBER OPTIC CABLE	S-33
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

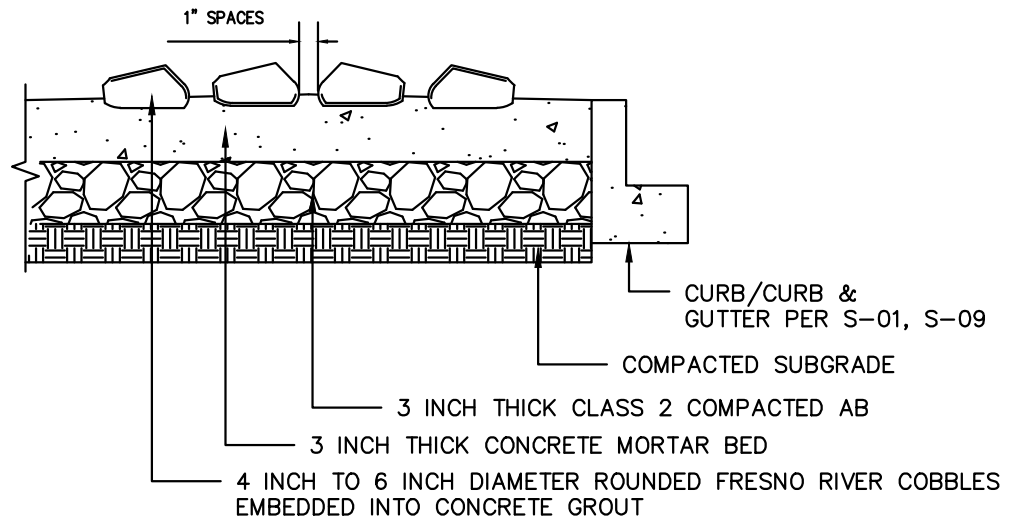

SECTION VIEW

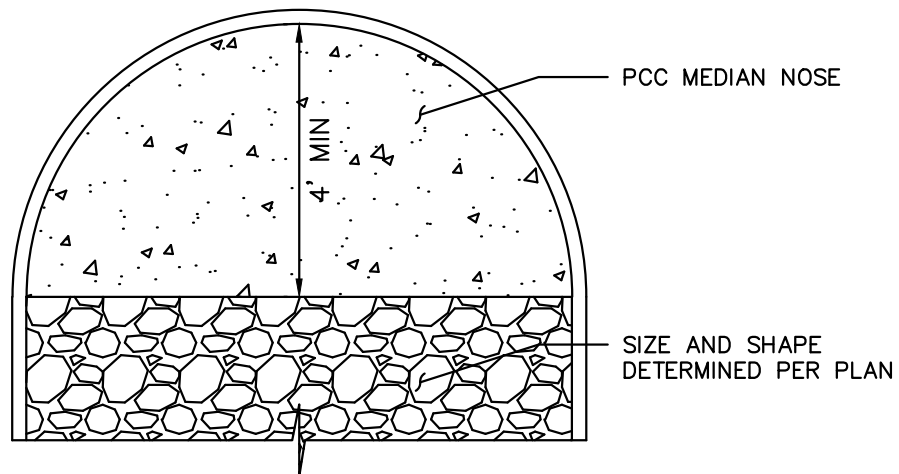

PLAN VIEW

NOTES:

1. CROWN TO BE ROUNDED WITH NO SHARP GRADE BREAKS.
2. VISIBLE EXPOSED GROUT AT COBBLE JOINTS.
3. SURFACE OF COBBLE FIELD TO BE SMOOTH AND FLAT TO GRADE WITHOUT VARIATION IN HEIGHT OF INDIVIDUAL COBBLES.
4. COBBLES WITH BREAKS OR FRACTURES ARE NOT ALLOWED.
5. ROCK SHALL BE SATURATED SURFACE MOIST (SSM) PRIOR TO PLACEMENT.
6. CONCRETE MORTAR BED SHALL HAVE A CEMENT RATIO PER CUBIC YARD OF CONCRETE OF NOT LESS THAN 564 POUNDS.
7. INTEGRAL COLOR ADMIXTURE: CHROMIX, ADOBE TAN, #C-21 BY L.M SCOFIELD (OR APPROVED EQUAL)
8. CONCRETE CLASS 520-D-2500
9. ALL SPACES BETWEEN STONES SHALL BE FILLED WITH CLASS MORTAR. 1 PART CEMENT TO 2-2/1 PARTS SAND, 2000 PSI PORTLAND CEMENT CONCRETE (NO "DRY-PACK" IS ALLOWED)
10. A SAMPLE AREA, MIN. 40 SQ.FT., SHALL BE APPROVED BY THE CITY INSPECTOR, PRIOR TO PROCEEDING WITH REMAINING ROCK WORK.
11. ROCKS SHALL BE SMOOTH, ROUNDED AND FREE OF OBJECTIONABLE DISFIGURATIONS.
12. ROCKSCAPE SHOULD FOLLOW GRADE WHERE SLOPE EXIST MAINTAIN A 2% MIN. AT ALL TIMES WITHIN THE RIGHT OF WAY.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STANDARD COMMERCIAL COBBLESTONE MEDIAN	S-34
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

DRAWING INDEX

T-1	BLANK INTENTIONALLY
T-2	BLANK INTENTIONALLY
T-3	BLANK INTENTIONALLY
T-4	BLANK INTENTIONALLY
T-5	INTERSECTION DISPLAY PANEL
T-6	R CABINET FOUNDATION LAYOUT
T-7	R CABINET EQUIPMENT LAYOUT
T-8	DETECTOR RACK LAYOUT
T-9	PEDESTRIAN PUSH BUTTON POST

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	TRAFFIC IMPROVEMENT STANDARD DRAWINGS INDEX	T-INDEX
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	T-1
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	T-2
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	BLANK INTENTIONALLY	T-3
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	T-4
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	INTERSECTION DISPLAY PANEL	T-5
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

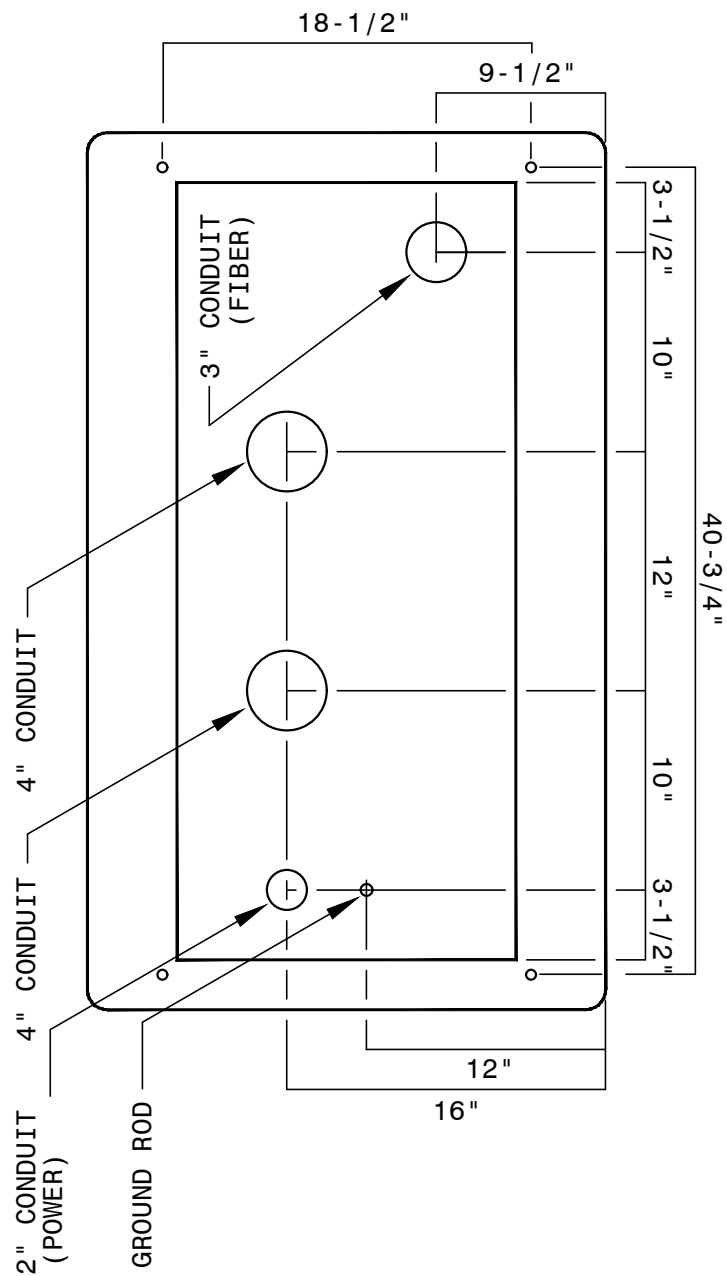

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	R CABINET FOUNDATION LAYOUT	T-6
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

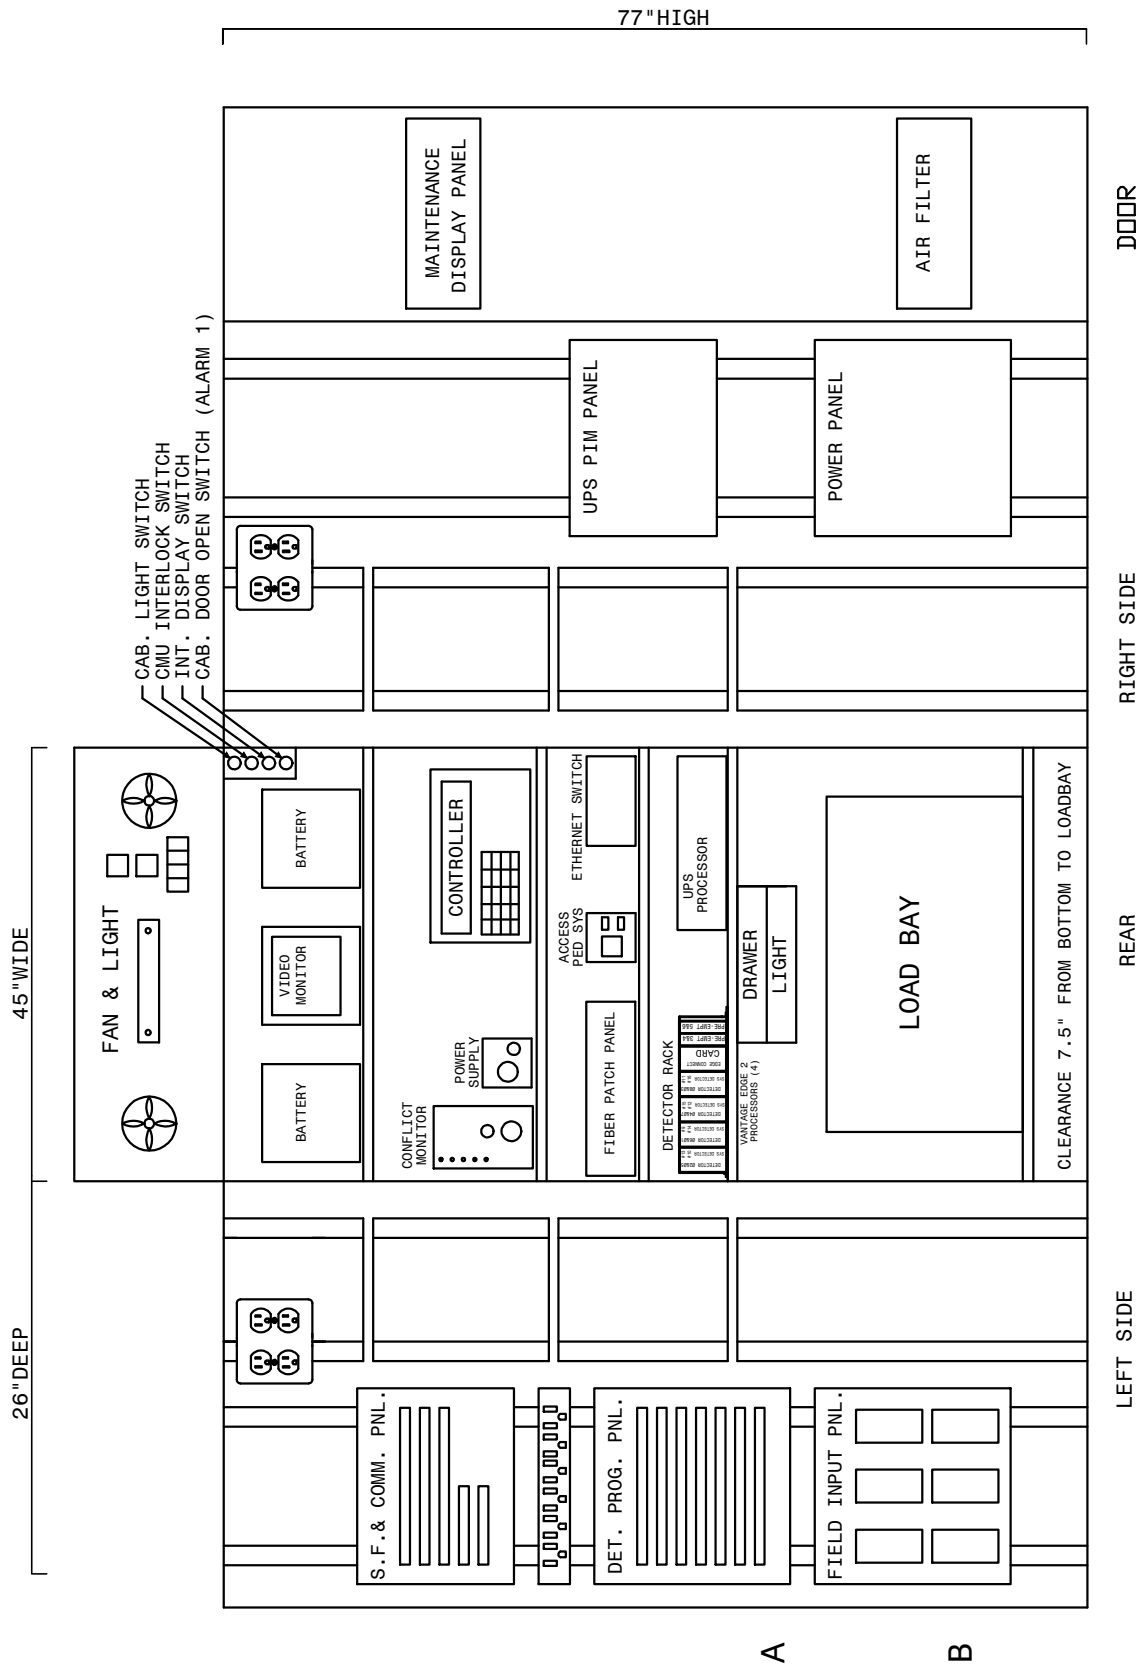


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	R CABINET EQUIPMENT LAYOUT	T-7
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	DETECTOR RACK LAYOUT	T-8
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

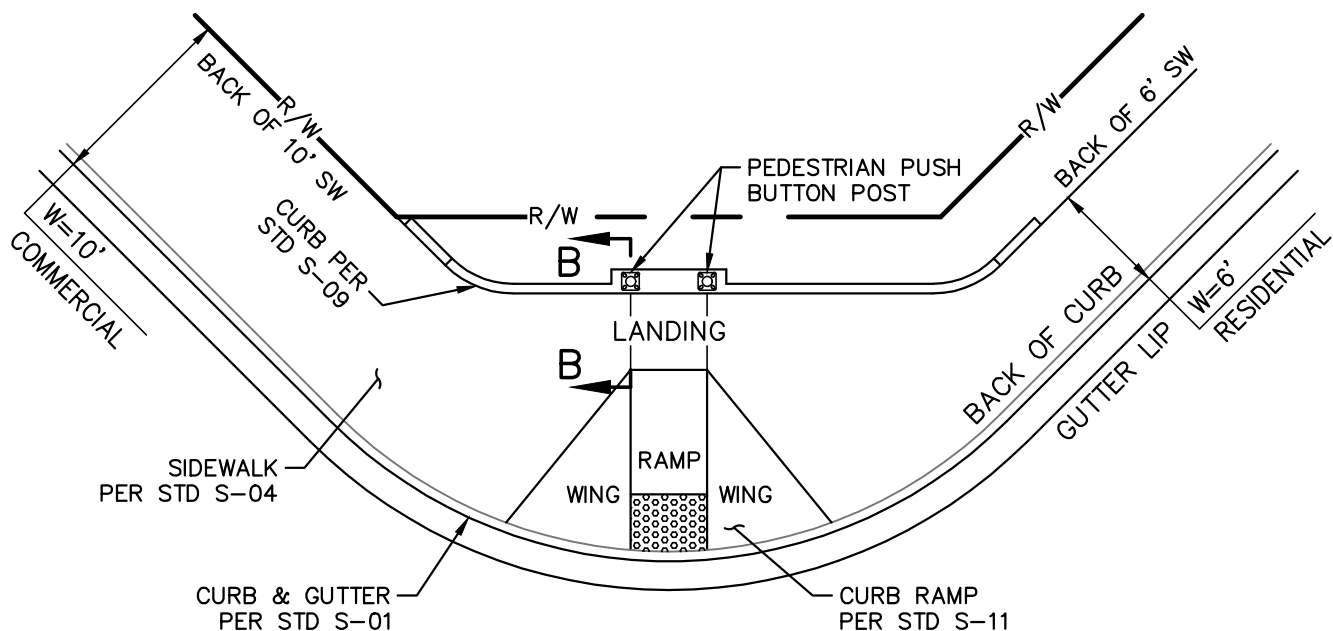


CURB RETURN

(TYPE A RAMP SHOWN)
NOT TO SCALE

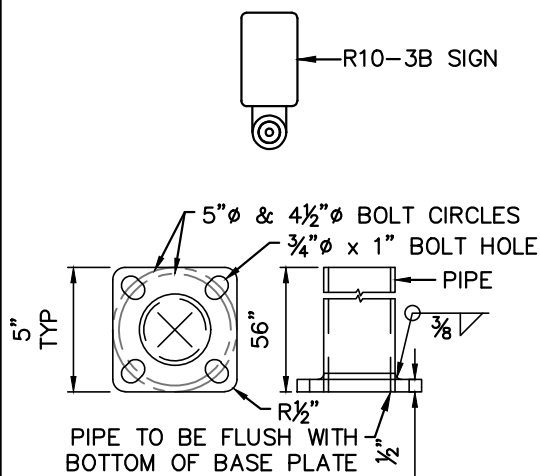

BASE PLATE

NOT TO SCALE

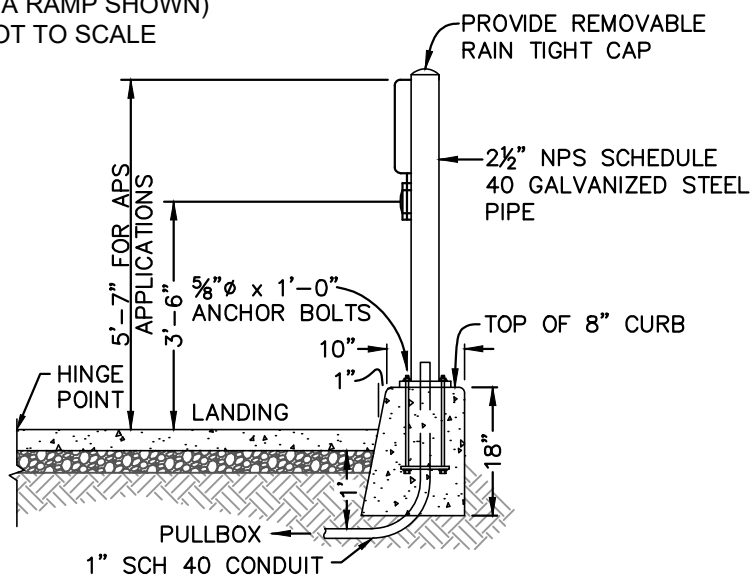

SECTION B-B

NOTES:

1. THE PORTLAND CEMENT CONCRETE CLASS PER SECTION 201 SHALL BE 560-C-3250 PER THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (GREENBOOK), LATEST EDITION.
2. THE PEDESTRIAN PUSH BUTTON POST (POST) MATERIAL SHALL BE CONSTRUCTED FROM ASTM A36 STEEL AND GALVANIZED AFTER FABRICATION.
3. THE POST SHALL BE CENTERED ON THE TOP OF THE CURB.
4. POST ANCHOR BOLTS SHALL BE SET IN CONCRETE WITH A 5" ϕ BOLT CIRCLE TEMPLATE.
5. THE POST SHALL BE ADJACENT THE CURB RAMP LANDING.
6. ONE POST SHALL BE PROVIDED FOR EACH CROSSWALK DIRECTION ON THE LANDING CORNERS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT





REV. DATE	BY	PEDESTRIAN PUSH BUTTON POST	T-9
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

DRAWING INDEX

D-01A	STANDARD WASH CROSSING
D-01B	CHANNEL CROSSING IN EXISTING RURAL RESIDENTIAL AREA ONLY
D-02	STANDARD DROP INLET (3 SHEETS)
D-03	CURB OPENING CATCH BASIN WITH GRATINGS
D-04	STORM DRAIN MANHOLE FRAME AND COVER
D-05	PRECAST STORM DRAIN MANHOLE
D-06	DRY WELL SYSTEM DETAILS (2 SHEETS)
D-07	DRY WELL AND INTERCEPTOR

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	DRAINAGE IMPROVEMENT STANDARD DRAWINGS INDEX	D-INDEX
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	STANDARD WASH CROSSING	D-01A
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

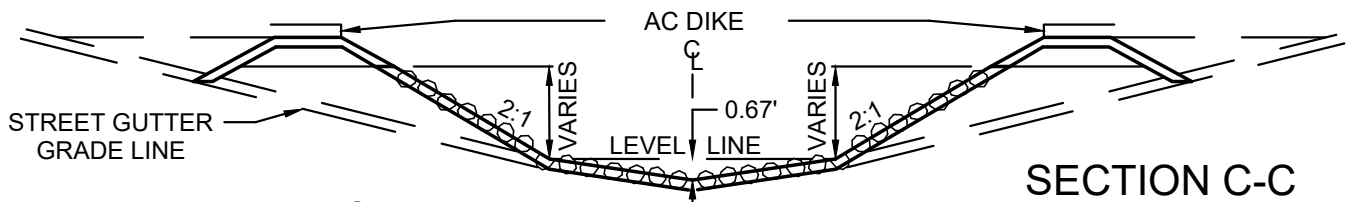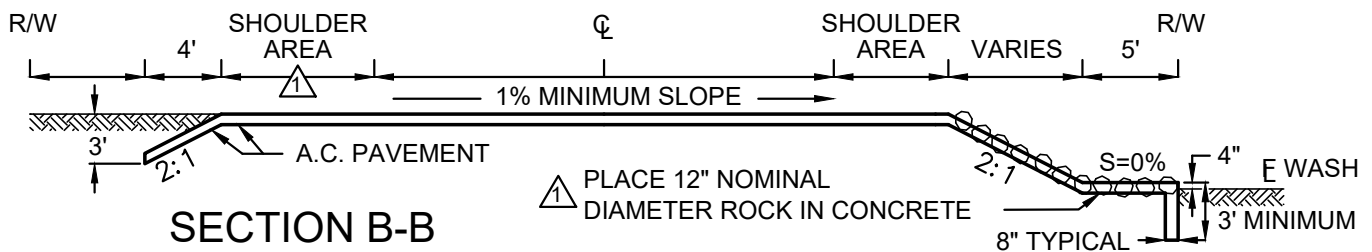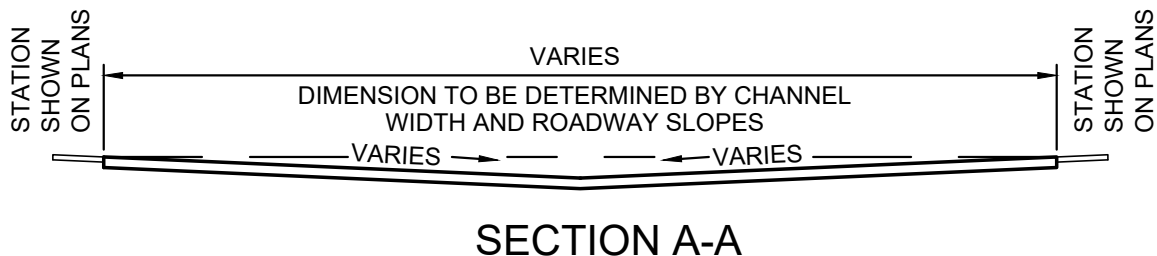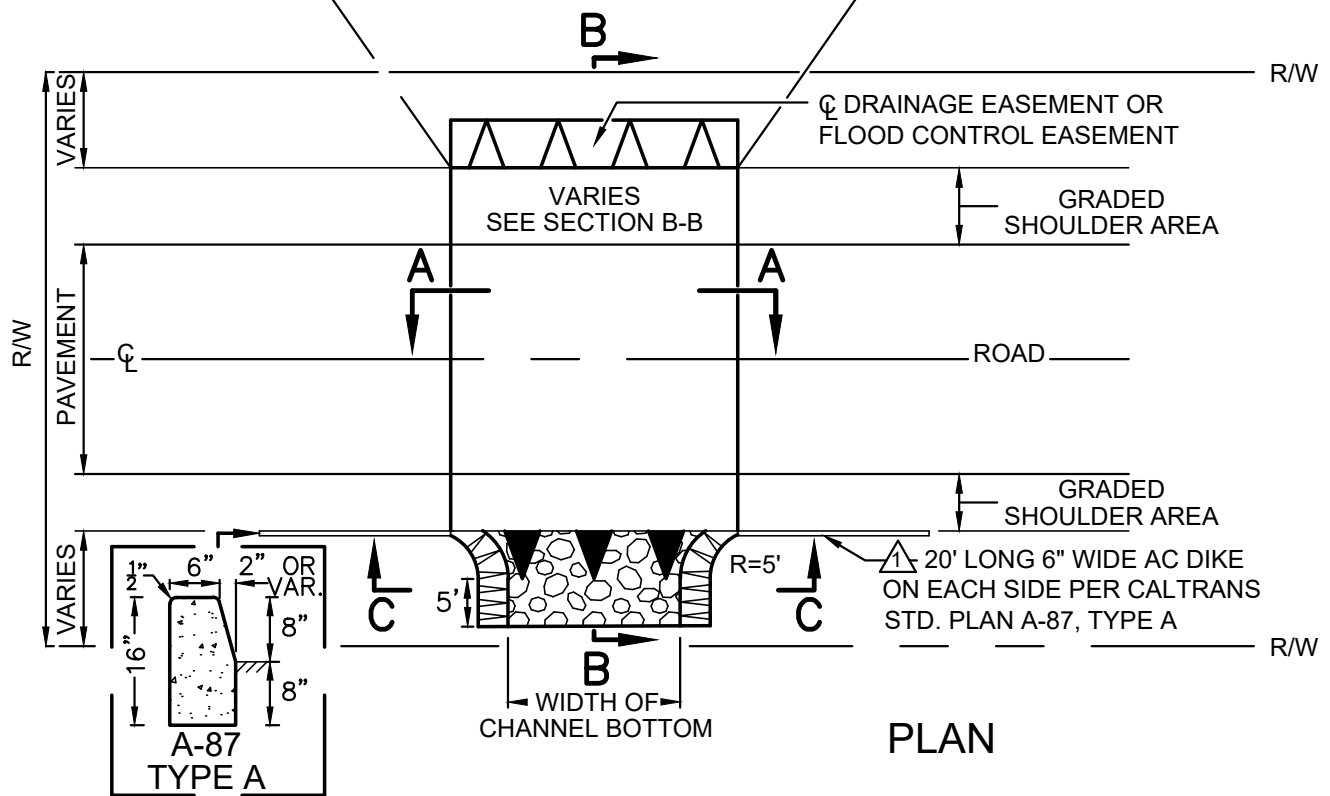


NOTE:


1. CONCRETE SHALL CONTAIN NOT LESS THAN 550 POUNDS OF CEMENTITIOUS MATERIAL PER CUBIC YARD WITH 4% AIR ENTRAINMENT.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CHANNEL CROSSING IN EXISTING RURAL RESIDENTIAL AREA ONLY	D-01B
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

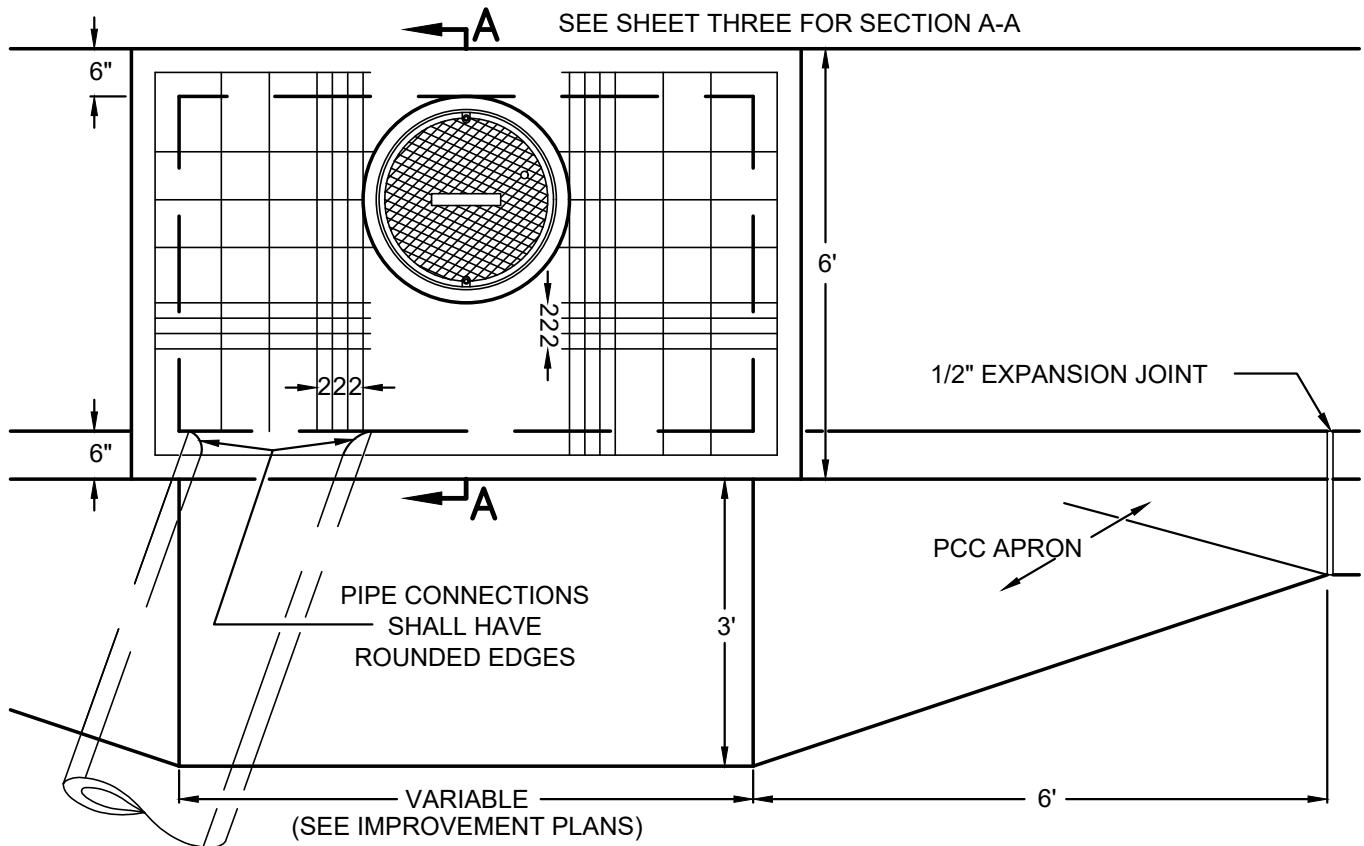

PLAN

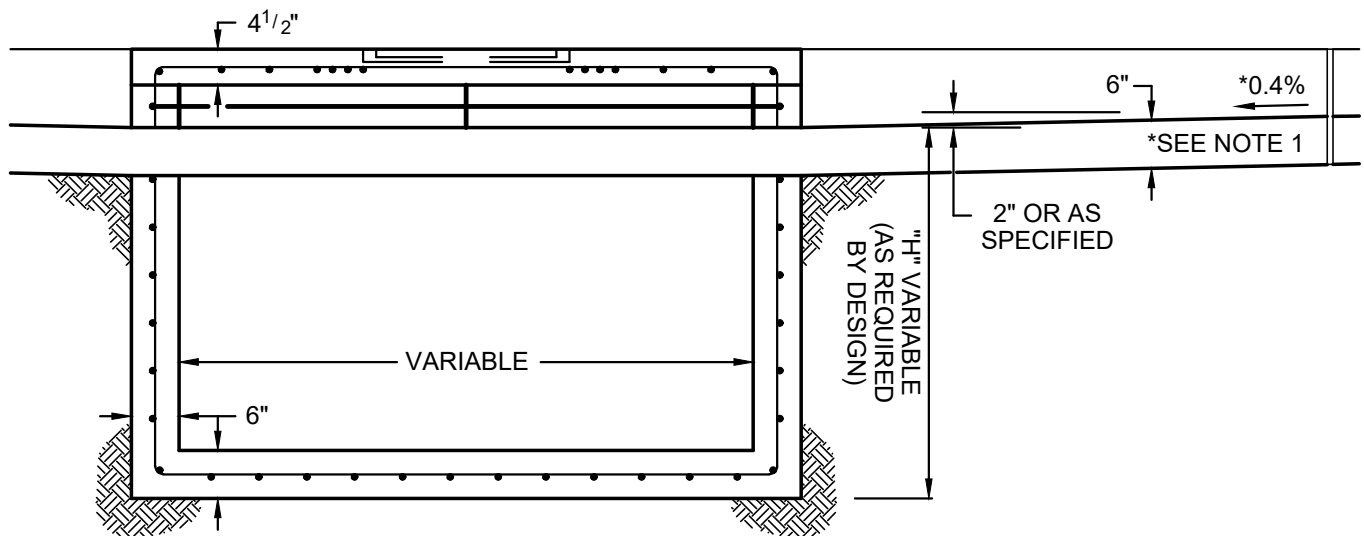



SECTION

NOTES:

1. THE GUTTER CROSS SLOPE SHALL NOT EXCEED 8.33%. THE GUTTER FLOW LINE SHALL NOT BE LESS THAN 0.3% WITHIN 30 FEET OF THE EDGE OF THE DROP INLET OPENING. THE APRON TRANSITION MAY BE EXTENDED UP TO 15 FEET IN LENGTH.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STANDARD DROP INLET	D-02
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 3

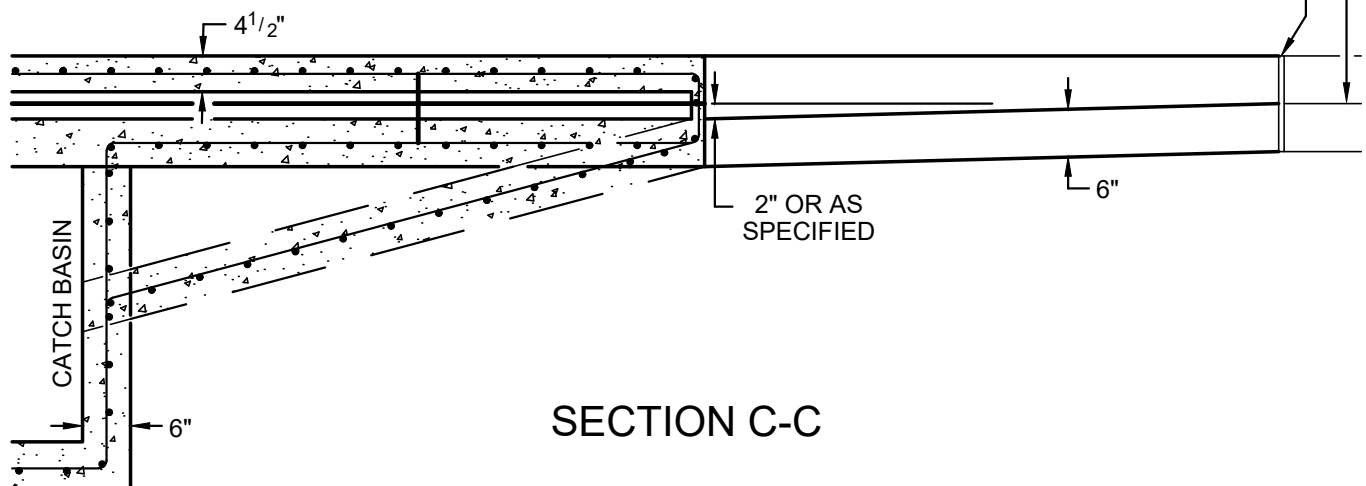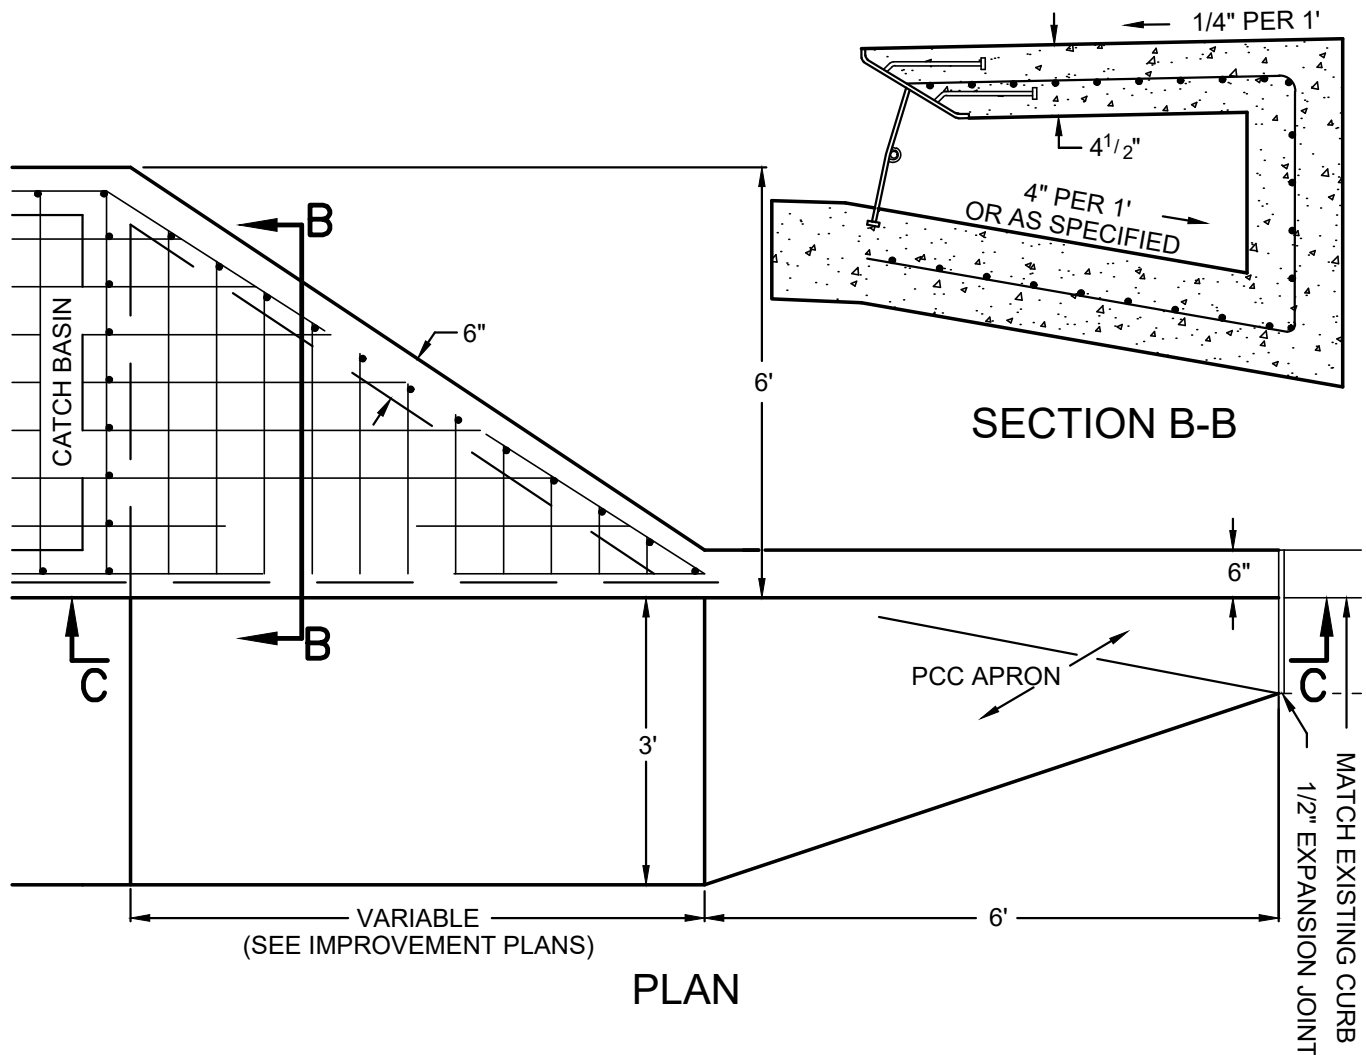

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SIDE INLET FOR STANDARD DROP INLET	D-02
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 3

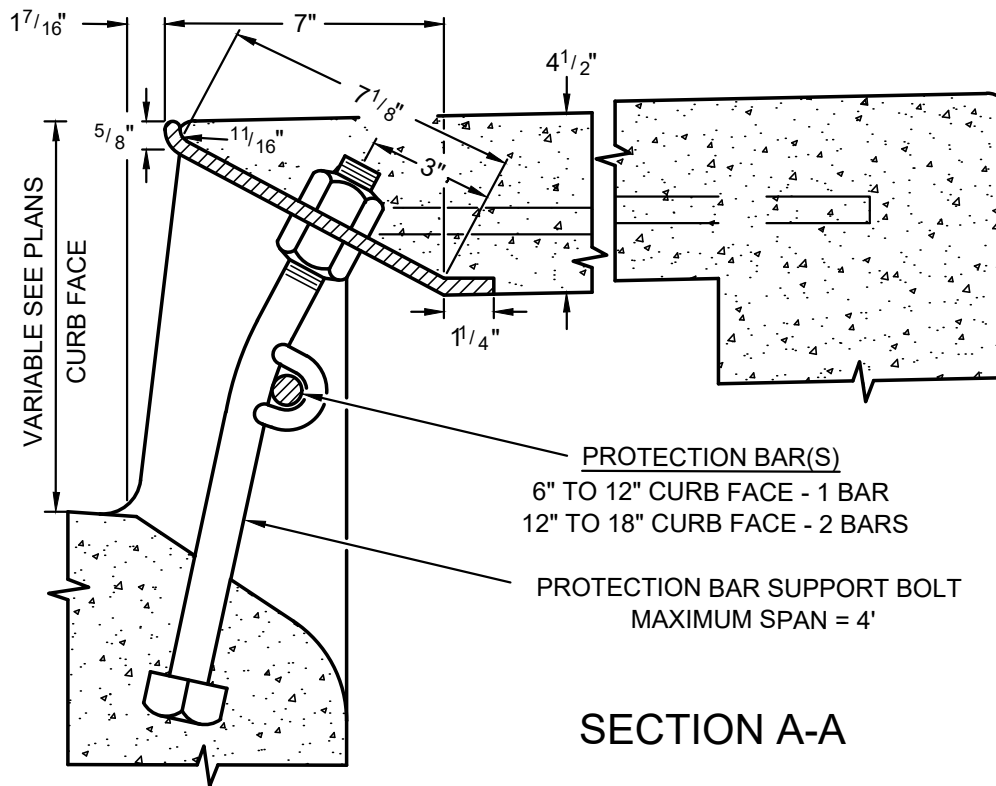

NOTES:

1. ALL CONCRETE SHALL BE PORTLAND CEMENT CONCRETE PER SECTION 201, CLASS 560-C-3250 OF THE GREENBOOK.
2. SEE DRAWING S-01 FOR EXPANSION JOINT DETAIL.
3. FLOOR SLOPE SHALL BE 1" PER FOOT TOWARD OUTLET OR AS SPECIFIED ON THE PLANS.
4. REINFORCING SHALL CONSIST OF NO. 4 DEFORMED BARS AT 6" CENTERS EACH WAY UNLESS OTHERWISE NOTED.
5. ALL STEEL REINFORCING SPLICES SHALL BE LAPPED 40 DIAMETERS.
6. ALL STEEL REINFORCING JOINTS SHALL BE BENT TO 1" RADIUS AND EITHER CONTINUED OR LAPPED 40 DIAMETERS.
7. COVER SHALL BE BOLTED DOWN WITH 2 SOCKET SET SCREW BOLTS PER DETAILS ON STANDARD DRAWING D-04.
8. FRAME AND COVER SHALL BE ALHAMBRA FOUNDRY NO. A1530B, GALVANIZED, 22" DIAMETER OPENING OR EQUAL.
9. CURB PROTECTION PLATE SHALL BE ALHAMBRA FOUNDRY NO. A3911 OR EQUAL. PROTECTION BAR SHALL BE ALHAMBRA FOUNDRY A1564 OR EQUAL. PROTECTION BAR SUPPORT BOLTS SHALL BE ALHAMBRA FOUNDRY A1572 OR EQUAL.
10. STEPS - NONE REQUIRED WHERE "H" IS 3'6" OR LESS. INSTALL ONE STEP 16"± ABOVE FLOOR WHEN "H" IS 3'6" TO 5'0". WHERE "H" IS MORE THAN 5'0", STEPS SHALL BE EVENLY SPACED AT 12"± INTERVALS FROM 16"± ABOVE FLOOR TO WITHIN 12"± OF THE TOP OF THE BOX. PLACE STEPS IN WALL WITHOUT PIPE OPENINGS.
11. ALL EXPOSED METAL PARTS SHALL BE GALVANIZED.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV.	DATE	BY		
	04/24/2026	STAFF	STANDARD DROP INLET	D-02
			<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 3 OF 3




**SEE STANDARD PLANS FOR
PUBLIC WORKS CONSTRUCTION
STANDARD PLAN 302, LATEST
REVISION**

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	CURB OPENING	D-03
04/24/2026	STAFF	CATCH BASIN WITH GRATINGS	
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

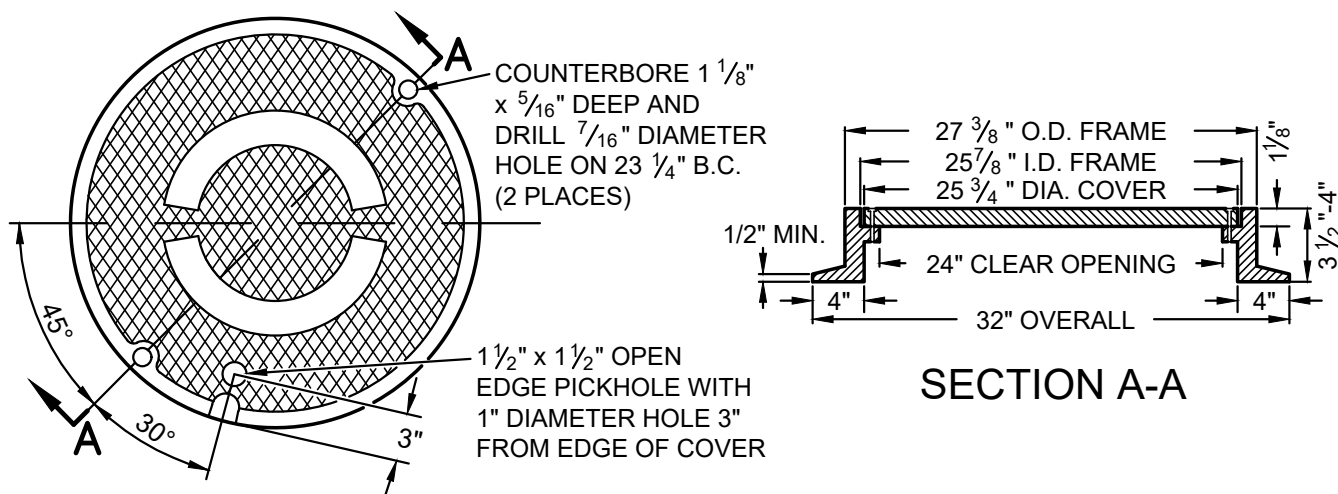


**PLATEN COVER
TOP VIEW**

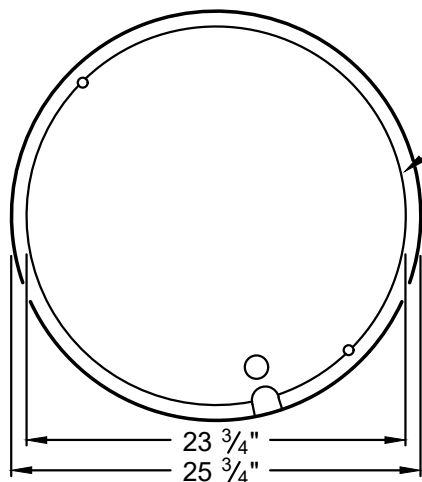

**PLATEN COVER
BOTTOM VIEW**

DRILL AND TAP FRAME
FOR $\frac{3}{8}"$ -16"x $1\frac{1}{2}"$
SOCKET SET SCREW
BOLTS ON $23\frac{1}{4}"$ B.C.
(2 PLACES)

MACHINED
SURFACE

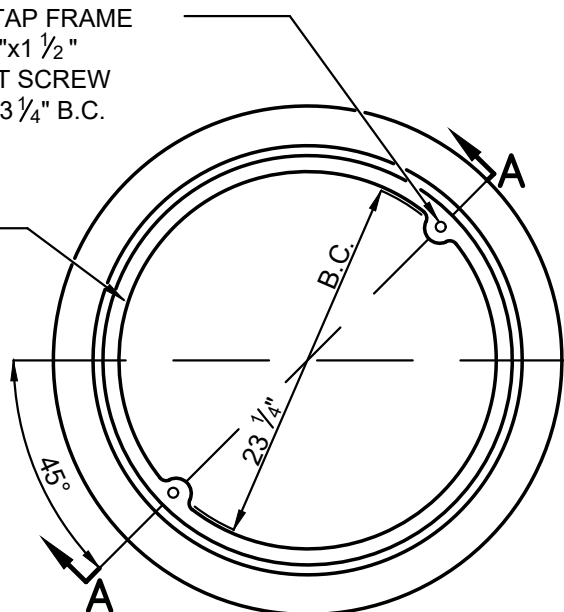

PLAN OF FRAME

NOTES:

1. MANHOLE FRAME AND COVER TO BE MANUFACTURED FROM CLASS 35 CAST IRON PER ASTM A-48.
2. FRAME AND COVER SHALL BE CAPABLE OF SUPPORTING H-20 WHEEL LOADING.
3. COVER SHALL HAVE CAST INTO TOP IN 1" HIGH MINIMUM BLOCK LETTERS "VICTORVILLE" OR "CITY OF VICTORVILLE" AND "DRAIN". MANUFACTURER'S NAME OR INSIGNIA SHALL BE CAST INTO BOTH FRAME AND COVER.
4. MACHINE MATING SURFACES OF FRAME AND COVER TO PROVIDE UNIFORM EDGE SUPPORT FOR COVER.
5. PAINT FRAME AND COVER WITH BLACK BITUMINOUS PAINT.
6. APPROVED SUPPLIERS: ALHAMBRA FOUNDRY #1254, NEENAH FOUNDRY #R-1593 AND SOUTH BAY FOUNDRY #SBF1253B.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STORM DRAIN MANHOLE FRAME AND COVER	D-04
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1



**SEE STANDARD
PLANS FOR
PUBLIC WORKS CONSTRUCTION
STANDARD PLAN 320-330
MIN MH DIAM= 30" PER STD 632**

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	PRECAST STORM DRAIN MANHOLE	D-05
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

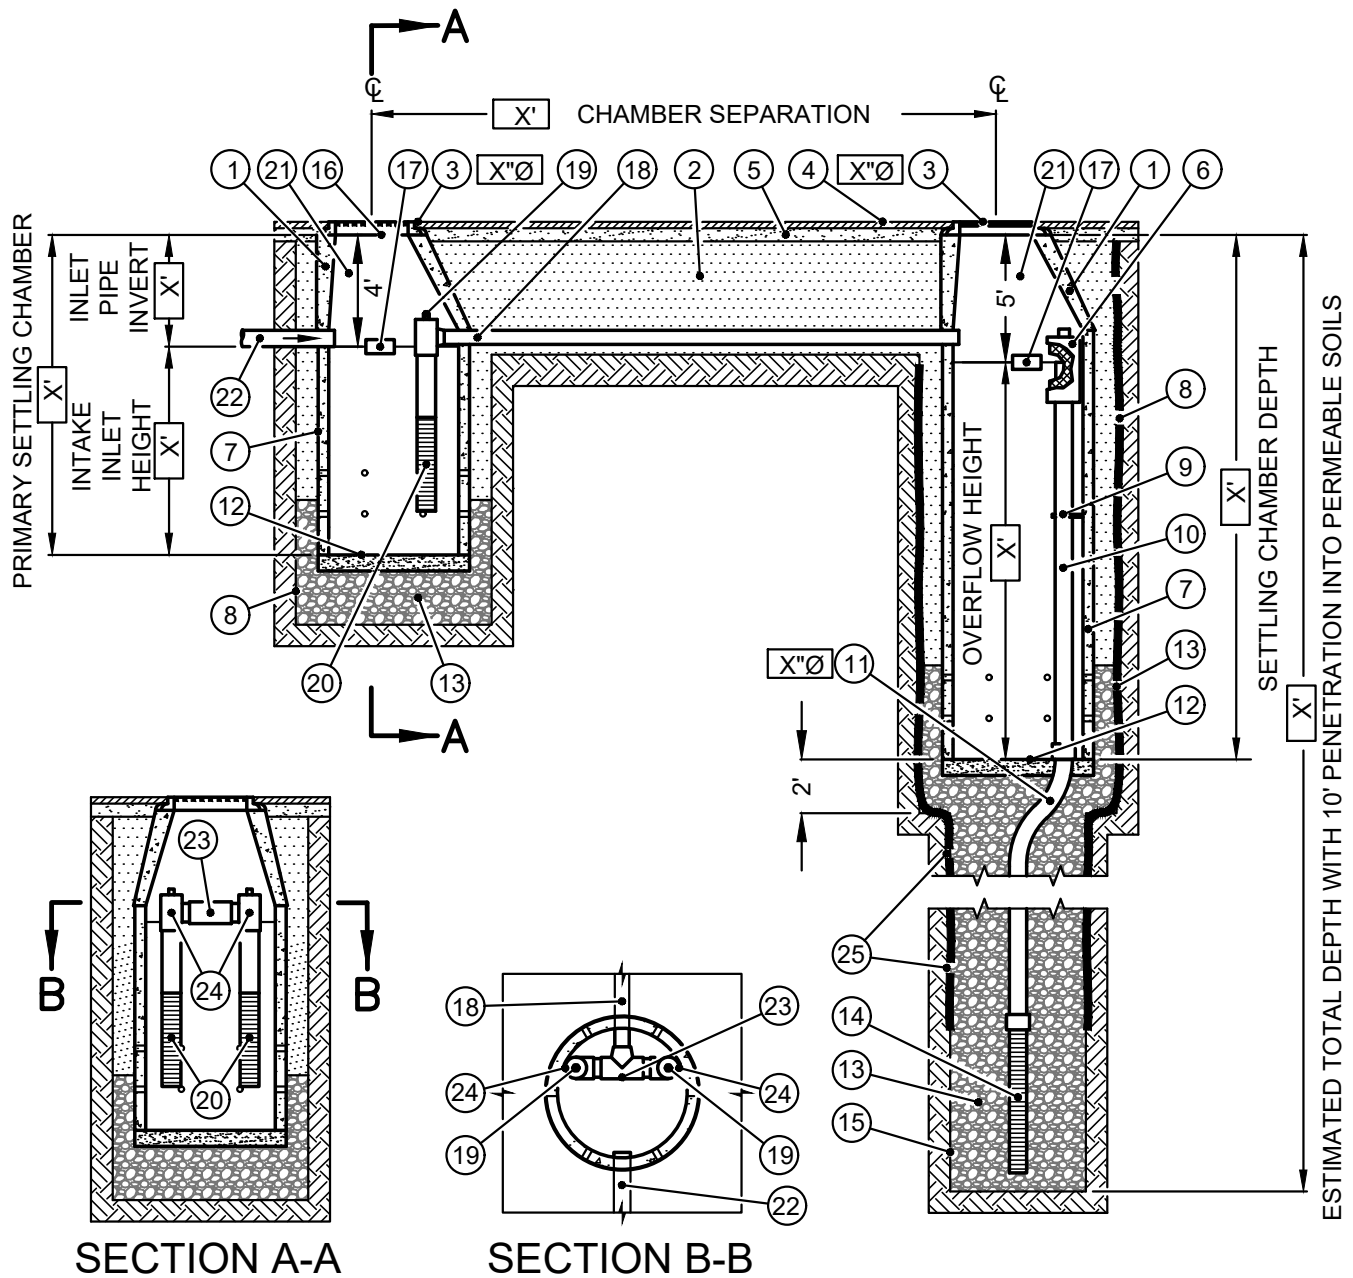

NOTES:

1. CONSTRUCT DRY WELLS PER THE BID SPECIFICATIONS AND PLANS, COMPLETE IN PLACE. DETAILS ARE AS FOLLOWS:

INTERCEPTOR DEPTH = 10 FEET
 OVERALL DEPTH = 75 FEET
 SETTLING CHAMBER DEPTH = 18 FEET
 EFFECTIVE SETTLING CAPACITY = 13 FEET

CONNECTOR PIPE = 4'Ø
 OVERFLOW PIPE = 6'Ø
 C.I. RING AND GRATE = 30"Ø

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	DRY WELL SYSTEM DETAILS	D-06
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 2

ITEM NUMBERS:


- ① MANHOLE CONE - MODIFIED FLAT BOTTOM. CITY OF VICTORVILLE STD. SS-1, MANHOLE SECTIONS AND CONES COULD BE SUBSTITUTED UPON WRITTEN APPROVAL.
- ② STABILIZED BACKFILL - 2 SACK CONCRETE SLURRY.
- ③ BOLTED RING & GRATE/COVER - DIAMETER AS SHOWN. CLEAN CAST IRON WITH WORDING "CITY OF VICTORVILLE DRYWELL" IN RAISED LETTERS. BOLTED IN 2 LOCATIONS AND SECURED TO CONE WITH MORTAR. RIM ELEVATION $\pm 0.02'$ OF PLANS, PER CITY STD. D-04.
- ④ GRADED BASIN OR PAVING (BY OTHERS).
- ⑤ COMPACTED BASE MATERIAL (BY OTHERS).
- ⑥ DEBRIS SHIELD - ROLLED 16 GA. STEEL X 24" LENGTH WITH VENTED ANTI-SIPHON AND INTERNAL .265" MAX. SWO FLATTENED EXPANDED STEEL SCREEN X 12" LENGTH. FUSION BONDED EPOXY COATED.
- ⑦ PRE-CAST LINER - 4000 PSI CONCRETE 48" ID. X 54" OD. CENTER IN HOLE AND ALIGN SECTIONS TO MAXIMIZE BEARING SURFACE.
- ⑧ MIN. 6' Ø DRILLED SHAFT.
- ⑨ SUPPORT BRACKET - FORMED 12 GA. STEEL. FUSION BONDED EPOXY COATED.
- ⑩ OVERFLOW PIPE - SCH. 40 PVC MATED TO DRAINAGE PIPE AT BASE SEAL.
- ⑪ DRAINAGE PIPE - ADS HIGHWAY GRADE WITH COUPLER. SUSPEND PIPE DURING BACKFILL OPERATIONS TO PREVENT BUCKLING OR BREAKAGE. DIAMETER AS NOTED.
- ⑫ BASE SEAL - 6" THICK CONCRETE SLAB.
- ⑬ ROCK - CLEAN AND WASHED 3/8" AGGREGATE.
- ⑭ DRAINAGE SCREEN - SCH. 40 PVC 0.120" SLOTTED WELL SCREEN WITH 32 SLOTS PER ROW/FT. DIAMETER VARIES 96" OVERALL LENGTH WITH COUPLER.
- ⑮ MIN. 4' Ø SHAFT - DRILLED TO MAINTAIN PERMEABILITY OF DRAINAGE SOILS.
- ⑯ FABRIC SEAL - U.V. RESISTANT GEOTEXTILE - TO BE REMOVED BY CUSTOMER AT PROJECT COMPLETION.
- ⑰ ABSORBENT - HYDROPHOBIC PETROCHEMICAL SPONGE. MIN. 128 OZ. CAPACITY.
- ⑱ CONNECTOR PIPE - 4" Ø SCH. 40 PVC .
- ⑲ VENTED ANTI-SIPHON INTAKE.
- ⑳ INTAKE SCREEN - 6" Ø SCH. 40 PVC 0.120" MODIFIED SLOTTED WELL SCREEN WITH 32 SLOTS PER ROW/FT. 48" OVERALL LENGTH WITH END CAP.
- ㉑ FREEBOARD DEPTH VARIES WITH INLET PIPE ELEVATION. INCREASE PRIMARY/SECONDARY SETTLING CHAMBER DEPTHS AS NEEDED TO MAINTAIN ALL INLET PIPE ELEVATIONS ABOVE CONNECTOR PIPE OVERFLOW.
- ㉒ GUTTER DRAIN INLET - 8" SCH 40 PVC, PER CITY STD. D-07.
- ㉓ 6" X 4" REDUCING TEE - SCH. 40 PVC, WITH FLOW REGULATOR.
- ㉔ 6" TEE - SCH. 40 PVC.
- ㉕ NON-WOVEN GEOTEXTILE SLEEVE, MIRAFL 140 NL. MIN. 6 FT Ø, HELD APPROX. 10 FEET OFF THE BOTTOM OF EXCAVATION.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	DRY WELL SYSTEM DETAILS	D-06
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2

NOTES:

1. ACTUAL LOCATIONS OF INTERCEPTOR AND DRY WELL WOULD BE FIELD DETERMINED BASED ON LOCATION OF UTILITY LINES AND OTHER OBSTRUCTIONS/LANDSCAPING.
2. DIMENSIONS SHOWN ON THIS SHEET WILL BE USED AS A GUIDE ONLY.
3. CONTRACTOR TO CALL U.S.A. AT LEAST 48 HOURS PRIOR TO FIELD DETERMINATION OF DRY WELL AND INTERCEPTOR.
4. CONTRACTOR TO TAKE DUE PRECAUTIONARY MEASURES TO PROTECT ALL UTILITY LINES AND OBSTRUCTIONS/LANDSCAPING DURING ACTUAL CONSTRUCTION.
5. CONTRACTOR TO RESTORE SITE AS CLOSE AS POSSIBLE BACK TO THE ORIGINAL CONDITIONS AFTER COMPLETION OF WORK.
6. CONCRETE SHALL BE MINOR CONCRETE PER SECTION 90 OF STANDARD SPECIFICATIONS.
7. GUTTER DRAIN DETAIL IS ALHAMBRA FOUNDRY A-1292 GUTTER DRAIN.
8. ALL EXPOSED METAL PARTS SHALL BE GALVANIZED.
9. FOR ALL CONSTRUCTION, INLET OPENINGS SHALL HAVE A LAYER OF FILTER FABRIC OVER THE OPENING AND A SAND BAG CHECK DAM AND BE MAINTAINED IN PLACE UNTIL CONSTRUCTION IS COMPLETED AND STREETS HAVE BEEN CLEANED.
10. CONTRACTOR HAS TO CLEAN AND REMOVE THE SILT AND DEBRIS BUILDUP IN THE INTERCEPTOR AND DRY WELLS PRIOR TO ACCEPTANCE BY THE CITY.

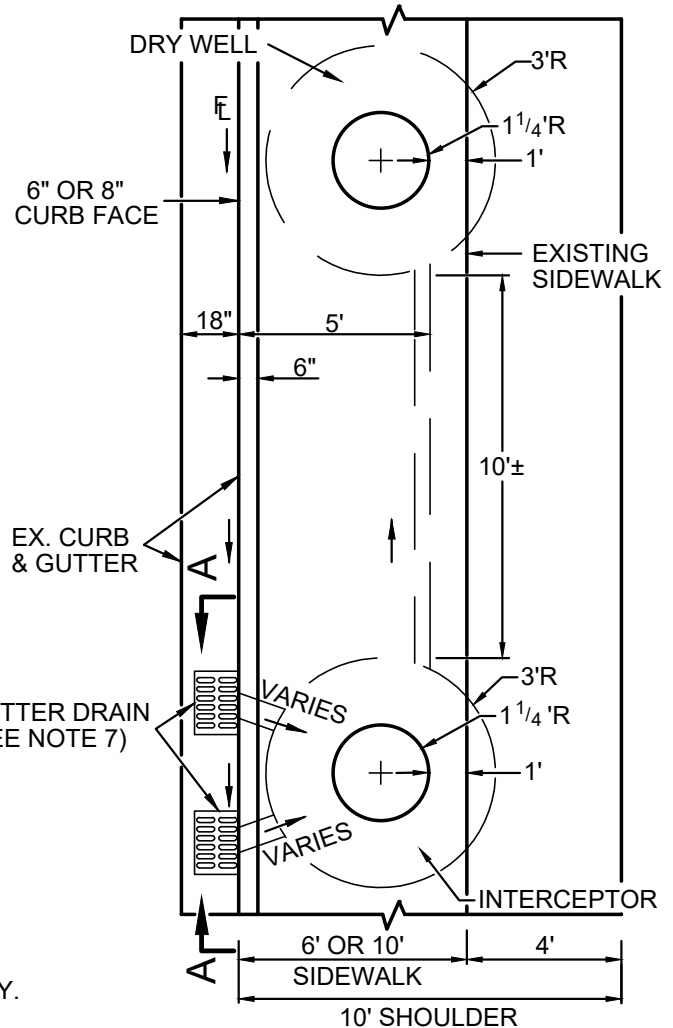

PLAN
NOT TO SCALE

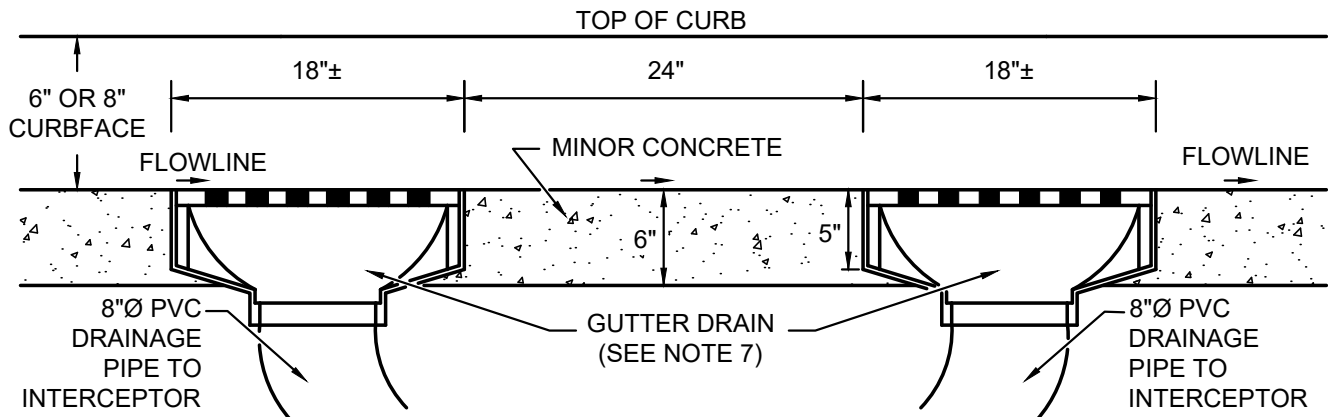

SECTION A-A
NOT TO SCALE

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	DRY WELL AND INTERCEPTOR	D-07
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

DRAWING INDEX

GS-01 CIRCULAR DRIVEWAY (2 SHEETS)
GS-02 HAMMERHEAD DRIVEWAY TYPE 1 (2 SHEETS)
GS-03 HAMMERHEAD DRIVEWAY TYPE 2 (2 SHEETS)
GS-04 HAMMERHEAD DRIVEWAY TYPE 3 (2 SHEETS)
GS-05 HAMMERHEAD DRIVEWAY TYPE 4 (2 SHEETS)
GS-06 HAMMERHEAD DRIVEWAY TYPE 5 (2 SHEETS)

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	GENERAL SURFACE IMPROVEMENT STANDARD DRAWINGS INDEX	GS-INDEX
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 1

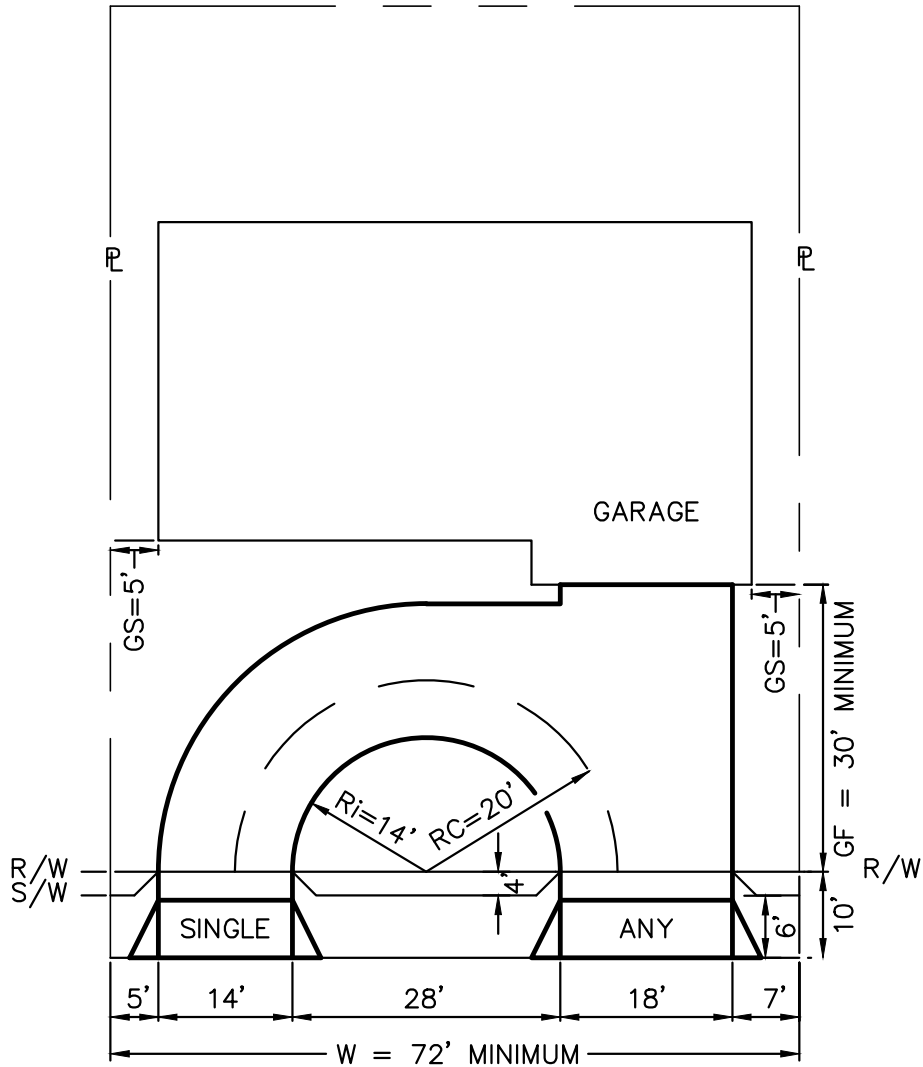

PLAN
NOT TO SCALE

W	GF	GS	Rc	Ri
72'	30'	5'	20'	14'

TABLE

NOTES:

- ALL DIMENSIONS ARE MINIMUMS AND ARE IN FEET.
W = LOT WIDTH (AT PROPERTY LINE).
GF = FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE.
GS = SIDE YARD SETBACK FROM GARAGE WALL TO NEAREST PROPERTY LINE.
Rc = CENTER TURNING RADIUS OF DRIVEWAY. MINIMUM 20 FEET.
Ri = INSIDE TURNING RADIUS OF DRIVEWAY.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	CIRCULAR DRIVEWAY	GS-01
04/24/2026	STAFF		
	<i>FAB</i>	FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 2

NOTES:

1. ALL DIMENSIONS ARE MINIMUMS.
2. DIMENSIONS MAY NEED TO BE INCREASED TO ALLOW FOR SLOPES ON THE SIDE YARD OR FRONT YARD, MAXIMUM GRADE OF THE DRIVEWAY, LOT DRAINAGE, PLACEMENT OF FIRE HYDRANTS AND/OR STREETLIGHTS OR OTHER CONDITIONS.
3. ASSUMED WIDTH OF DRIVEWAY AND DRIVEWAY APPROACH FOR A TWO-CAR GARAGE IS 18 FEET. DRIVEWAY WIDTHS AND DIMENSIONS FROM EDGE OF DRIVEWAY TO OUTSIDE SURFACE OF GARAGE WALL WILL VARY.
4. ASSUMED DRIVEWAY WIDTH IS 12 FEET AND DRIVEWAY APPROACH WIDTH IS 14 FEET FOR CIRCULAR DRIVEWAY SECOND APPROACH.
5. MINIMUM YARD SETBACKS ARE SUBJECT TO CITY REQUIREMENTS INCLUDING THE MUNICIPAL CODE, THE GENERAL PLAN OR THE SPECIFIC PLAN (IF APPLICABLE).
6. FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE (GF) AND SIDE YARD SETBACK FROM GARAGE WALL TO NEAREST PROPERTY LINE (GS) AND THE SETBACKS TO THE GARAGE AND HOUSE ARE NOT NECESSARILY THE SAME AS THE MINIMUM FRONT YARD AND SIDE YARD SETBACKS REQUIRED.
7. THE FOOTPRINT OF THE HOUSE SHOWN IN THIS STANDARD IS AN EXAMPLE ONLY. FOOTPRINTS WILL VARY BUT MUST MEET SETBACK REQUIREMENTS.
8. THE CIRCULAR LAYOUT NEEDS TO BE DESIGNED FOR A SPECIFIC LOT AND INCORPORATED INTO THE PRECISE GRADING PLAN FOR THE LOT.
9. RETAINING WALLS, CURBS AND DRAINAGE SWALES MAY BE REQUIRED TO ACCOMMODATE THE DRIVEWAY IMPROVEMENTS ON A LOT. THE PRECISE GRADING PLAN FOR THE LOT MUST SHOW IMPROVEMENTS NECESSARY TO CONSTRUCT THE DRIVEWAY.
10. DRIVEWAY APPROACHES SHALL COMPLY WITH CITY OF VICTORVILLE STANDARD DRAWING NO. S-02.
11. MAXIMUM DRIVEWAY LONGITUDINAL SLOPE (90 DEGREES TO STREET) IS 12%.
12. MAXIMUM DRIVEWAY CROSS SLOPE (PARALLEL TO STREET) IS 6%.
13. MAXIMUM CHANGE OF SLOPE IN DRIVEWAY GRADE BREAK IS 12%.
14. FOR CONSTRUCTION OF CIRCULAR DRIVEWAYS AT EXISTING RESIDENCES, THE CITY ENGINEER MAY GRANT EXCEPTIONS TO THE STANDARDS.
15. MAXIMUM WIDTH FOR SINGLE DRIVE APPROACH IS 16 FEET.
16. MAXIMUM WIDTH FOR DOUBLE DRIVE APPROACH IS 18 FEET.
17. MAXIMUM WIDTH FOR TRIPLE DRIVE APPROACH IS 24 FEET.
18. MAXIMUM NUMBER OF DRIVE APPROACHES PER LOT IS 2.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CIRCULAR DRIVEWAY	GS-01
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2

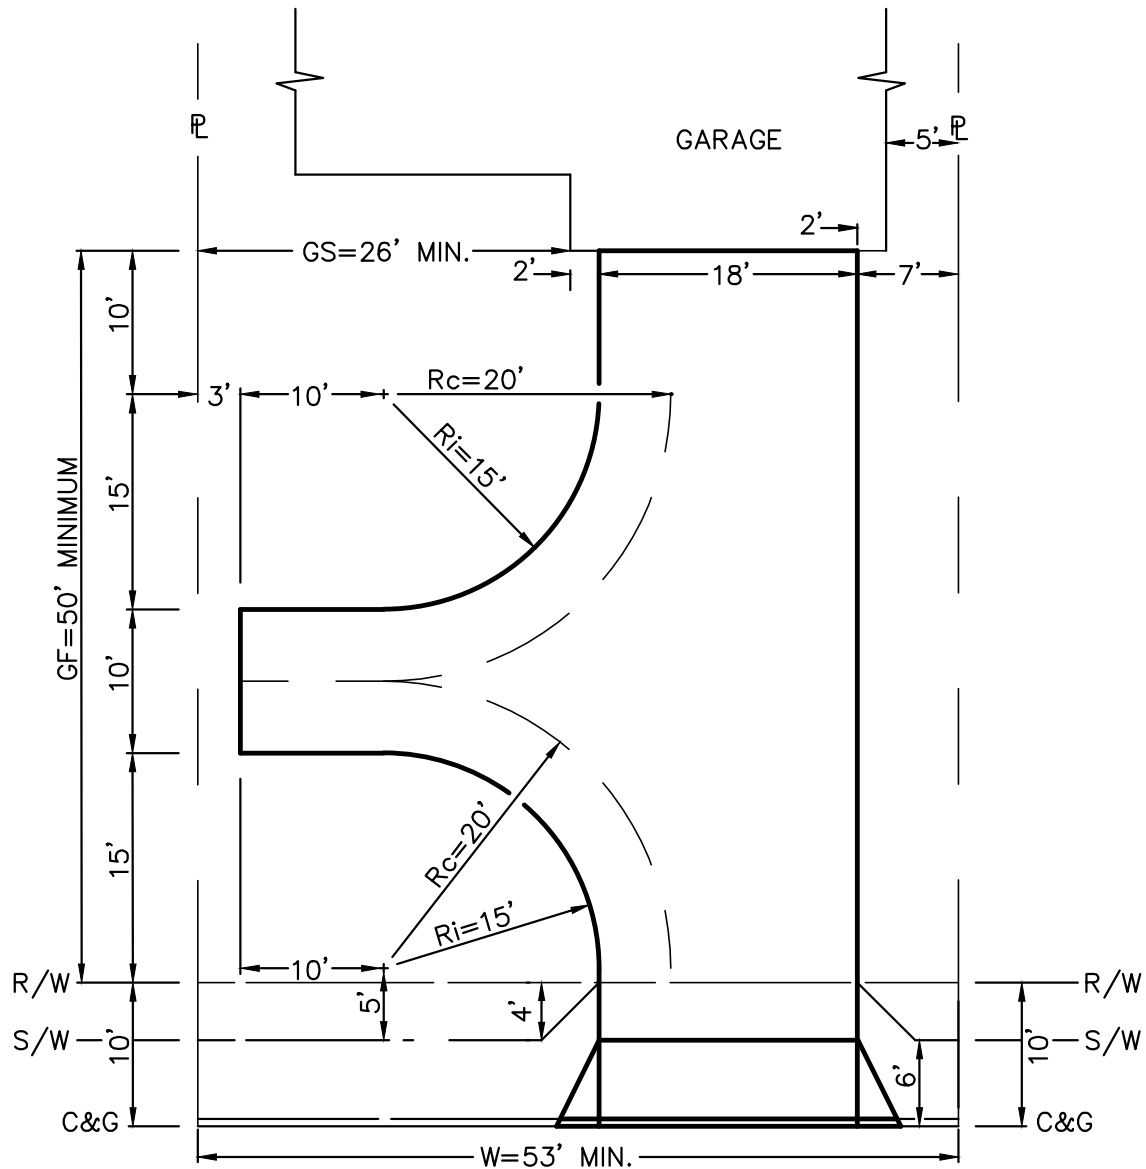

GARAGE FACING STREET
HAMMERHEAD TO LOT EXTERIOR

PLAN
N.T.S.

W	GF	GS	Rc	Ri
53'	45'	26'	20'	15'

TABLE

ABBREVIATIONS

- W = LOT WIDTH (AT PROPERTY LINE).
 GF = FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE.
 GS = SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD.
 Rc = CENTER TURNING RADIUS OF DRIVEWAY. MINIMUM 20 FEET.
 Ri = INSIDE TURNING RADIUS OF DRIVEWAY.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 1	GS-02
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 2

NOTES:

1. ALL DIMENSIONS ARE MINIMUMS.
2. DIMENSIONS MAY NEED TO BE INCREASED TO ALLOW FOR SLOPES ON THE SIDE YARD OR FRONT YARD, MAXIMUM GRADE OF THE DRIVEWAY, LOT DRAINAGE, PLACEMENT OF FIRE HYDRANTS AND/OR STREETLIGHTS OR OTHER CONDITIONS.
3. ASSUMED WIDTH OF DRIVEWAY AND DRIVEWAY APPROACH FOR A TWO-CAR GARAGE IS 18 FEET. DRIVEWAY WIDTHS AND DIMENSIONS FROM EDGE OF DRIVEWAY TO OUTSIDE SURFACE OF GARAGE WALL WILL VARY.
4. MINIMUM YARD SETBACKS ARE SUBJECT TO CITY REQUIREMENTS INCLUDING THE MUNICIPAL CODE, THE GENERAL PLAN OR THE SPECIFIC PLAN (IF APPLICABLE).
5. FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE (GF) AND SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD (GS) AND THE SETBACKS TO THE GARAGE ARE NOT NECESSARILY THE SAME AS THE MINIMUM FRONT YARD AND SIDE YARD SETBACKS REQUIRED.
6. THE FOOTPRINT OF THE HOUSE SHOWN IN THIS STANDARD IS AN EXAMPLE ONLY. FOOTPRINTS WILL VARY BUT MUST MEET SETBACK REQUIREMENTS.
7. THE HAMMERHEAD LAYOUT NEEDS TO BE DESIGNED FOR A SPECIFIC LOT AND INCORPORATED INTO THE PRECISE GRADING PLAN FOR THE LOT.
8. RETAINING WALLS, CURBS AND DRAINAGE SWALES MAY BE REQUIRED TO ACCOMMODATE THE DRIVEWAY IMPROVEMENTS ON A LOT. THE PRECISE GRADING PLAN FOR THE LOT MUST SHOW IMPROVEMENTS NECESSARY TO CONSTRUCT THE DRIVEWAY.
9. DRIVEWAY APPROACH SHALL COMPLY WITH CITY OF VICTORVILLE STANDARD DRAWING NO. S-02 WHERE CURB AND GUTTER EXISTS.
10. MAXIMUM DRIVEWAY LONGITUDINAL SLOPE (90 DEGREES TO STREET) IS 12%.
11. MAXIMUM DRIVEWAY CROSS SLOPE (PARALLEL TO STREET) IS 6%.
12. MAXIMUM CHANGE OF SLOPE IN DRIVEWAY GRADE BREAK IS 12%.
13. FOR CONSTRUCTION OF HAMMERHEAD DRIVEWAYS AT EXISTING RESIDENCES, THE CITY ENGINEER MAY GRANT EXCEPTIONS TO THE STANDARDS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 1	GS-02
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2

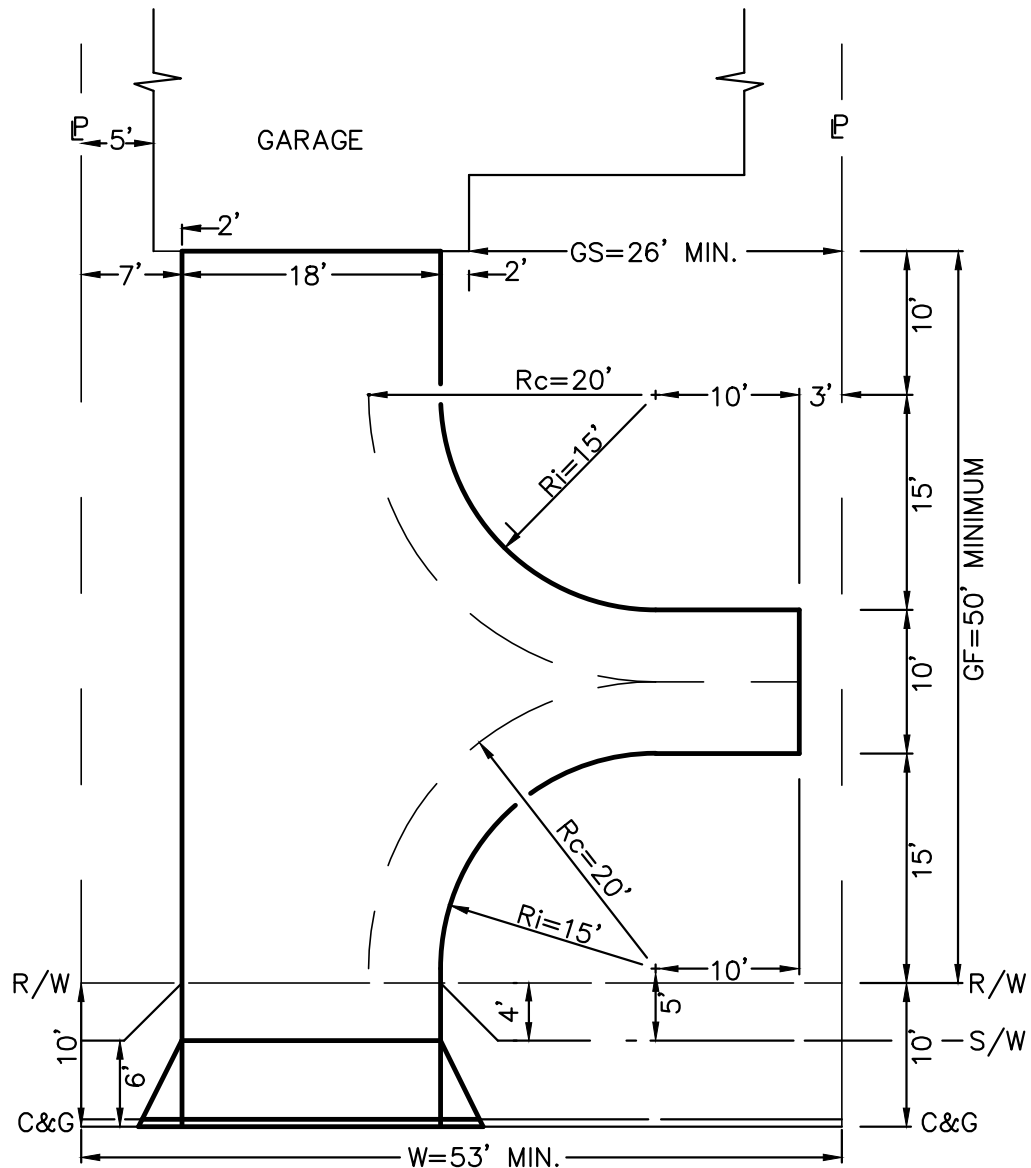

GARAGE FACING STREET
HAMMERHEAD TO LOT INTERIOR

PLAN
N.T.S.

W	GF	GS	Rc	Ri
53'	50'	26'	20'	15'

TABLE

ABBREVIATIONS

W = LOT WIDTH (AT PROPERTY LINE).
 GF = FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE.
 GS = SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD.
 Rc = CENTER TURNING RADIUS OF DRIVEWAY. MINIMUM 20 FEET.
 Ri = INSIDE TURNING RADIUS OF DRIVEWAY.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 2	GS-03
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 2

NOTES:

1. ALL DIMENSIONS ARE MINIMUMS.
2. DIMENSIONS MAY NEED TO BE INCREASED TO ALLOW FOR SLOPES ON THE SIDE YARD OR FRONT YARD, MAXIMUM GRADE OF THE DRIVEWAY, LOT DRAINAGE, PLACEMENT OF FIRE HYDRANTS AND/OR STREETLIGHTS OR OTHER CONDITIONS.
3. ASSUMED WIDTH OF DRIVEWAY AND DRIVEWAY APPROACH FOR A TWO-CAR GARAGE IS 18 FEET. DRIVEWAY WIDTHS AND DIMENSIONS FROM EDGE OF DRIVEWAY TO OUTSIDE SURFACE OF GARAGE WALL WILL VARY.
4. MINIMUM YARD SETBACKS ARE SUBJECT TO CITY REQUIREMENTS INCLUDING THE MUNICIPAL CODE, THE GENERAL PLAN OR THE SPECIFIC PLAN (IF APPLICABLE).
5. FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE (GF) AND SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD (GS) AND THE SETBACKS TO THE GARAGE ARE NOT NECESSARILY THE SAME AS THE MINIMUM FRONT YARD AND SIDE YARD SETBACKS REQUIRED.
6. THE FOOTPRINT OF THE HOUSE SHOWN IN THIS STANDARD IS AN EXAMPLE ONLY. FOOTPRINTS WILL VARY BUT MUST MEET SETBACK REQUIREMENTS.
7. THE HAMMERHEAD LAYOUT NEEDS TO BE DESIGNED FOR A SPECIFIC LOT AND INCORPORATED INTO THE PRECISE GRADING PLAN FOR THE LOT.
8. RETAINING WALLS, CURBS AND DRAINAGE SWALES MAY BE REQUIRED TO ACCOMMODATE THE DRIVEWAY IMPROVEMENTS ON A LOT. THE PRECISE GRADING PLAN FOR THE LOT MUST SHOW IMPROVEMENTS NECESSARY TO CONSTRUCT THE DRIVEWAY.
9. DRIVEWAY APPROACH SHALL COMPLY WITH CITY OF VICTORVILLE STANDARD DRAWING NO. S-02 WHERE CURB AND GUTTER EXISTS.
10. MAXIMUM DRIVEWAY LONGITUDINAL SLOPE (90 DEGREES TO STREET) IS 12%.
11. MAXIMUM DRIVEWAY CROSS SLOPE (PARALLEL TO STREET) IS 6%.
12. MAXIMUM CHANGE OF SLOPE IN DRIVEWAY GRADE BREAK IS 12%.
13. FOR CONSTRUCTION OF HAMMERHEAD DRIVEWAYS AT EXISTING RESIDENCES, THE CITY ENGINEER MAY GRANT EXCEPTIONS TO THE STANDARDS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 2	GS-03
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2

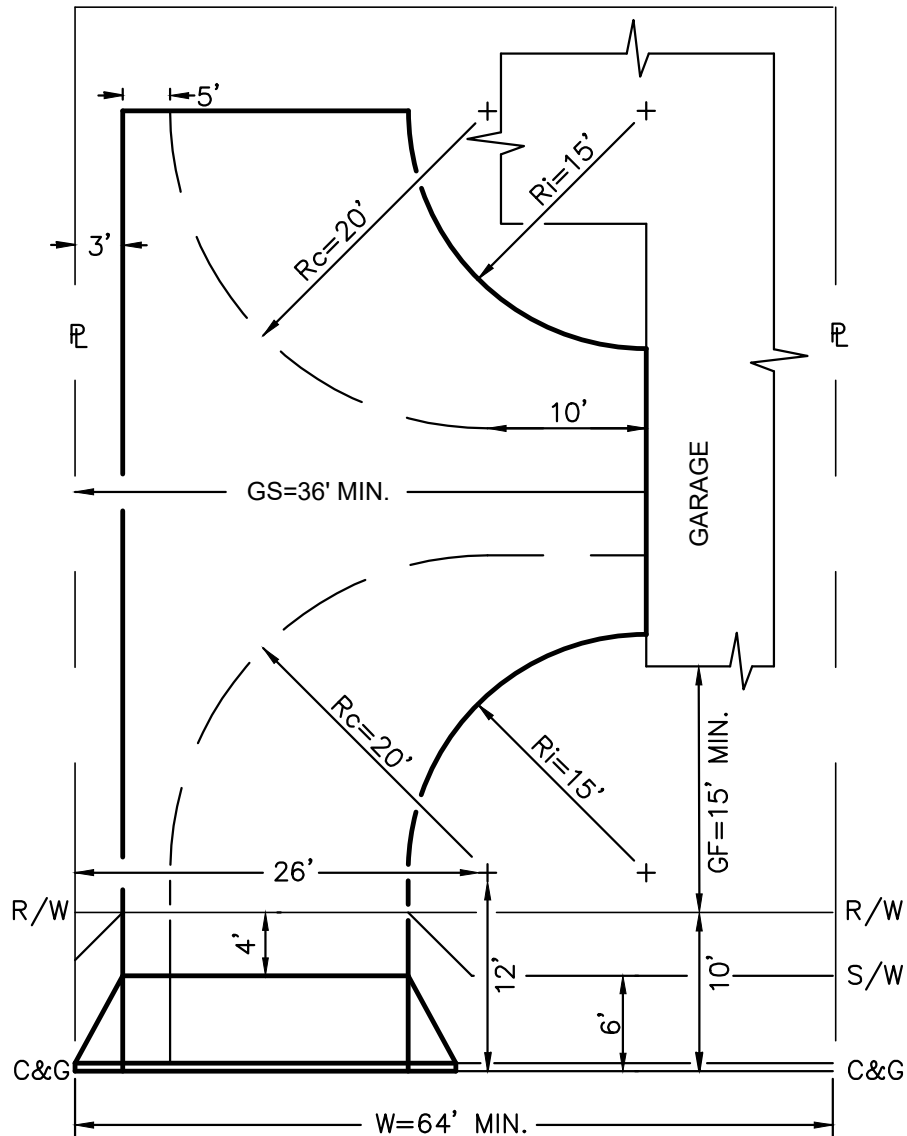

GARAGE FACING SIDE
HAMMERHEAD TO BACK OF LOT

PLAN
N.T.S.

W	GF	GS	Rc	Ri
64'	15'	36'	20'	15'

TABLE

ABBREVIATIONS

- W = LOT WIDTH (AT PROPERTY LINE).
 GF = FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE.
 GS = SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD.
 Rc = CENTER TURNING RADIUS OF DRIVEWAY. MINIMUM 20 FEET.
 Ri = INSIDE TURNING RADIUS OF DRIVEWAY.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 3	GS-04
04/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 2

NOTES:


1. ALL DIMENSIONS ARE MINIMUMS.
2. DIMENSIONS MAY NEED TO BE INCREASED TO ALLOW FOR SLOPES ON THE SIDE YARD OR FRONT YARD, MAXIMUM GRADE OF THE DRIVEWAY, LOT DRAINAGE, PLACEMENT OF FIRE HYDRANTS AND/OR STREETLIGHTS OR OTHER CONDITIONS.
3. ASSUMED WIDTH OF DRIVEWAY AND DRIVEWAY APPROACH FOR A TWO-CAR GARAGE IS 18 FEET. DRIVEWAY WIDTHS AND DIMENSIONS FROM EDGE OF DRIVEWAY TO OUTSIDE SURFACE OF GARAGE WALL WILL VARY.
4. MINIMUM YARD SETBACKS ARE SUBJECT TO CITY REQUIREMENTS INCLUDING THE MUNICIPAL CODE, THE GENERAL PLAN OR THE SPECIFIC PLAN (IF APPLICABLE).
5. FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE (GF) AND SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD (GS) AND THE SETBACKS TO THE GARAGE ARE NOT NECESSARILY THE SAME AS THE MINIMUM FRONT YARD AND SIDE YARD SETBACKS REQUIRED.
6. THE FOOTPRINT OF THE HOUSE SHOWN IN THIS STANDARD IS AN EXAMPLE ONLY. FOOTPRINTS WILL VARY BUT MUST MEET SETBACK REQUIREMENTS.
7. THE HAMMERHEAD LAYOUT NEEDS TO BE DESIGNED FOR A SPECIFIC LOT AND INCORPORATED INTO THE PRECISE GRADING PLAN FOR THE LOT.
8. RETAINING WALLS, CURBS AND DRAINAGE SWALES MAY BE REQUIRED TO ACCOMMODATE THE DRIVEWAY IMPROVEMENTS ON A LOT. THE PRECISE GRADING PLAN FOR THE LOT MUST SHOW IMPROVEMENTS NECESSARY TO CONSTRUCT THE DRIVEWAY.
9. DRIVEWAY APPROACH SHALL COMPLY WITH CITY OF VICTORVILLE STANDARD DRAWING NO. S-02 WHERE CURB AND GUTTER EXISTS.
10. MAXIMUM DRIVEWAY LONGITUDINAL SLOPE (90 DEGREES TO STREET) IS 12%.
11. MAXIMUM DRIVEWAY CROSS SLOPE (PARALLEL TO STREET) IS 6%.
12. MAXIMUM CHANGE OF SLOPE IN DRIVEWAY GRADE BREAK IS 12%.
13. FOR CONSTRUCTION OF HAMMERHEAD DRIVEWAYS AT EXISTING RESIDENCES, THE CITY ENGINEER MAY GRANT EXCEPTIONS TO THE STANDARDS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 3	GS-04
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2

NOTES:

1. ALL DIMENSIONS ARE MINIMUMS.
2. DIMENSIONS MAY NEED TO BE INCREASED TO ALLOW FOR SLOPES ON THE SIDE YARD OR FRONT YARD, MAXIMUM GRADE OF THE DRIVEWAY, LOT DRAINAGE, PLACEMENT OF FIRE HYDRANTS AND/OR STREETLIGHTS OR OTHER CONDITIONS.
3. ASSUMED WIDTH OF DRIVEWAY AND DRIVEWAY APPROACH FOR A TWO-CAR GARAGE IS 18 FEET. DRIVEWAY WIDTHS AND DIMENSIONS FROM EDGE OF DRIVEWAY TO OUTSIDE SURFACE OF GARAGE WALL WILL VARY.
4. MINIMUM YARD SETBACKS ARE SUBJECT TO CITY REQUIREMENTS INCLUDING THE MUNICIPAL CODE, THE GENERAL PLAN OR THE SPECIFIC PLAN (IF APPLICABLE).
5. FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE (GF) AND SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD (GS) AND THE SETBACKS TO THE GARAGE ARE NOT NECESSARILY THE SAME AS THE MINIMUM FRONT YARD AND SIDE YARD SETBACKS REQUIRED.
6. THE FOOTPRINT OF THE HOUSE SHOWN IN THIS STANDARD IS AN EXAMPLE ONLY. FOOTPRINTS WILL VARY BUT MUST MEET SETBACK REQUIREMENTS.
7. THE HAMMERHEAD LAYOUT NEEDS TO BE DESIGNED FOR A SPECIFIC LOT AND INCORPORATED INTO THE PRECISE GRADING PLAN FOR THE LOT.
8. RETAINING WALLS, CURBS AND DRAINAGE SWALES MAY BE REQUIRED TO ACCOMMODATE THE DRIVEWAY IMPROVEMENTS ON A LOT. THE PRECISE GRADING PLAN FOR THE LOT MUST SHOW IMPROVEMENTS NECESSARY TO CONSTRUCT THE DRIVEWAY.
9. DRIVEWAY APPROACH SHALL COMPLY WITH CITY OF VICTORVILLE STANDARD DRAWING NO. S-02 WHERE CURB AND GUTTER EXISTS.
10. MAXIMUM DRIVEWAY LONGITUDINAL SLOPE (90 DEGREES TO STREET) IS 12%.
11. MAXIMUM DRIVEWAY CROSS SLOPE (PARALLEL TO STREET) IS 6%.
12. MAXIMUM CHANGE OF SLOPE IN DRIVEWAY GRADE BREAK IS 12%.
13. FOR CONSTRUCTION OF HAMMERHEAD DRIVEWAYS AT EXISTING RESIDENCES, THE CITY ENGINEER MAY GRANT EXCEPTIONS TO THE STANDARDS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 4	GS-05
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2

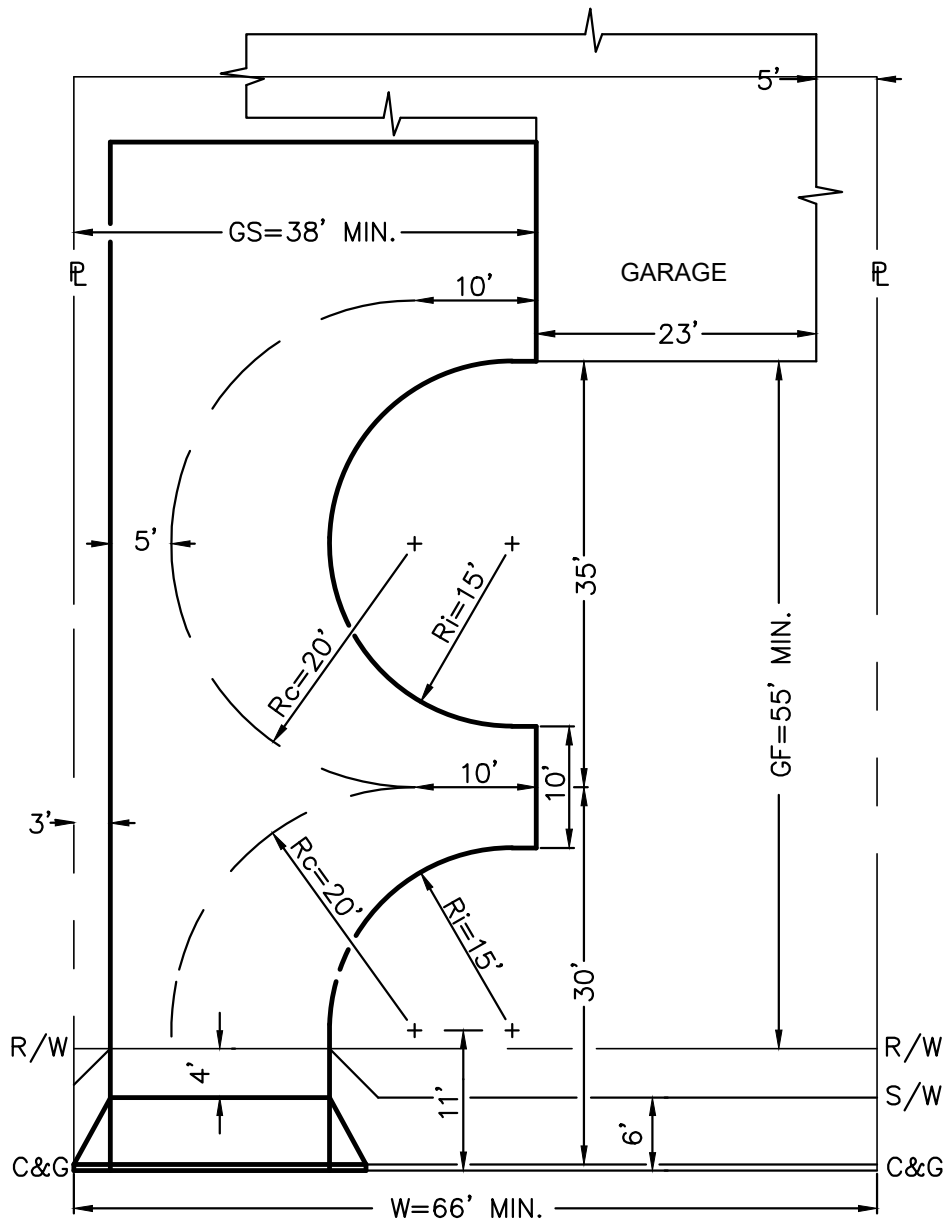

GARAGE FACING SIDE
HAMMERHEAD TO LOT INTERIOR

PLAN
N.T.S.

W	GF	GS	Rc	Ri
66'	50'	38'	20'	15'

TABLE

ABBREVIATIONS

W = LOT WIDTH (AT PROPERTY LINE).
 GF = FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE.
 GS = SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD.
 Rc = CENTER TURNING RADIUS OF DRIVEWAY. MINIMUM 20 FEET.
 Ri = INSIDE TURNING RADIUS OF DRIVEWAY.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 5	GS-06
04/24/2026	STAFF		
		FREDY A. BONILLA CITY ENGINEER	SHEET 1 OF 2

NOTES:


1. ALL DIMENSIONS ARE MINIMUMS.
2. DIMENSIONS MAY NEED TO BE INCREASED TO ALLOW FOR SLOPES ON THE SIDE YARD OR FRONT YARD, MAXIMUM GRADE OF THE DRIVEWAY, LOT DRAINAGE, PLACEMENT OF FIRE HYDRANTS AND/OR STREETLIGHTS OR OTHER CONDITIONS.
3. ASSUMED WIDTH OF DRIVEWAY AND DRIVEWAY APPROACH FOR A TWO-CAR GARAGE IS 18 FEET. DRIVEWAY WIDTHS AND DIMENSIONS FROM EDGE OF DRIVEWAY TO OUTSIDE SURFACE OF GARAGE WALL WILL VARY.
4. MINIMUM YARD SETBACKS ARE SUBJECT TO CITY REQUIREMENTS INCLUDING THE MUNICIPAL CODE, THE GENERAL PLAN OR THE SPECIFIC PLAN (IF APPLICABLE).
5. FRONT YARD SETBACK TO GARAGE WALL AND HOUSE FROM PROPERTY LINE (GF) AND SIDE YARD SETBACK TO GARAGE WALL FROM PROPERTY LINE NEAREST HAMMERHEAD (GS) AND THE SETBACKS TO THE GARAGE ARE NOT NECESSARILY THE SAME AS THE MINIMUM FRONT YARD AND SIDE YARD SETBACKS REQUIRED.
6. THE FOOTPRINT OF THE HOUSE SHOWN IN THIS STANDARD IS AN EXAMPLE ONLY. FOOTPRINTS WILL VARY BUT MUST MEET SETBACK REQUIREMENTS.
7. THE HAMMERHEAD LAYOUT NEEDS TO BE DESIGNED FOR A SPECIFIC LOT AND INCORPORATED INTO THE PRECISE GRADING PLAN FOR THE LOT.
8. RETAINING WALLS, CURBS AND DRAINAGE SWALES MAY BE REQUIRED TO ACCOMMODATE THE DRIVEWAY IMPROVEMENTS ON A LOT. THE PRECISE GRADING PLAN FOR THE LOT MUST SHOW IMPROVEMENTS NECESSARY TO CONSTRUCT THE DRIVEWAY.
9. DRIVEWAY APPROACH SHALL COMPLY WITH CITY OF VICTORVILLE STANDARD DRAWING NO. S-02 WHERE CURB AND GUTTER EXISTS.
10. MAXIMUM DRIVEWAY LONGITUDINAL SLOPE (90 DEGREES TO STREET) IS 12%.
11. MAXIMUM DRIVEWAY CROSS SLOPE (PARALLEL TO STREET) IS 6%.
12. MAXIMUM CHANGE OF SLOPE IN DRIVEWAY GRADE BREAK IS 12%.
13. FOR CONSTRUCTION OF HAMMERHEAD DRIVEWAYS AT EXISTING RESIDENCES, THE CITY ENGINEER MAY GRANT EXCEPTIONS TO THE STANDARDS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	HAMMERHEAD DRIVEWAY TYPE 5	GS-06
04/24/2026	STAFF		
		 FREDY A. BONILLA CITY ENGINEER	SHEET 2 OF 2

DRAWING INDEX

SS-01	SANITARY SEWER MANHOLE
SS-02	SANITARY SEWER 30" MANHOLE FRAME AND COVER
SS-03	SEWER LATERALS
SS-04	SEWER LATERAL - CLEANOUTS (2 SHEETS)
SS-05	PVC SEWER PIPE BEDDING (2 SHEETS)
SS-06	CLEAN-OUT FRAME AND COVER
SS-07	SANITARY SEWER DROP MANHOLE
SS-07A	SANITARY SEWER MANHOLE WITH INTERNAL SEWER MAIN DROP
SS-08	TEMPORARY SAND TRAP
SS-09	SANITARY SEWER SADDLE
SS-10	BLANK INTENTIONALLY

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	SANITARY SEWER IMPROVEMENT STANDARD DRAWINGS INDEX	SS-INDEX
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

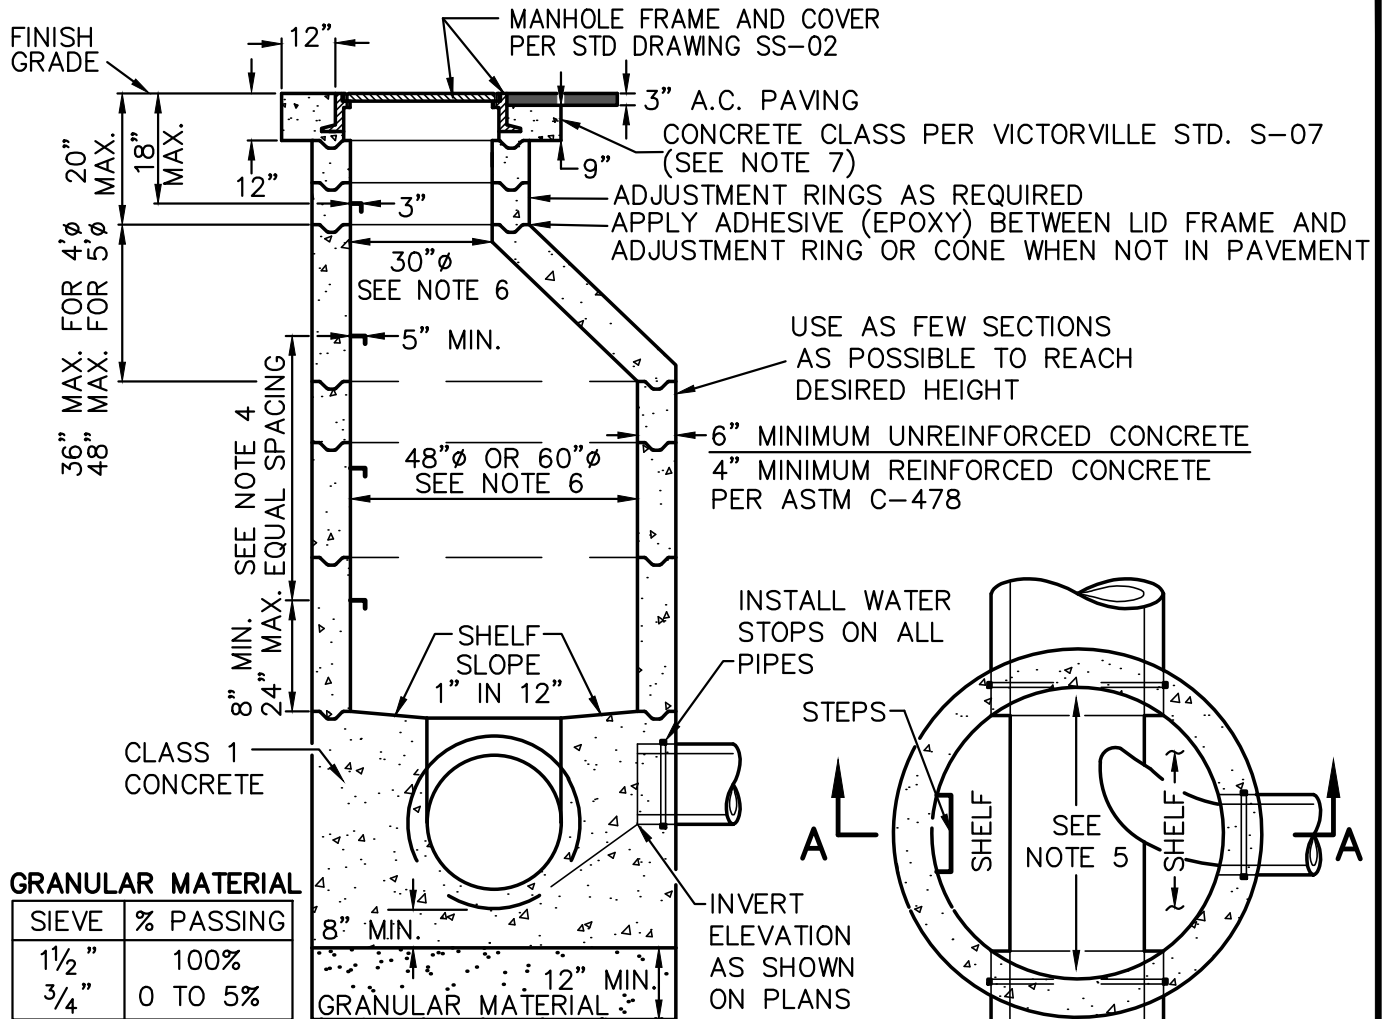

GRANULAR MATERIAL

SIEVE	% PASSING
1 1/2"	100%
3/4"	0 TO 5%

GRANULAR MATERIAL ALL
MANHOLES IF INVERT IS
WITHIN 8" OF GROUNDWATER

SECTION A-A NOT TO SCALE



PLAN NOT TO SCALE

NOTES:

1. ALL SECTIONS TO BE SET IN 1:3 MORTAR TRIMMED SMOOTH INSIDE.
2. CONCRETE FOR MANHOLE SECTIONS SHALL BE 3000 P.S.I. MINIMUM.
3. PROVIDE FLEXIBLE JOINT IN ALL SEWER PIPE OUTSIDE OF MANHOLE BUT WITHIN 12" OF CONCRETE BASE FOR VCP ONLY.
4. MANHOLE STEPS SHALL BE ALHAMBRA FOUNDRY A3320 OR EQUAL. INSTALL AT 12" MINIMUM TO 16" MAXIMUM EQUAL SPACINGS WITH TREAD WIDTH OF 14" MINIMUM.
5. FOR ALL PIPE SIZES THE TOP HALF OF THE PIPE SHALL BE REMOVED TO THE CONTOUR OF THE INSIDE OF THE MANHOLE AND THE BROKEN EDGES SHALL BE TROWELED SMOOTH WITH CEMENT MORTAR PROVIDING A MONOLITHIC BASE.
6. A 30" DIA. CLEAR OPENING, RING AND COVER, SHALL BE USED FOR ALL MANHOLES. A 60" SHAFT DIA. SHALL BE USED FOR MANHOLES WITH A) 18" DIA. OR LARGER, OR B) WHERE 2 OR MORE INLETS EXIST, OR C) WHERE MANHOLE SHAFT DEPTH IS 20' OR MORE IN DEPTH.
7. IN AREAS WHERE MANHOLE IS IN A DIRT EASEMENT, A MINIMUM 12" WIDE BY 12" DEEP PAD OR PRE-CAST FRAME AND LID WILL BE REQUIRED AROUND MANHOLE LID AND FRAME.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	SANITARY SEWER MANHOLE	SS-01
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

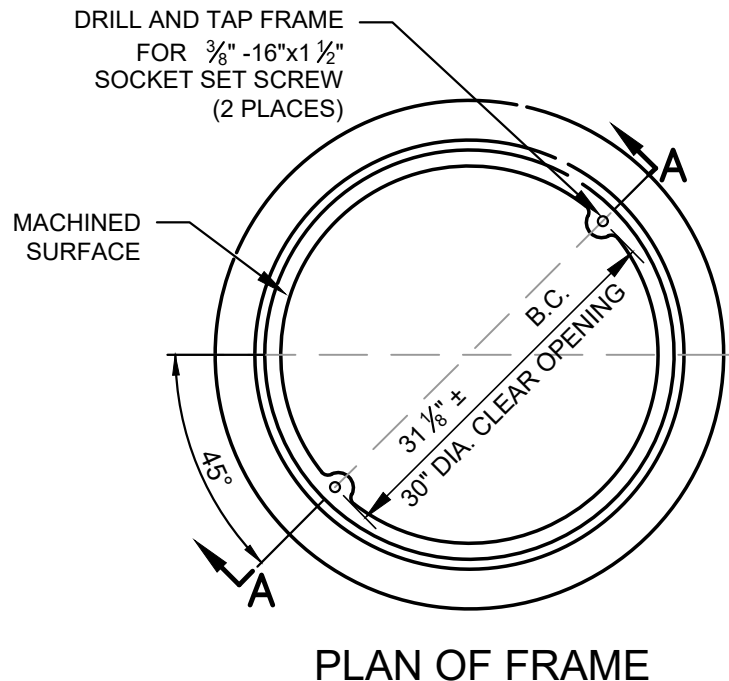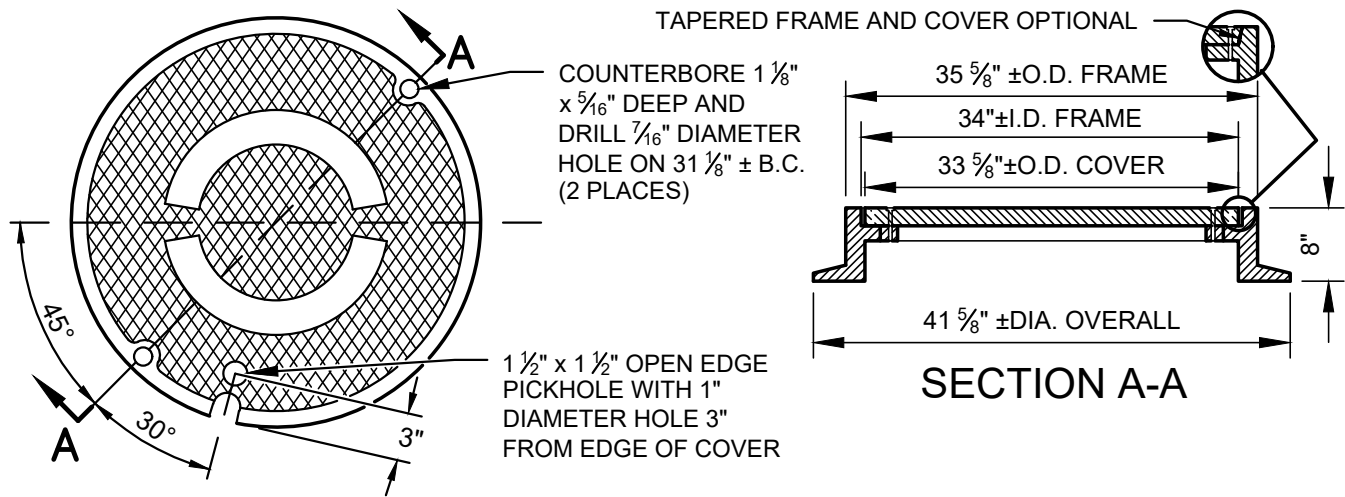

NOTES:

1. MANHOLE FRAME AND COVER TO BE MANUFACTURED FROM CLASS 35 CAST IRON PER ASTM A-48.
2. FRAME AND COVER SHALL BE CAPABLE OF SUPPORTING H-20 WHEEL LOADING.
3. COVER SHALL HAVE CAST INTO TOP IN $1"$ HIGH MINIMUM BLOCK LETTERS "VICTORVILLE" OR "CITY OF VICTORVILLE" AND "SEWER". MANUFACTURER'S NAME OR INSIGNIA SHALL BE CAST INTO BOTH FRAME AND COVER.
4. MACHINE MATING SURFACES OF FRAME AND COVER TO PROVIDE UNIFORM EDGE SUPPORT FOR COVER.
5. PAINT FRAME AND COVER WITH BLACK BITUMINOUS PAINT.
6. APPROVED SUPPLIERS: ALHAMBRA FOUNDRY, NEENAH FOUNDRY, SOUTH BAY FOUNDRY AND NATIONAL CASTING CORP.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	SANITARY SEWER	SS-02
4/24/2026	STAFF	30" MANHOLE FRAME AND COVER	
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

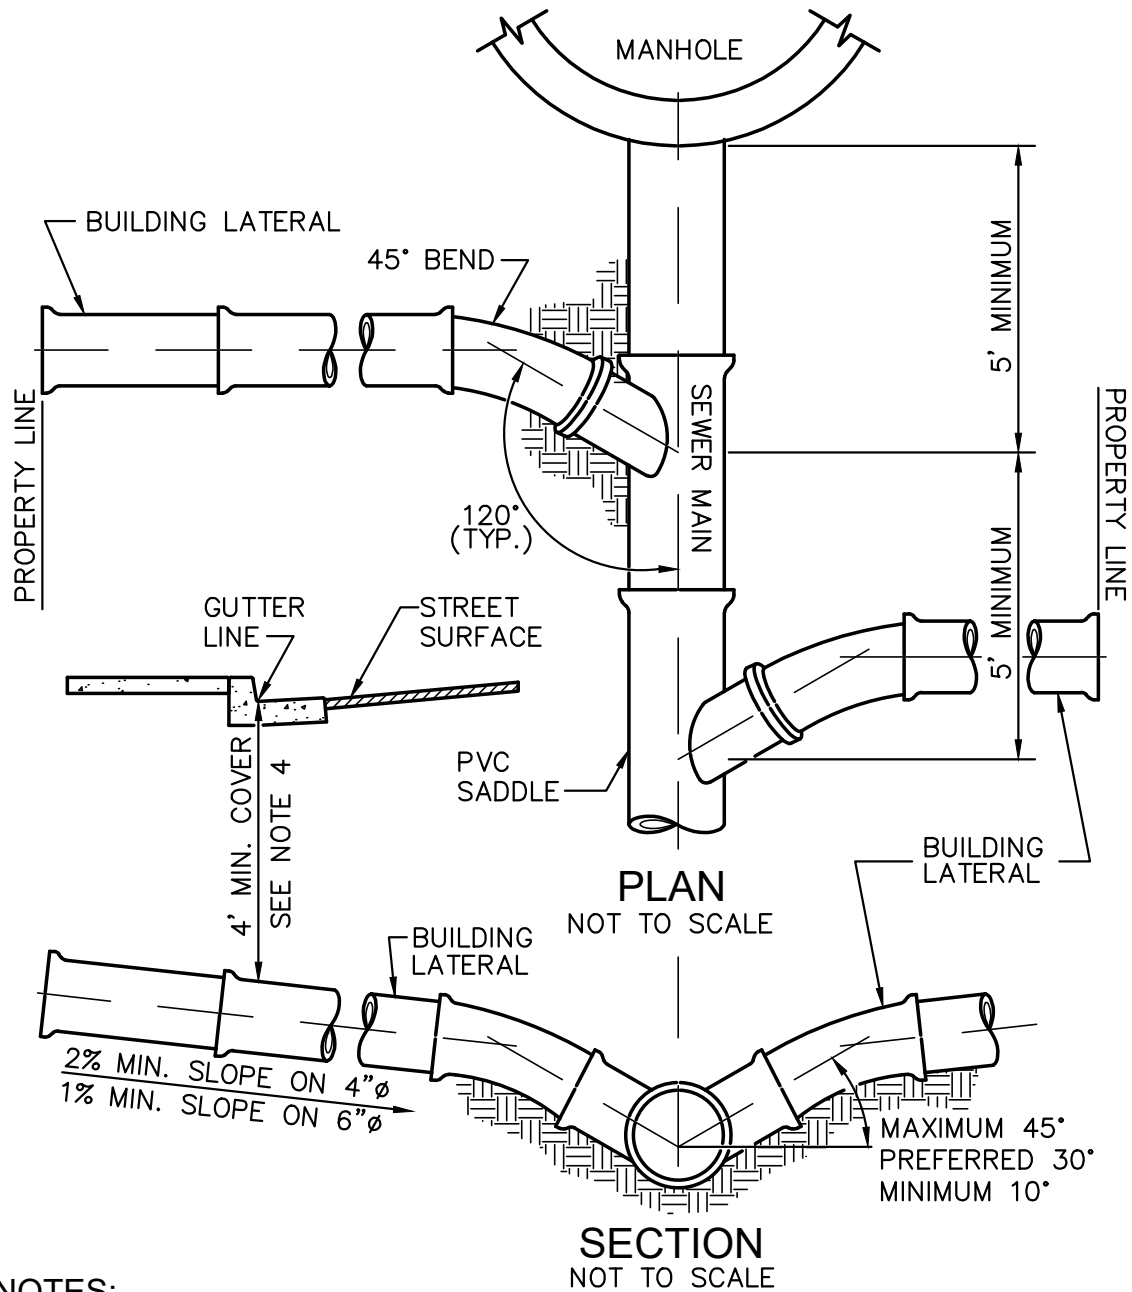


NOTES:

1. USE FACTORY MADE WYES, FITTINGS AND SEWER LATERAL PIPE OF THE SAME MATERIAL AS THE MAIN LINE SEWER FOR NEW INSTALLATIONS OR USE COMPATIBLE WYES AND FITTINGS TO JOIN LATERALS AND MAIN LINE SEWERS OF DIFFERENT MATERIALS.
2. SEWER LATERALS ON EXISTING MAIN LINE SEWER SHALL USE SEWER SADDLES PER CITY STANDARD DRAWING SS-09.
3. PIPE BEDDING FOR LATERALS SHALL CONFORM TO STANDARD DRAWING SS-05.
4. COVER MAY BE REDUCED TO 3' IF CONCRETE ENCASED OR SPECIAL PIPE APPROVED BY THE ENGINEER IS USED.
5. SEWER CLEANOUTS - CLEANOUT PIPE DIAMETER SHALL BE SAME SIZE AS SEWER LATERAL.
6. SEWER TAPS SHALL UTILIZE PVC SADDLES; NEOPRENE SADDLES SHALL NOT BE ACCEPTED.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SEWER LATERALS	SS-03
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

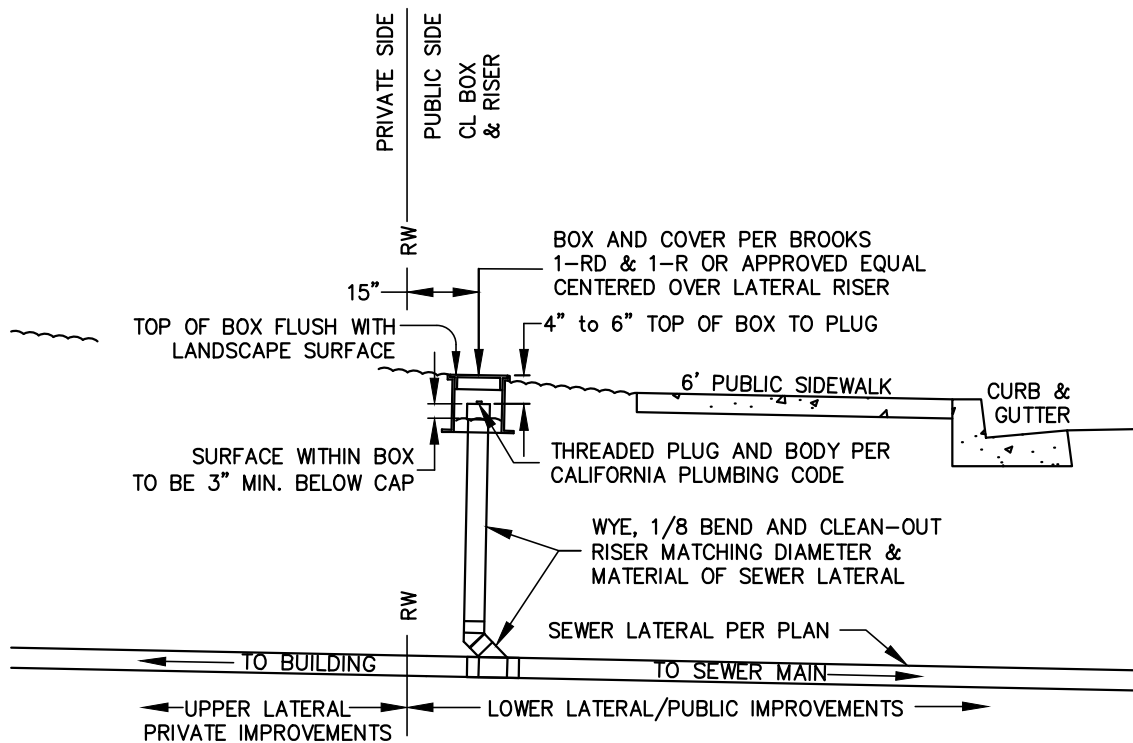

CASE 1

CLEAN-OUT WITHIN RIGHT-OF-WAY IN FRONT YARD LANDSCAPING

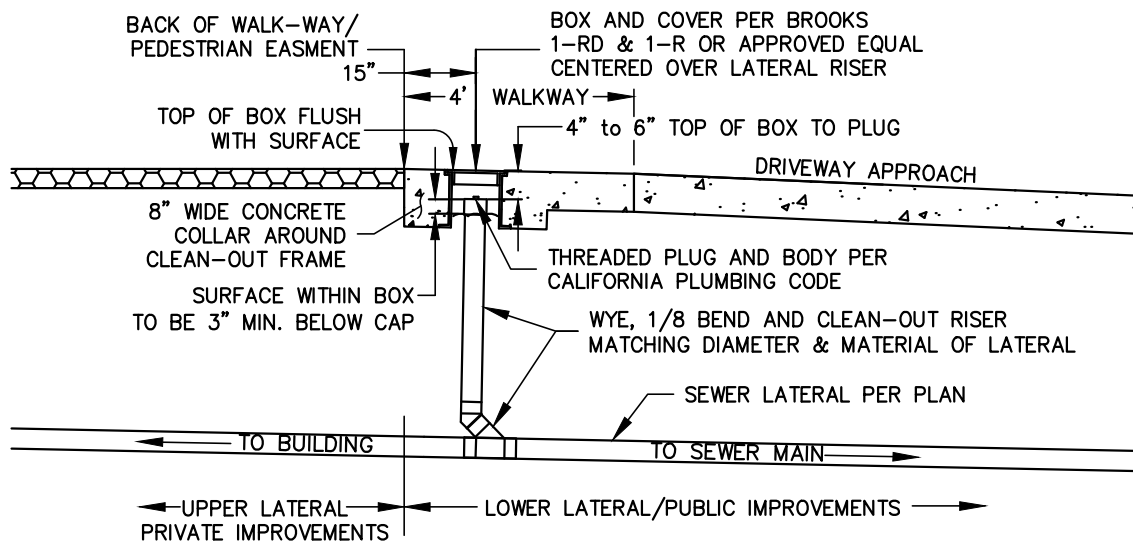


CASE 2


CLEAN-OUT WITHIN RIGHT-OF-WAY IN DRIVEWAY APPROACH

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SEWER LATERAL - CLEANOUTS	SS-04
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 2

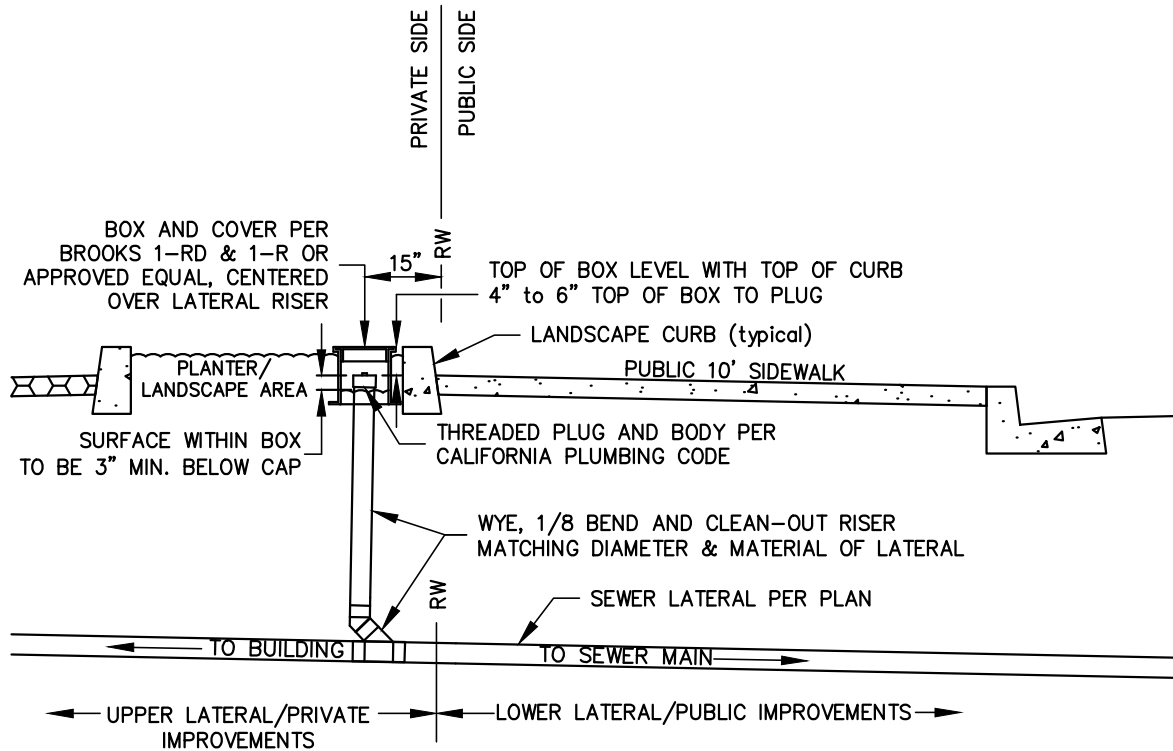


CASE 3
CLEAN-OUT WITHIN PRIVATE PROPERTY IN PLANTER

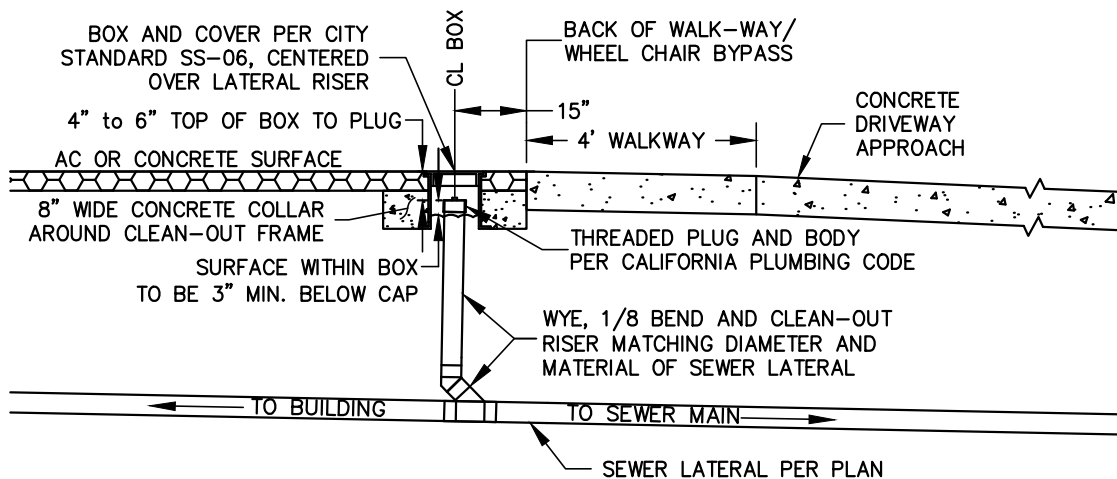

CASE 4
CLEAN-OUT WITHIN PRIVATE PROPERTY IN DRIVEWAY APPROACH

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SEWER LATERAL - CLEANOUTS	SS-04
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 2 OF 2

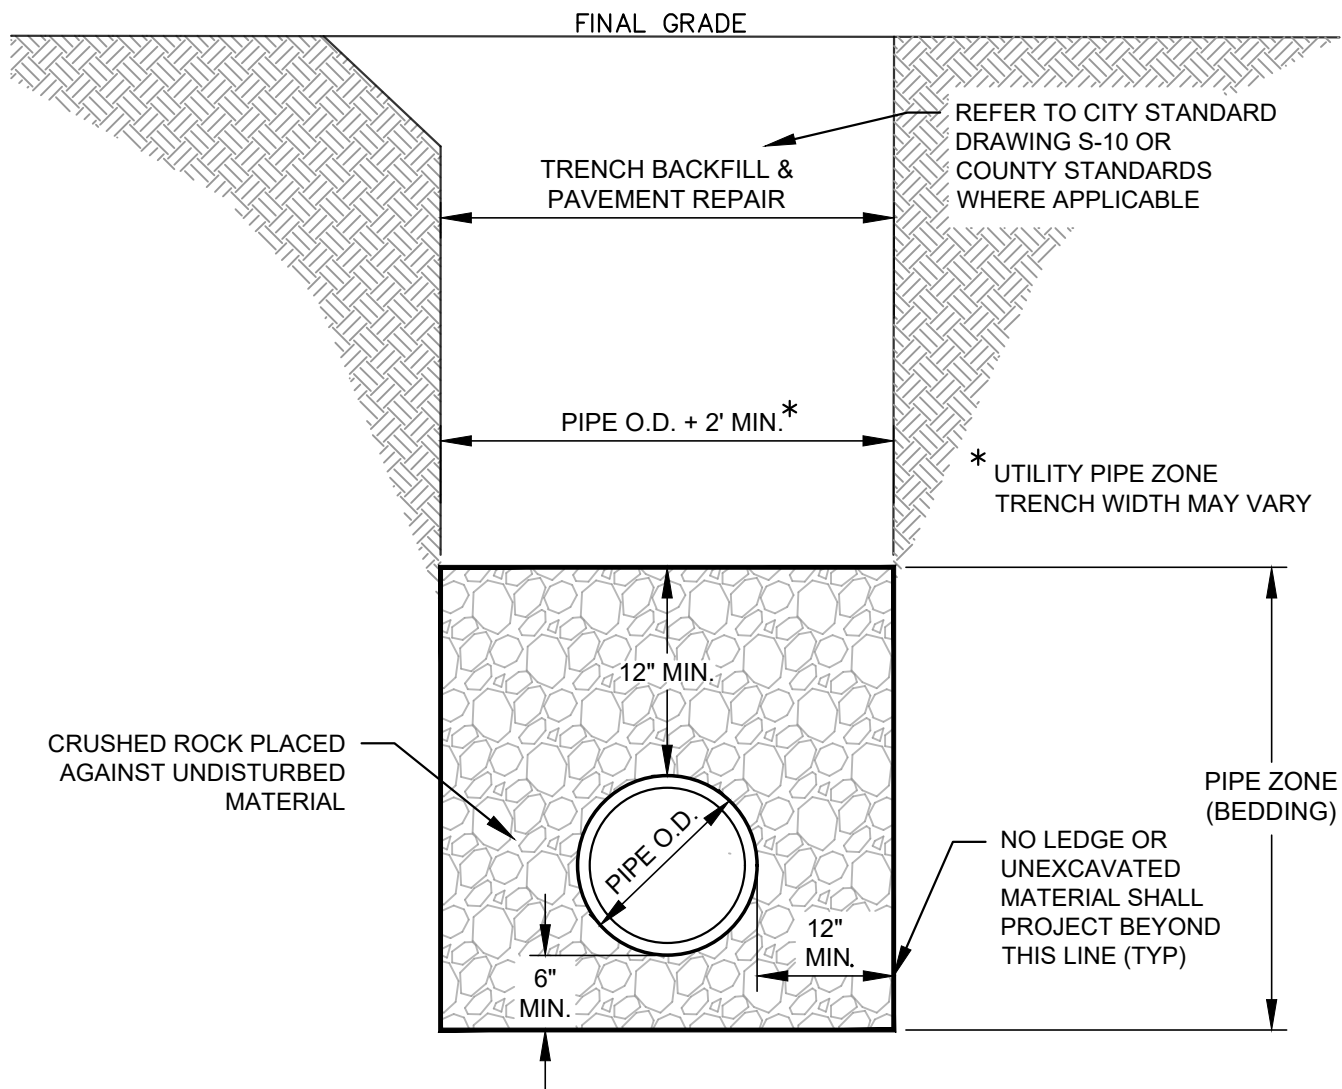


NOTES:

1. P.V.C. PIPE SHALL CONFORM TO THE REQUIREMENTS OF ASTM D-2680, D-3034 AND F-679 WITH AN SDR VALUE NOT MORE THAN 35 OR F-949.
2. BEDDING SHALL BE PLACED IN 6" LAYERS AND MECHANICALLY COMPACTED TO 12" ABOVE PIPE.
3. UNLESS NOTED OTHERWISE, TRENCH EXCAVATION AND BACKFILL SHALL BE PER SECTION 306-3 AND 306-6 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION AND CITY STANDARD DRAWING S-10.
4. THE CRUSHED ROCK BEDDING SHALL CONFORM TO THE REQUIREMENTS OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION 217.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	PVC SEWER PIPE BEDDING	SS-05
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 2

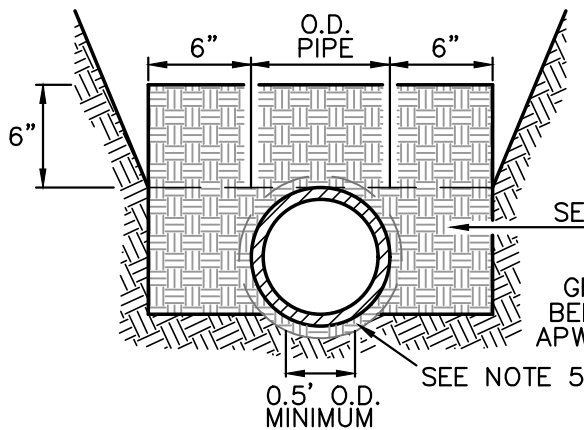


NORMAL BEDDING

LINEAR FEET = 1.5

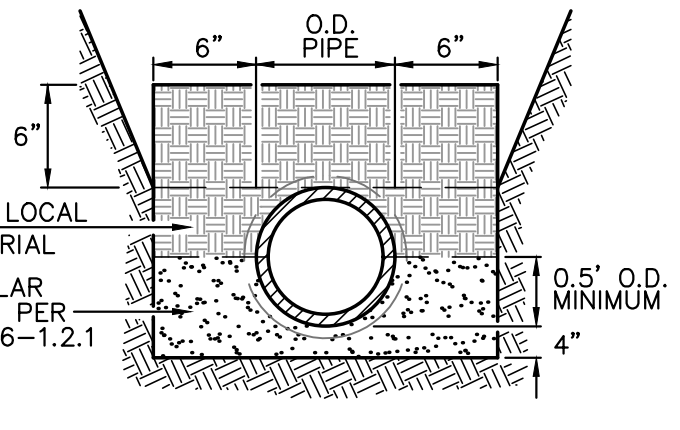


GRANULAR BEDDING

LINEAR FEET = 1.9

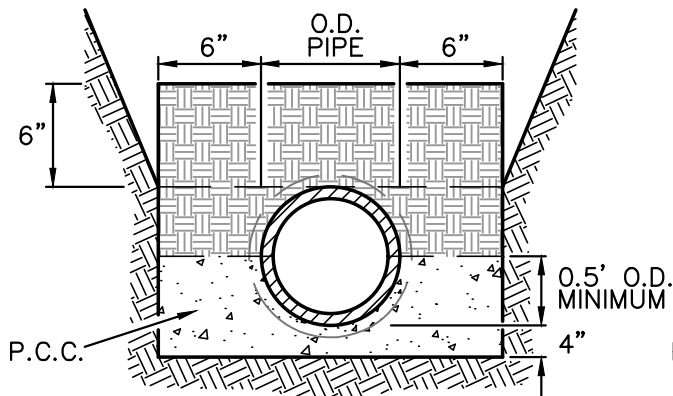

CONCRETE CRADLE

LINEAR FEET = 3.0

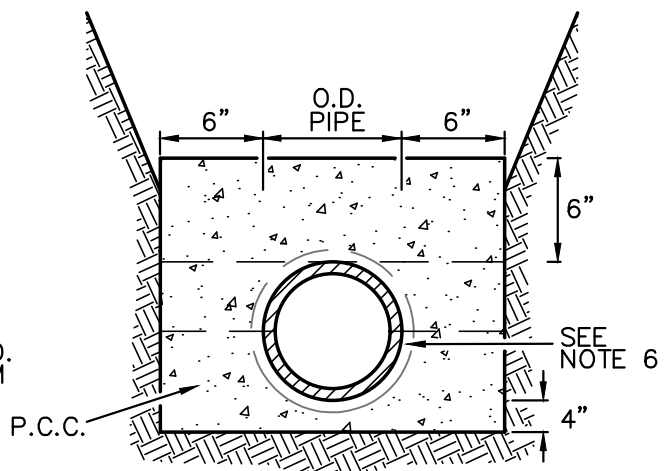

CONCRETE ENCASEMENT


LINEAR FEET = 4.5

NOTES:


1. WIDTH OF TRENCH AT TOP OF PIPE SHALL BE 21" MINIMUM.
2. CONCRETE SHALL BE MINOR CONCRETE PER SECTION 90 OF STANDARD SPECIFICATIONS.
3. BEDDING SHALL BE PLACED IN 6" LAYERS AND MECHANICALLY COMPACTED TO A HEIGHT OF 6" ABOVE THE TOP OF THE PIPE.
4. TRENCH EXCAVATION AND BACKFILL SHALL BE IN ACCORDANCE WITH SECTION 306.1 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION AND CITY STANDARD DRAWING S-10.
5. HAND SHAPED BOTTOM EITHER IN UNDISTURBED SOIL OR IN APPROVED GRANULAR MATERIAL AT LEAST 1" BELOW BELL OR COLLAR.
6. PLACE ONE LAYER OF 15# BUILDING PAPER AS BOND BREAKER AROUND PIPE AND COUPLINGS.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	PVC SEWER PIPE BEDDING	SS-05
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 2 OF 2

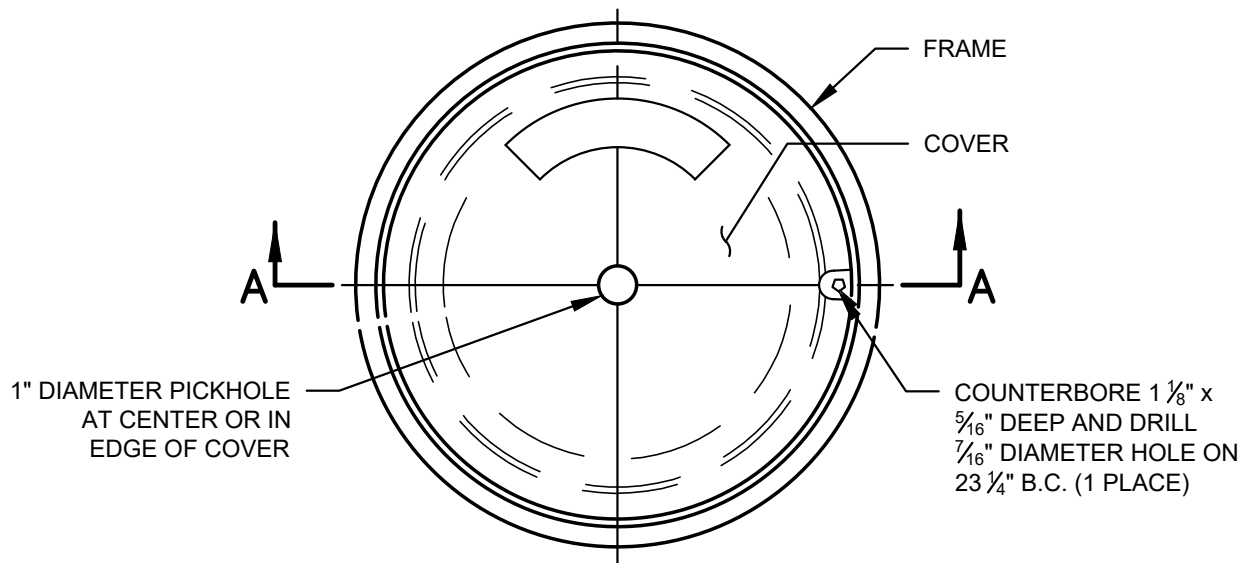

PLAN VIEW
NOT TO SCALE

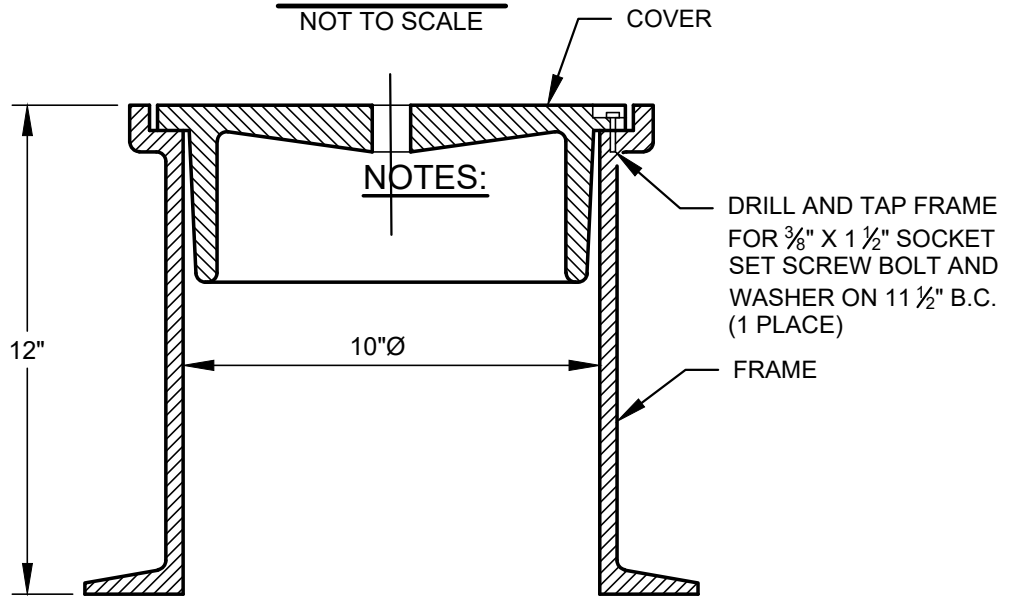


SECTION A-A
NOT TO SCALE

NOTES:

1. MANHOLE FRAME AND COVER TO BE MANUFACTURED FROM CLASS 35 CAST IRON PER ASTM A-48
2. FRAME AND COVER SHALL BE CAPABLE OF SUPPORTING H-20 WHEEL LOADING.
3. COVER SHALL HAVE CAST INTO TOP IN 1" HIGH MINIMUM BLOCK LETTERS "SEWER", MANUFACTURER'S NAME OR INSIGNIA SHALL BE CAST INTO BOTH FRAME AND COVER.
4. PAINT FRAME AND COVER WITH BLACK BITUMINOUS PAINT.
5. APPROVED SUPPLIERS: ALHAMBRA FOUNDRY A-1240.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	CLEAN-OUT FRAME AND COVER	SS-06
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

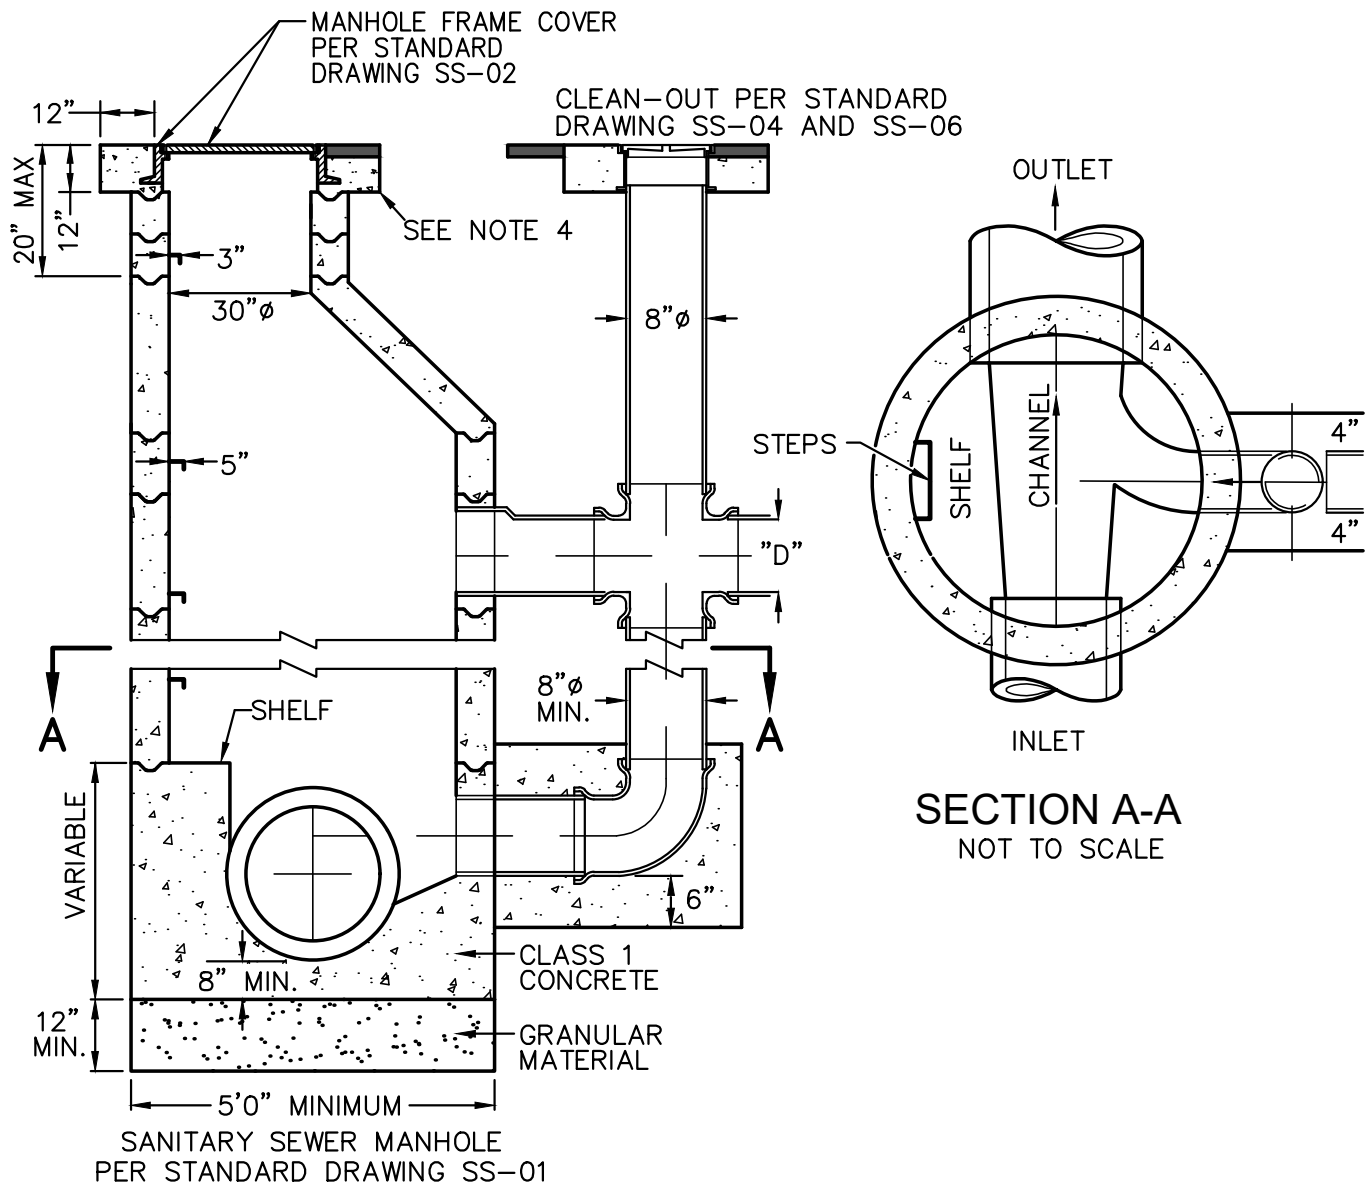


NOTES:

1. WHEN PIPE IS LAID THROUGH THE MANHOLE, THE TOP HALF OF THE PIPE SHALL BE REMOVED TO THE CONTOUR OF THE INSIDE OF THE MANHOLE AND THE BROKEN EDGE SHALL BE PLASTERED SMOOTH WITH CEMENT MORTAR.
2. CONCRETE SHALL BE CLASS 1 PER SECTION 90 OF STANDARD SPECIFICATIONS.
3. PROVIDE FLEXIBLE JOINT IN MANHOLE WALL OR WITHIN 2'0" OF OUTSIDE FACE FOR VCP ONLY.
4. IN AREAS WHERE MANHOLE IS IN A DIRT EASEMENT, A MINIMUM 12" WIDE BY 12" DEEP PAD OR PRE-CAST FRAME AND LID WILL BE REQUIRED AROUND MANHOLE LID AND FRAME.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	SANITARY SEWER DROP MANHOLE	SS-07
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

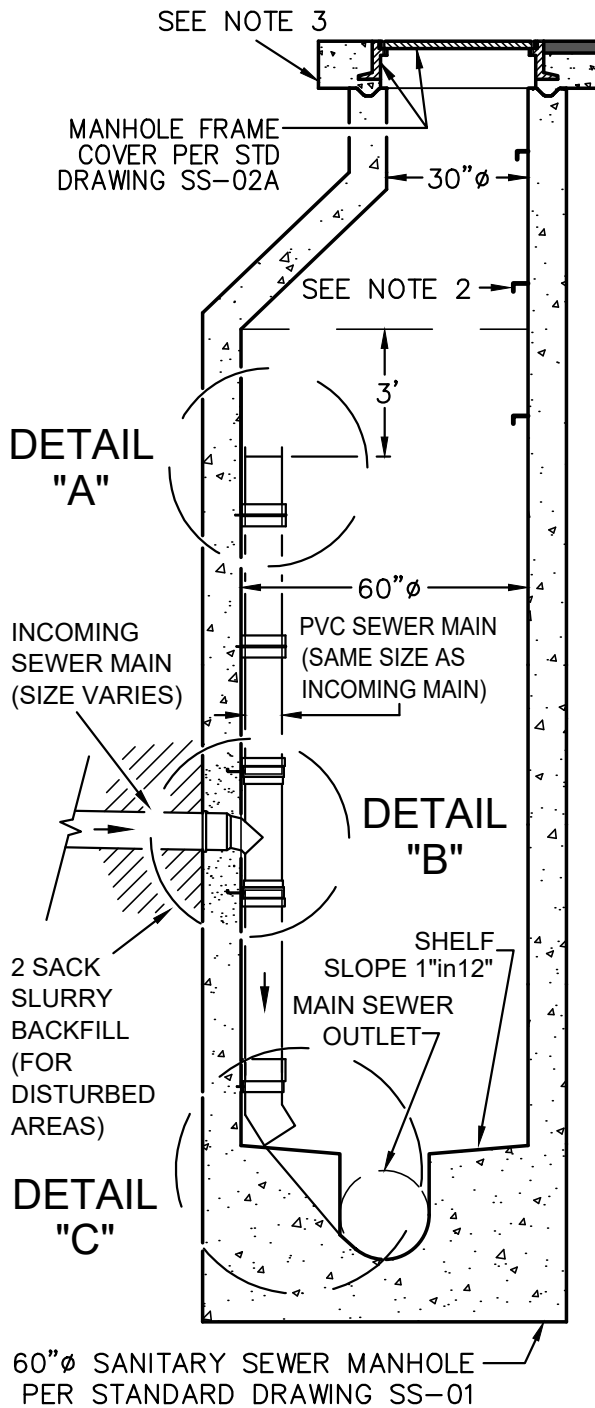



SECTIONAL VIEW
NOT TO SCALE

NOTES:

1. CORE THROUGH MANHOLE WALL AND RECONSTRUCT WITH WATERPROOF GROUT.
2. DROP PIPE SHALL NOT CONFLICT WITH STEPS.
3. IN AREAS WHERE MANHOLE IS IN A DIRT EASEMENT, A MINIMUM 12" WIDE BY 12" DEEP PAD OR PRE-CAST FRAME AND LID WILL BE REQUIRED AROUND MANHOLE LID AND FRAME.

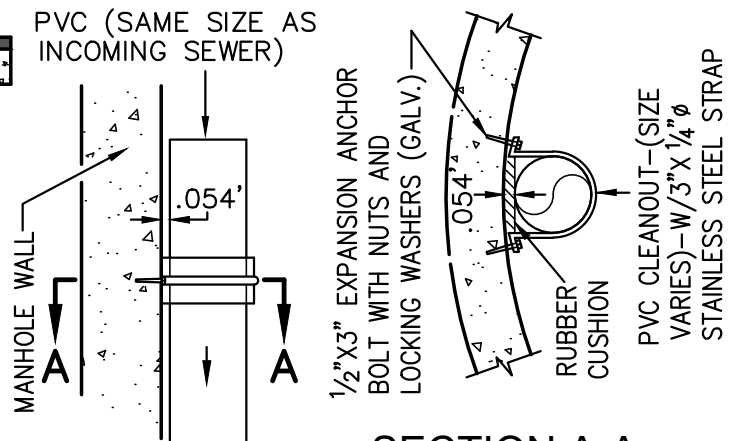


SECTION A-A

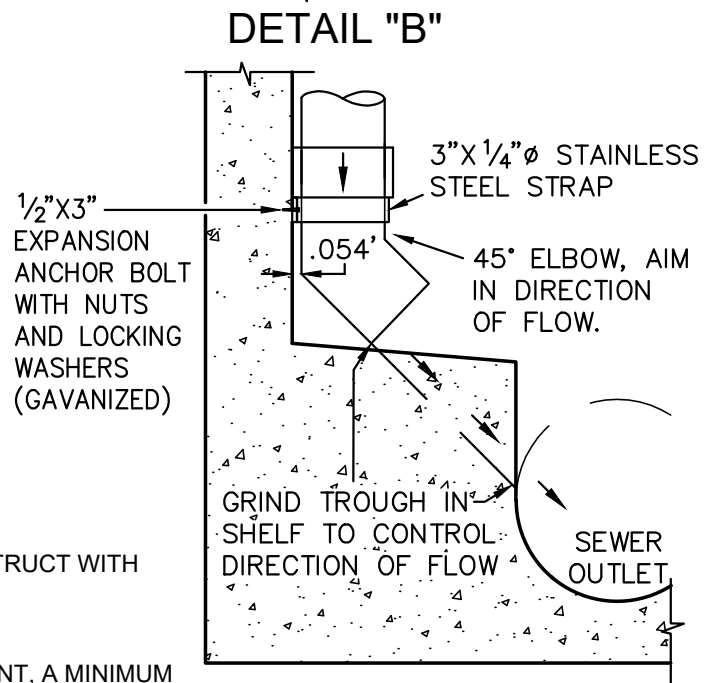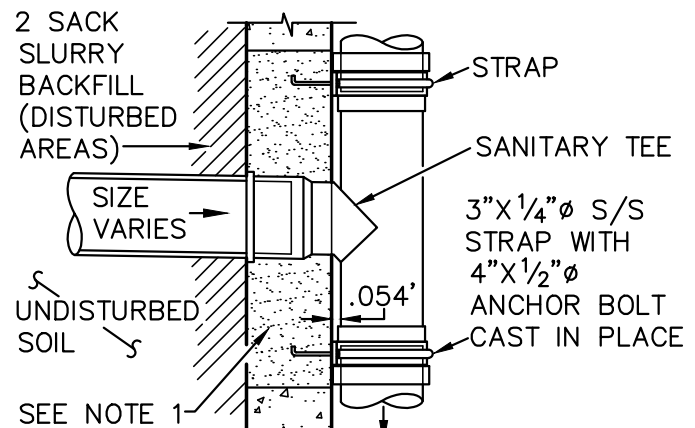


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SANITARY SEWER MANHOLE WITH INTERNAL SEWER MAIN DROP	SS-07A
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

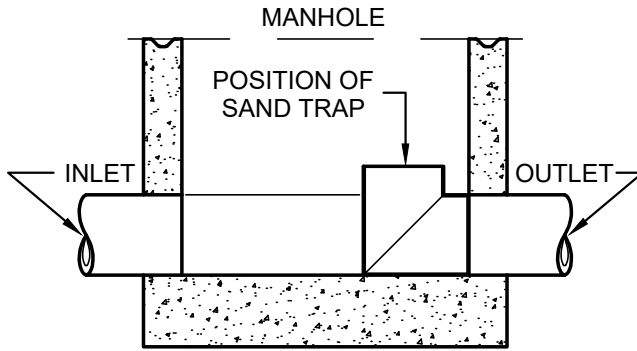


SECTIONAL VIEW OF
MANHOLE WITH LOCATION
OF SAND TRAP

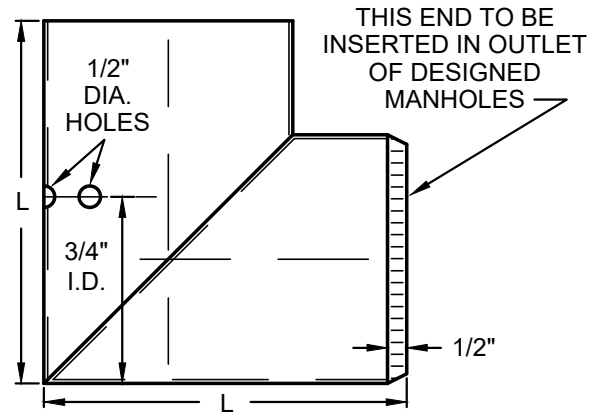


SIDE VIEW

DIMENSIONS OF TRAP

I.D.	LENGTH
8"	10-1/2"
10"	12-1/2"
12"	16"
15"	18"
18"	19"

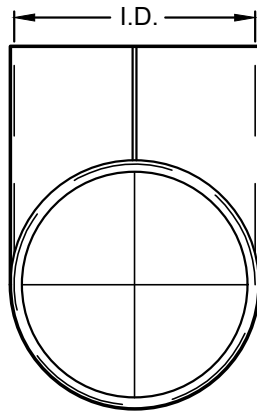

END VIEW

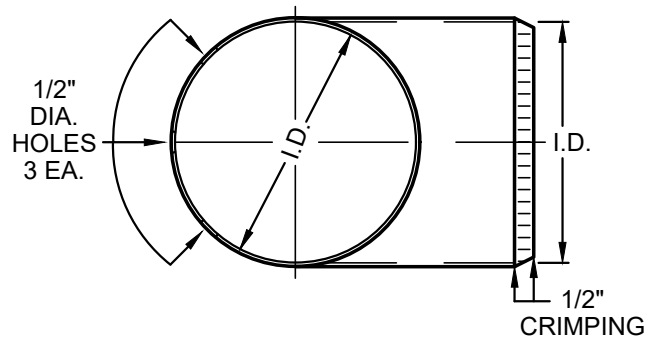


TOP VIEW

NOTES:

1. ALL SEAMS TO BE INTERLOCKING SEAMS AND SHALL BE SOLDERED.
2. TRAP TO BE CONSTRUCTED OF 20 GAUGE GALVANIZED SHEET METAL.
3. PLACE TRAPS IN ALL MANHOLES IN WORK AREA AND ONE IN MANHOLE BELOW WORK AREA BEFORE COMMENCING WORK.
4. CLEAN ALL MANHOLES AND REMOVE TRAPS AFTER COMPLETION OF WORK.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV.	DATE	BY	TEMPORARY SAND TRAP	SS-08
	4/24/2026	STAFF		
		<i>FAB</i>	FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

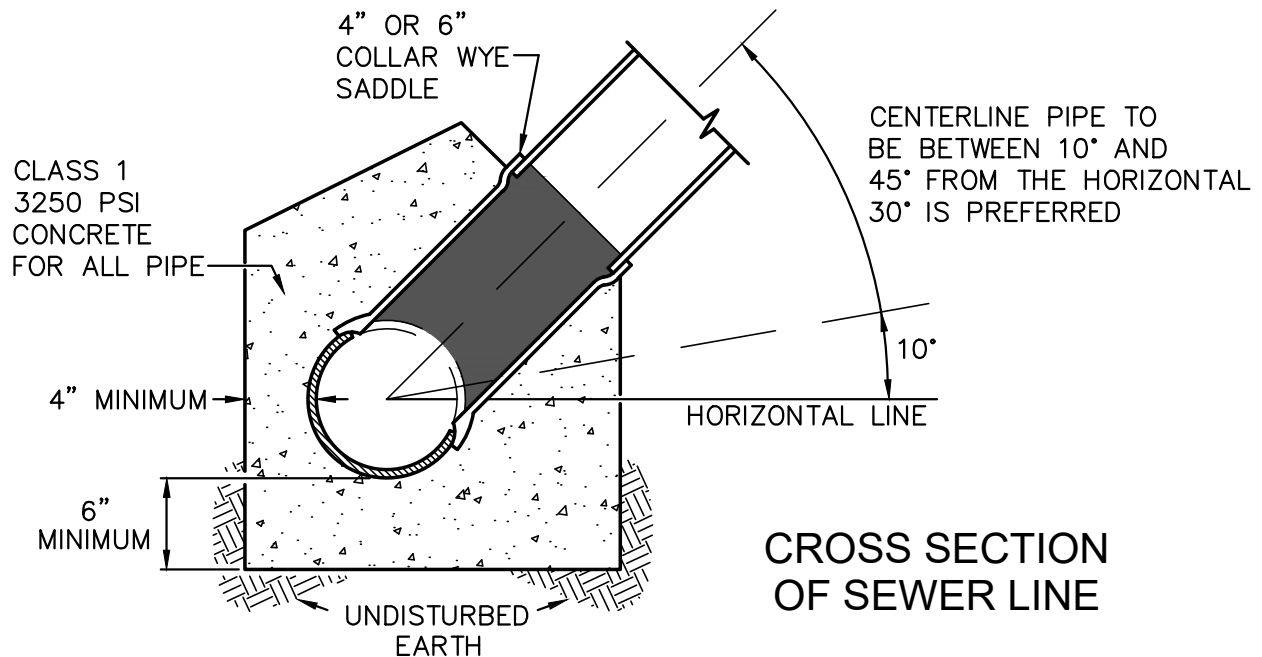

NOTES:

ALL PIPE

1. CALL FOR INSPECTION 2 WORKING DAYS IN ADVANCE OF CUTTING THE PIPE. INSPECTOR MUST BE PRESENT TO OVERSEE THE CUTTING AND SADDLING OPERATION.
2. IF PIPE IS CRACKED, BROKEN OR DAMAGED IN ANY WAY IT SHALL BE REPLACED.
3. MAKE NORMAL SIZE OPENING FOR SADDLE IN MAIN LINE SEWER PIPE 12" MINIMUM CLEAR OF THE BELL. ON CLAY PIPE SAWCUT ON CENTER OPENING AND USE NIPPERS TO ENLARGE OPENING TO SIZE. ON P.V.C. PIPE USE KEY HOLE SAW.
4. REPAIR STREET PER CITY STANDARD DRAWING S-10.

CLAY PIPE

5. WIRE SADDLE IN PLACE WITH 12 GAUGE GALVANIZED STEEL WIRE. USE SILICONE CAULK TO SEAL SADDLE TO PIPE. SADDLE MUST NOT PROTRUDE INTO THE MAIN LINE.
6. PLACE CLASS 1, 3250 PSI, CONCRETE AROUND MAIN LINE AND SADDLE AND 18" ALONG THE MAIN LINE PIPE PER THE CROSS SECTION ABOVE.
7. CURE CONCRETE BY COVERING WITH 12" OF WET EARTH. DO NOT BACKFILL UNTIL THE CONCRETE IS CURED SUFFICIENTLY TO WITHSTAND THE BACKFILL OPERATION.

P.V.C. PIPE

8. USE STANDARD MANUFACTURED SADDLES RECOMMENDED BY THE MAIN LINE PIPE MANUFACTURER BEING SADDLED. ALL SADDLES SHALL HAVE ELASTOMERIC SEALS AND SHALL BE INSTALLED PER THE MANUFACTURER'S RECOMMENDATIONS.
9. SADDLES SHALL BE BANDED TO THE MAIN LINE SEWER WITH A MINIMUM OF 2 EACH 1/2" WIDE STAINLESS STEEL BAND CLAMPS.
10. REPLACE PIPE BEDDING PER CITY STANDARD DRAWING SS-5 AND BACKFILL.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SANITARY SEWER SADDLE	SS-09
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	SS-10
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

DRAWING INDEX

W-01	TYPICAL SERVICE INSTALLATION FOR 3/4" AND 1" METERS
W-02	BLANK INTENTIONALLY
W-03	TYPICAL SERVICE INSTALLATION FOR 1-1/2" AND 2" METERS
W-04	3" DOMESTIC SERVICE (2 SHEETS)
W-05	4" DOMESTIC SERVICE (2 SHEETS)
W-06	6" DOMESTIC SERVICE IN VAULT (2 SHEETS)
W-07	BLANK INTENTIONALLY
W-08	BLANK INTENTIONALLY
W-09	BLANK INTENTIONALLY
W-10	METER BOX PLACEMENT
W-11	STANDARD FIRE HYDRANT
W-12	BLOW-OFF FIRE HYDRANT
W-13	TYPICAL FIRE HYDRANT PAVEMENT MARKER INSTALLATION
W-14	PHASE BREAK END
W-15	TEMPORARY BLOW-OFF ASSEMBLY, 2"
W-16	4" BLOW-OFF ASSEMBLY
W-17	6" BLOW-OFF ASSEMBLY
W-18	VALVE CAN ASSEMBLY
W-19	VALVE OPERATOR EXTENSION
W-20	TYPICAL BUTTERFLY VALVE OPERATOR LOCATIONS
W-21	HOT TAP DETAIL - AC, PVC, DIP
W-22	TAPPING OUTLET - FOR STEEL PIPE
W-23	WELDED STEEL PIPE BUTT-JOINT WITH HANDHOLE
W-24	STANDARD 1" AIR AND VACUUM RELEASE VALVE ASSEMBLY
W-25	STANDARD 2" AIR AND VACUUM RELEASE VALVE ASSEMBLY
W-26	STANDARD 4" AIR AND VACUUM RELEASE VALVE ASSEMBLY
W-27	AIR & VACUUM VALVE ENCLOSURE
W-28	FIRE SERVICE - REDUCED PRESSURE DETECTOR ASSEMBLY (2 SHEETS)
W-29	BLANK INTENTIONALLY
W-30	3" AND LARGER - REDUCED PRESSURE BACKFLOW DEVICE INSTALLATION (2 SHEETS)
W-31	LMAD BACKFLOW DEVICE INSTALLATION (2 SHEETS)
W-32	BLANK INTENTIONALLY
W-33	VAULT AND LID
W-34	SEPARATION CRITERIA FOR EXISTING WATER MAINS FROM NEW SANITARY SEWERS OR STORM DRAINS
W-35	SEPARATION CRITERIA FOR NEW WATER MAINS FROM EXISTING SANITARY SEWERS OR STORM DRAINS
W-36	TYPICAL TRENCH / PIPE ZONE BACKFILL SCHEMATIC
W-37	WATER MAINS UNDERCROSSING SEWER AND STORM DRAIN - CML&C STEEL PIPE
W-38	WATER MAINS UNDERCROSSING SEWER AND STORM DRAIN - STEEL SLEEVE CASING
W-39	2" AND SMALLER - REDUCED PRESSURE BACKFLOW DEVICE INSTALLATION
W-40	MINIMUM PROTECTION FOR FILLING WATER TRUCKS
W-41	CUTTING AND PLUGGING ABANDONED WATER MAINS
W-42	GUARD POST


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	WATER IMPROVEMENT STANDARD DRAWINGS INDEX	W-INDEX
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

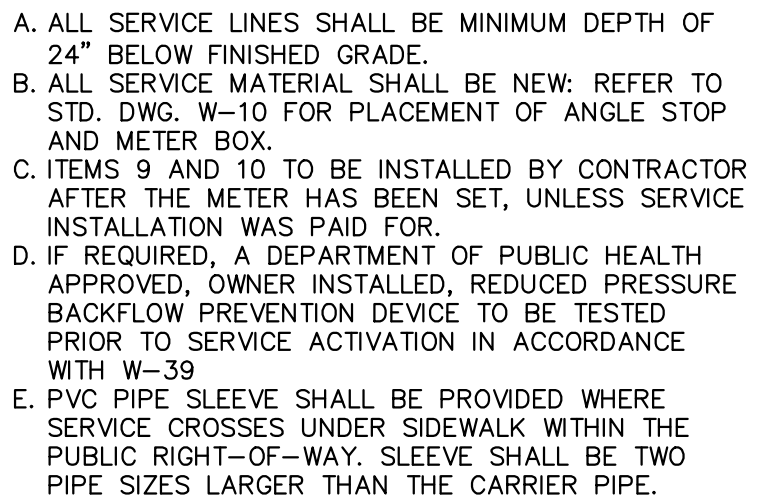SHEET 1 OF 1



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	W-02
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

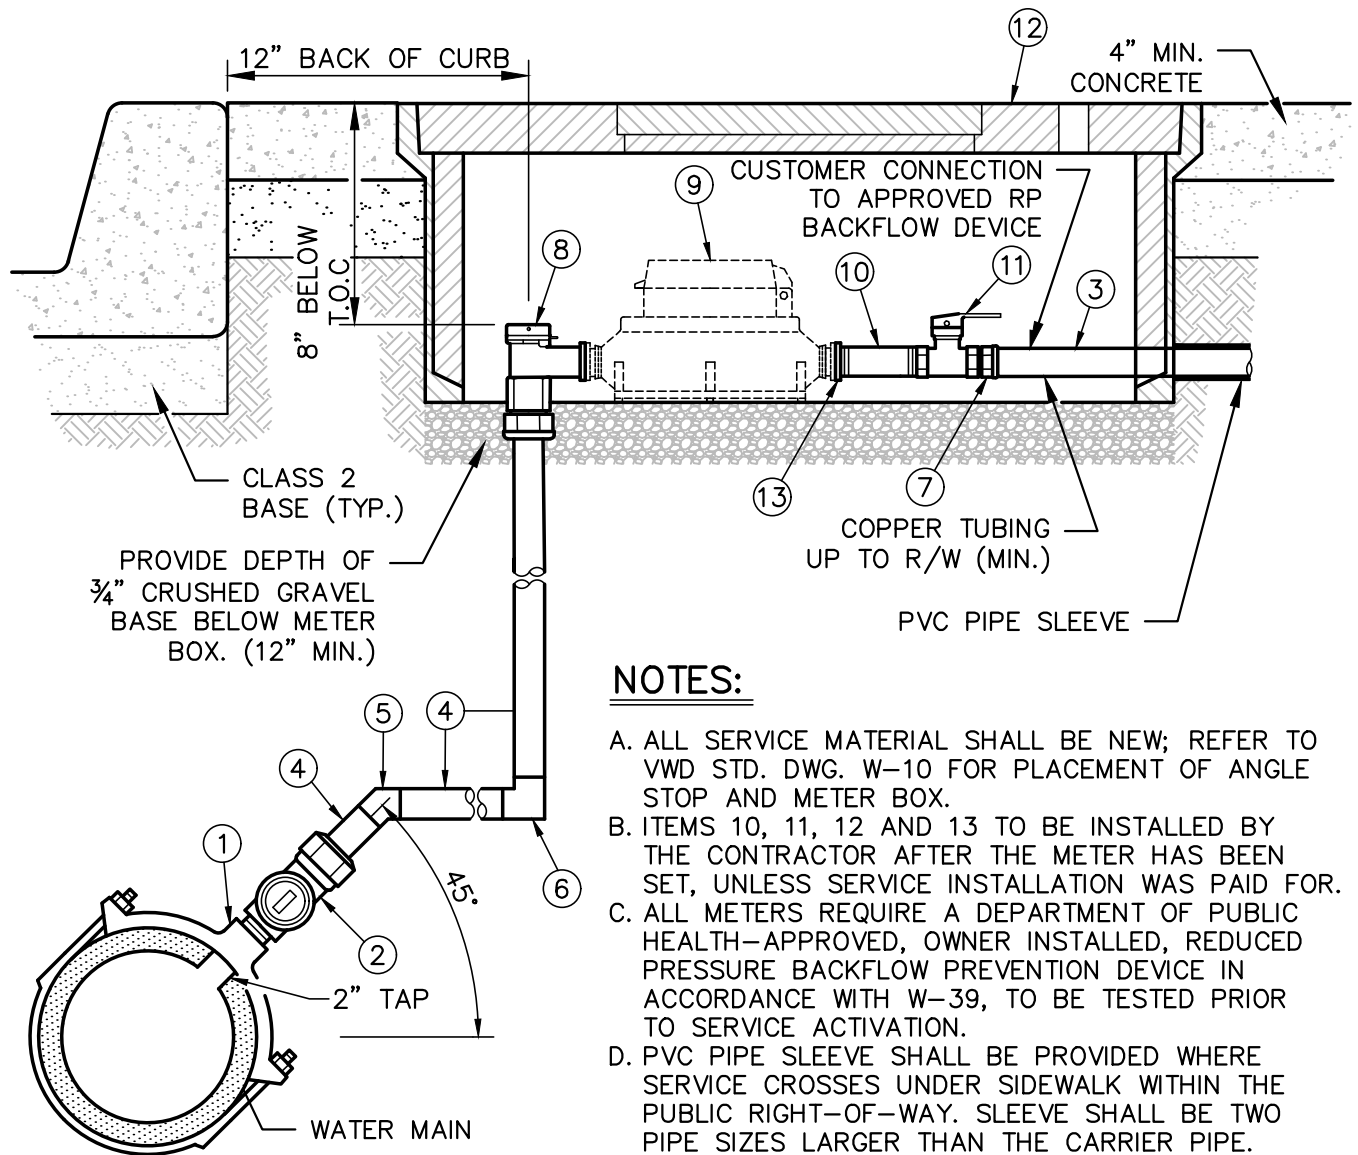


NOTES:

- ALL SERVICE MATERIAL SHALL BE NEW; REFER TO VWD STD. DWG. W-10 FOR PLACEMENT OF ANGLE STOP AND METER BOX.
- ITEMS 10, 11, 12 AND 13 TO BE INSTALLED BY THE CONTRACTOR AFTER THE METER HAS BEEN SET, UNLESS SERVICE INSTALLATION WAS PAID FOR.
- ALL METERS REQUIRE A DEPARTMENT OF PUBLIC HEALTH-APPROVED, OWNER INSTALLED, REDUCED PRESSURE BACKFLOW PREVENTION DEVICE IN ACCORDANCE WITH W-39, TO BE TESTED PRIOR TO SERVICE ACTIVATION.
- PVC PIPE SLEEVE SHALL BE PROVIDED WHERE SERVICE CROSSES UNDER SIDEWALK WITHIN THE PUBLIC RIGHT-OF-WAY. SLEEVE SHALL BE TWO PIPE SIZES LARGER THAN THE CARRIER PIPE.

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	"MAIN SIZE" x 2" SERVICE SADDLE	7-B
2	2" CORP. STOP (MIP x COMPRESSION)	2-D
3	1 1/2" OR 2" COPPER TUBING PER RESPECTIVE METER SIZE	1-D
4	2" SERVICE LATERAL (LENGTH VARIES)	1-D
5	2" - 45° FITTING (SOLDER)	6-D
6	2" - 90° ELBOW (SOLDER)	6-D
7	1 1/2" SERVICE FITTING (MIP x C110) OR 2" SERVICE FITTING (MIP x C110)	6-D
8	2" ANGLE METER STOP (COMPRESSION x FLG)	2-F
9	METER (FURNISHED AND INSTALLED BY VWD)	13-C
10	1 1/2" OR 2" NIPPLE PER RESPECTIVE METER SIZE, 4" LENGTH	6-D
11	1 1/2" OR 2" BALL VALVE PER RESPECTIVE METER SIZE	2-I
12	METER BOX SIZE (17"W x 30"L x 12"D)	9-E
13	1 1/2" OR 2" FLANGE ADAPTOR (FLG x FIP) PER RESPECTIVE METER SIZE	6-D

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	TYPICAL SERVICE INSTALLATION FOR 1 1/2" AND 2" METERS	W-03
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

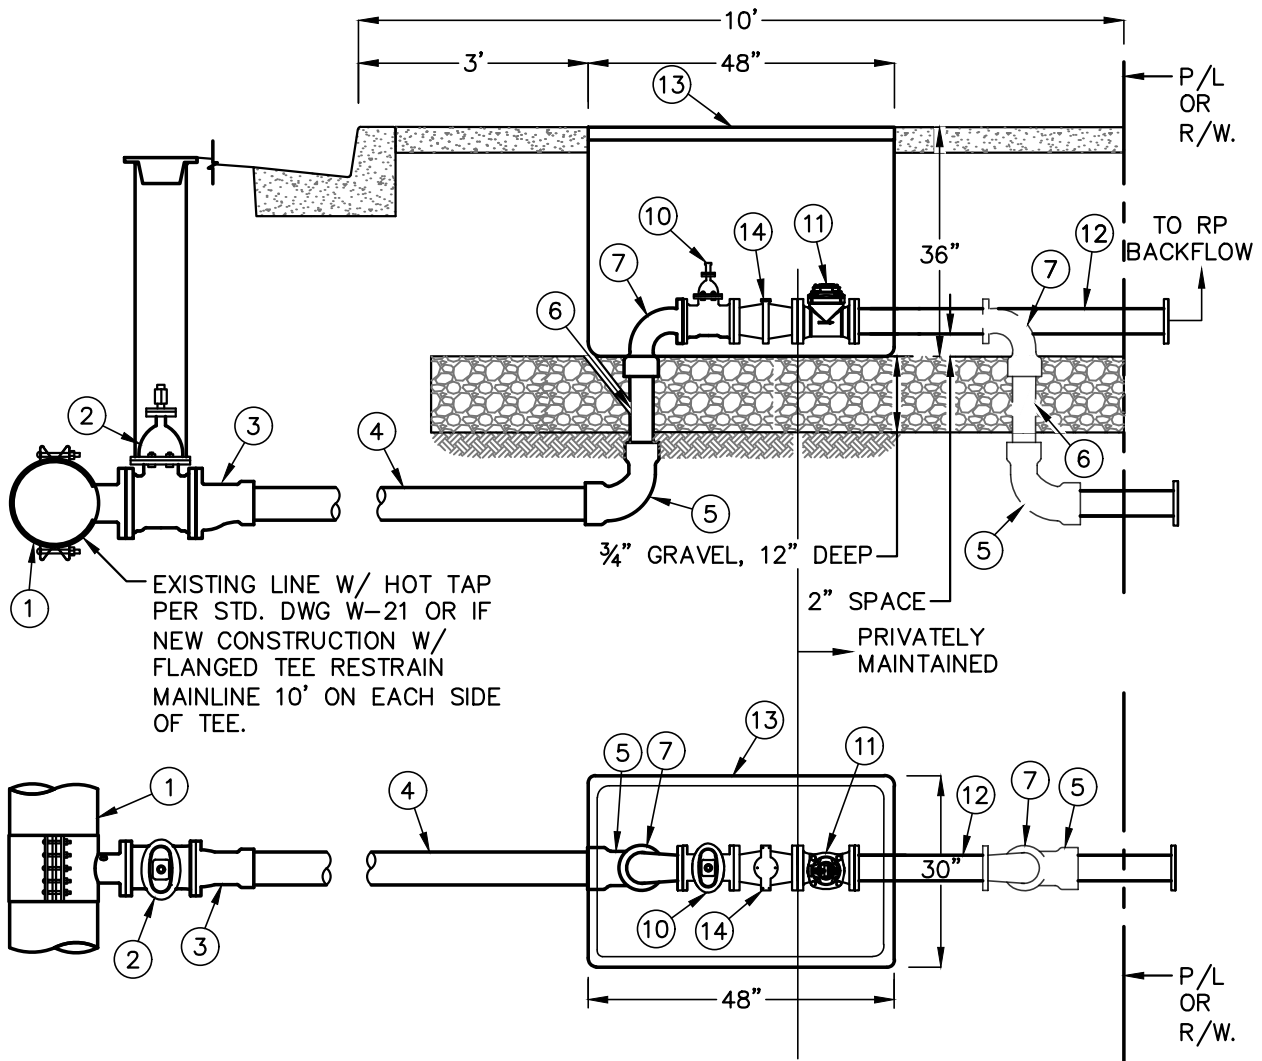


NOTES:

- A. **ALL JOINTS TO BE RESTRAINED.** (SEE ITEM 5 OF APPROVED MATERIALS LIST)
- B. SEE SHEET 2 OF 2 FOR CONSTRUCTION NOTES. (#)


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	3" DOMESTIC SERVICE	W-04
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 2

STANDARD ORIENTATION

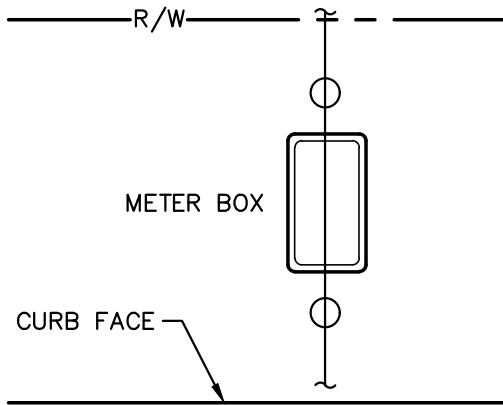

OPTIONAL ORIENTATION (IF APP'D BY INSPECTOR)

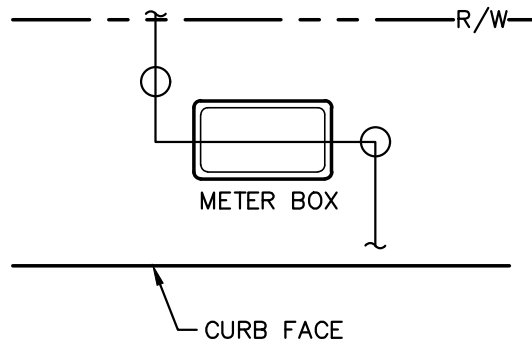

CONSTRUCTION NOTES


ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	6" TAPPING SLEEVE	7-A
2	6" GATE VALVE (FL x FL) W/ VALVE CAN ASSEMBLY	2-B
3	6" x 4" ECCENTRIC REDUCER (FL X MJ), INSTALL WITH TOP LEVEL	6-C
4	4" DIP PIPE	1-C
5	4" - 3" REDUCING 90° BEND (MJ)	6-C
6	3" PE SPOOL, CUT TO FIT	6-E
7	3" 90° BEND (MJ x FL) GRIP RING PACK	6-C
8	NOT REQUIRED	
9	NOT REQUIRED	
10	3" FL x FL GATE VALVE W/ OPERATING NUT	2-B
11	3" OCTAVE METER	13-C
12	3" FL SPOOL	6-E
13	#8 METER BOX LID + COVER.	9-E
14	3" STRAINER	13-L

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	3" DOMESTIC SERVICE	W-04
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 2 OF 2

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	4" DOMESTIC SERVICE	W-05
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 2

STANDARD ORIENTATION

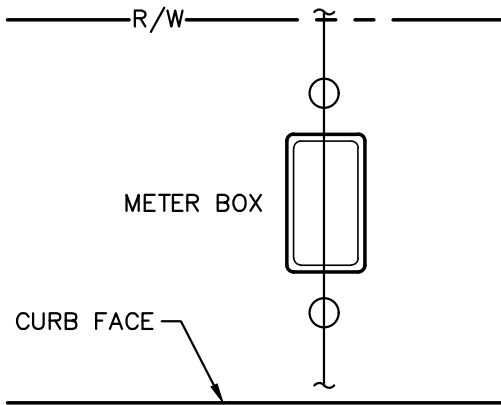

OPTIONAL ORIENTATION (IF APP'D BY INSPECTOR)


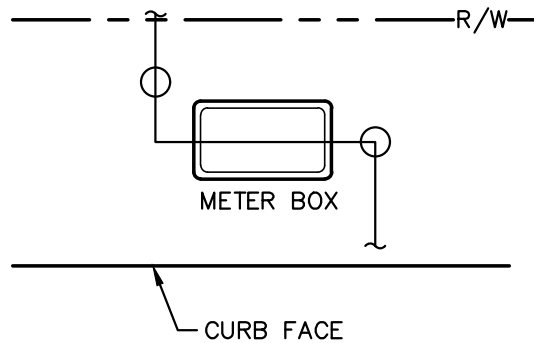


CONSTRUCTION NOTES

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	6" TAPPING SLEEVE	7-A
2	6" GATE VALVE (FL x FL) W/ VALVE CAN ASSEMBLY	2-B
3	6" x 4" ECCENTRIC REDUCER (INSTALL WITH TOP LEVEL)	6-C
4	4" DIP PIPE	1-C
5	4" MJ x MJ 90° BEND	6-C
6	4" 90° BEND (MJ x FL) GRIP RING PACK	6-C
7	4" FL x FL GATE VALVE W/ OPERATING NUT	2-B
8	NOT REQUIRED	
9	#8 METER BOX LID & COVER	9-E
10	4" x 13" FL x FL SPOOL	6-E
11	4" FL SPOOL	6-E
12	4" STRAINER	13-L

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	4" DOMESTIC SERVICE	W-05
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 2 OF 2

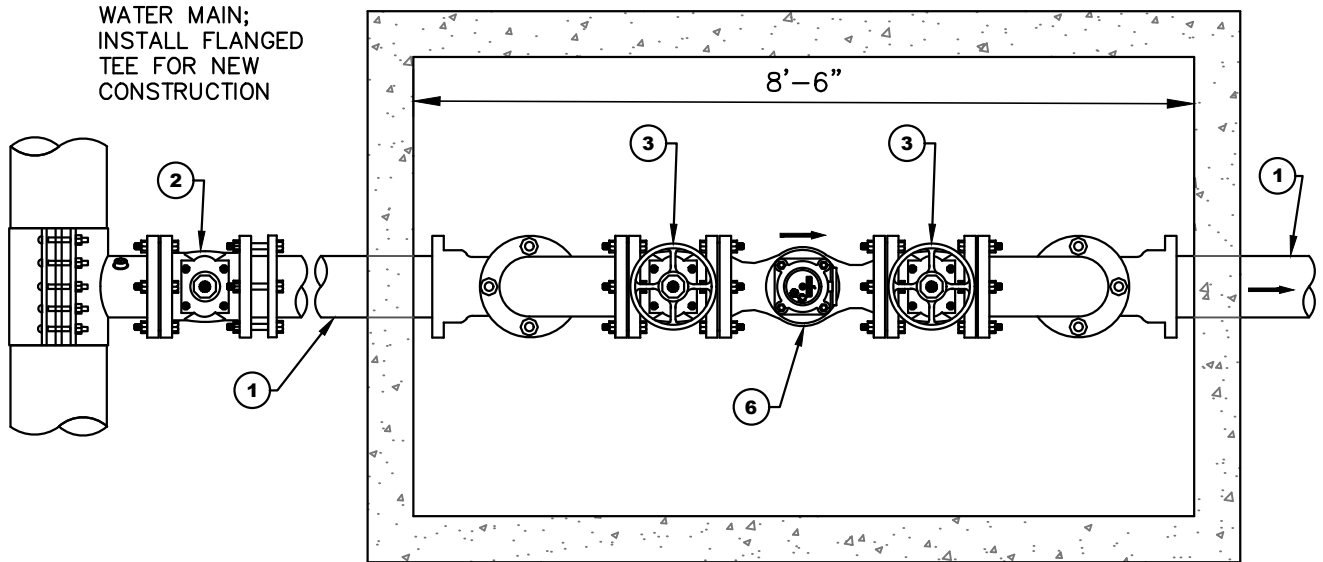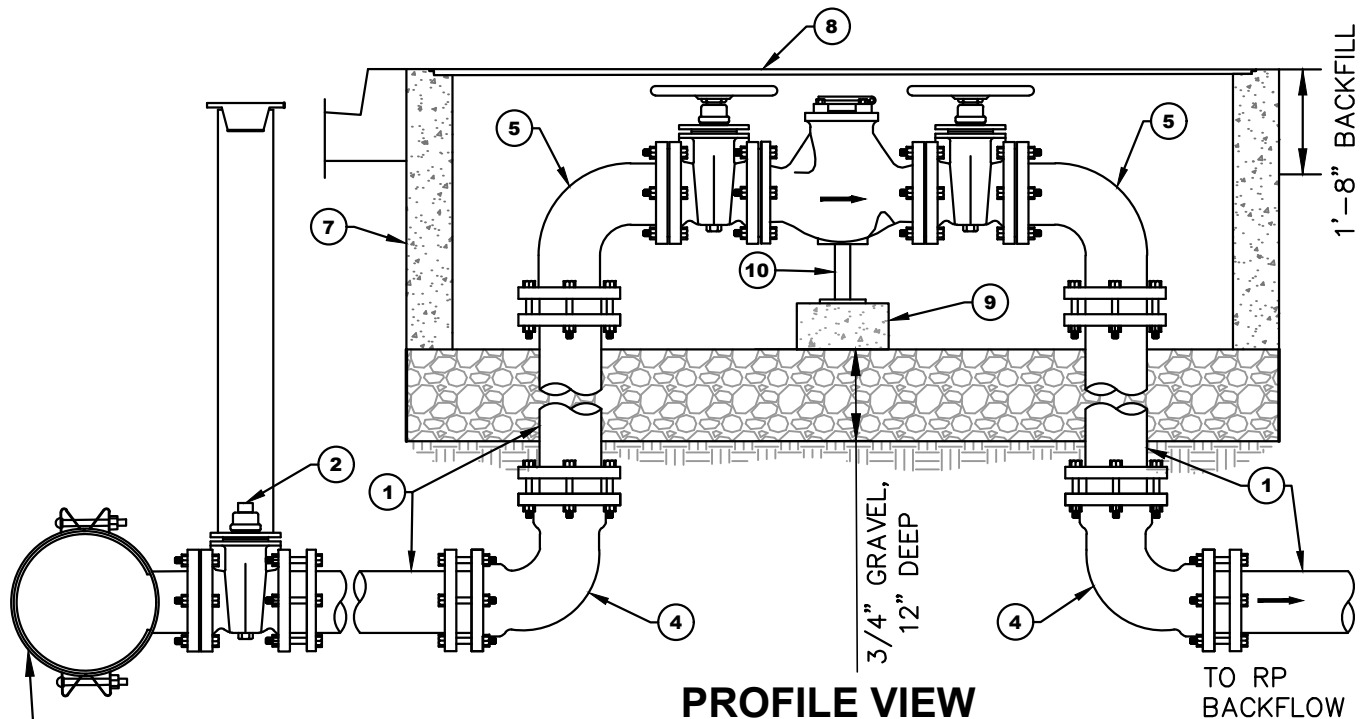

NOTES:


- ANY SPOOL PENETRATIONS THROUGH VAULT SHALL BE DRY PACKED.
- ALL JOINTS SHALL BE **RESTRAINED**. (SEE ITEM 5 OF APPROVED MATERIALS LIST)
- IF ANY PART OF THIS ASSEMBLY IS OUTSIDE THE PUBLIC RIGHT-OF-WAY, OWNER MUST DEDICATE TO VWD A 5' EASEMENT ON ALL SIDES.
- SEE SHEET 2 OF 2 FOR CONSTRUCTION NOTES.
- PIPING AND VALVES SHALL BE SAME SIZE AS WATER METER

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	6" OR LARGER DOMESTIC SERVICE IN VAULT	W-06
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 2

STANDARD ORIENTATION

**OPTIONAL ORIENTATION
(IF APP'D BY INSPECTOR)**

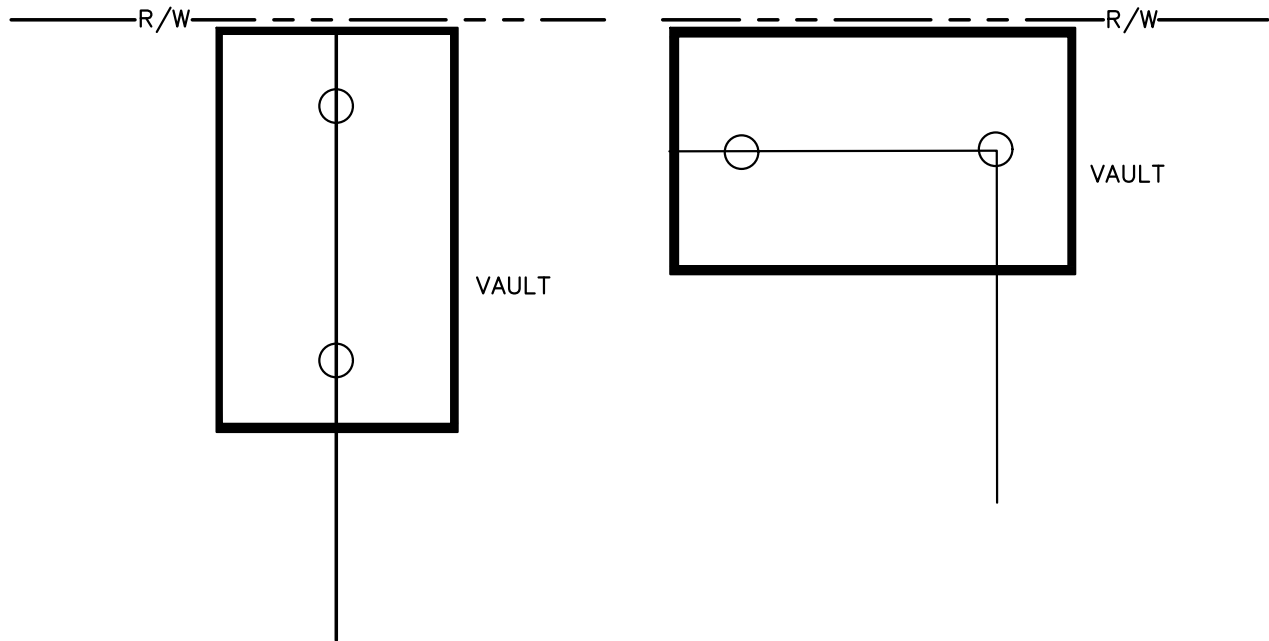

CONSTRUCTION NOTES

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	6" OR LARGER CLASS 350 DUCTILE IRON, CUT TO FIT	1-C
2	6" THROUGH 10" FL x MJ GATE VALVE OR TAPPING GATE VALVE; 12" AND LARGER (FL x FL) BUTTERFLY VALVE; W/ VALVE CAN ASSEMBLY	2-A/B
3	6" OR LARGER" FL x FL GATE VALVE W/ HANDWHEEL NRS	2-A/B
4	6" OR LARGER MJ x MJ 90° BEND	6-C
5	6" OR LARGER FL x MJ 90° BEND	6-C
6	6" OR LARGER MACH 10 ULTRASONIC METER	13-C
7	60" x 102" x 36"D PRECAST CONCRETE VAULT (LARGER VAULT MAY BE REQUIRED)	STD. DWG. W-33
8	VAULT LID	STD. DWG. W-33
9	12"W x 12"L x 6"D CONCRETE PAD	
10	STEEL PEDESTAL PIPE SUPPORT UNDER EACH METER	13-D

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	6" OR LARGER DOMESTIC SERVICE IN VAULT	W-06
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 2 OF 2



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	W-07
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	W-08
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1





CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	W-09
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. ALL METER SERVICES, MUST BE INSTALLED AS SHOWN UNLESS OTHERWISE APPROVED BY THE ENGINEER.
- B. PRIOR TO POURING THE SIDEWALK, THE METER BOX PLACEMENT MUST BE INSPECTED.

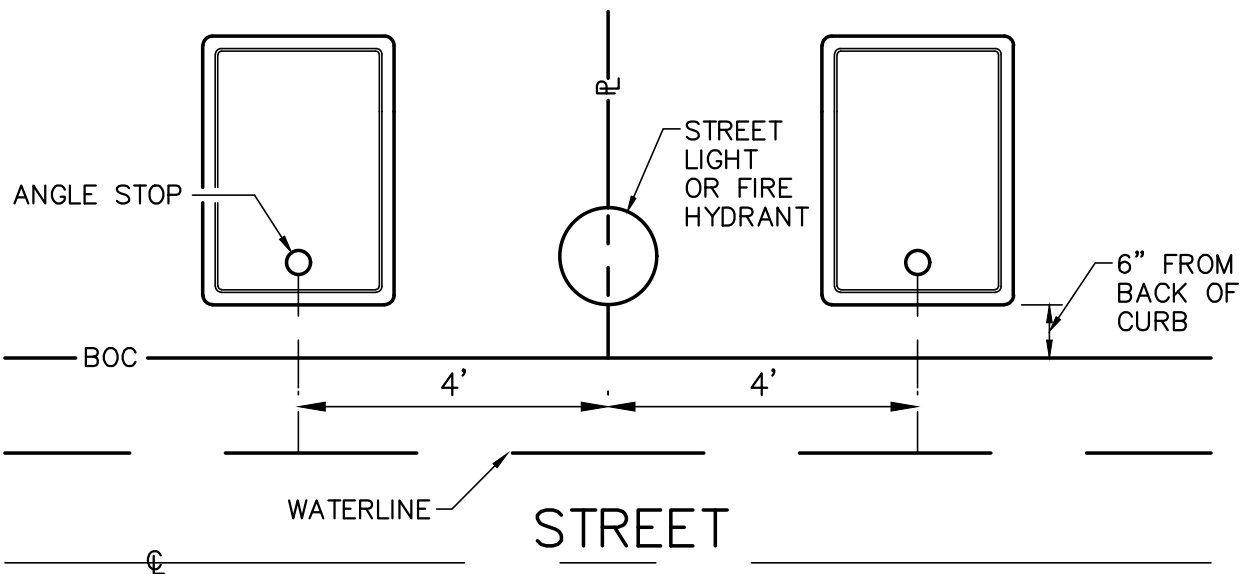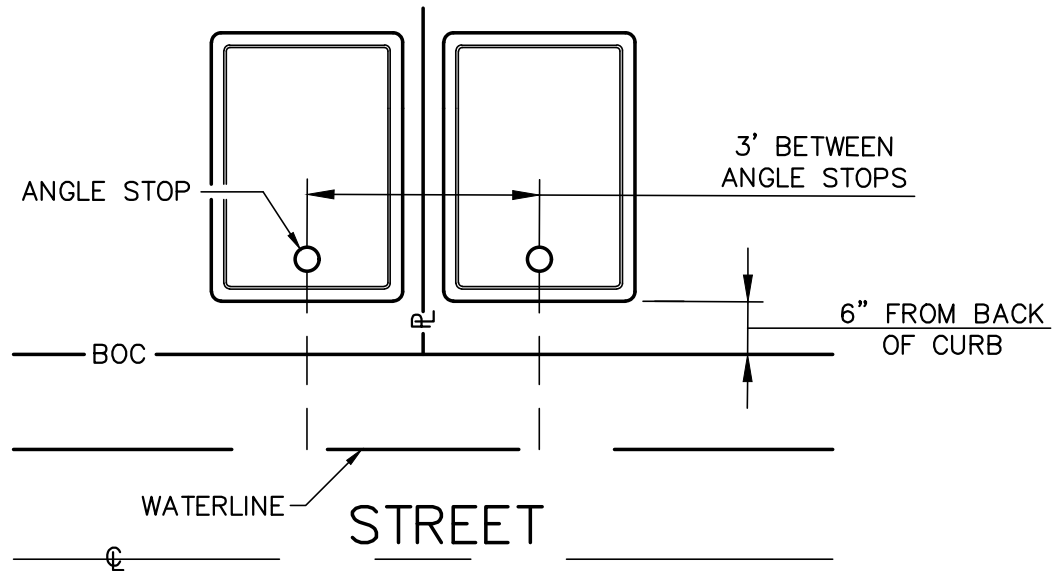

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	METER BOX PLACEMENT	W-10
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. ANY WATER FACILITIES IN CONTACT WITH CONCRETE REQUIRE A BOND BREAKER.
- B. WEEP HOLE ON HYDRANT BARREL MUST BE CLEAR OF OBSTRUCTIONS.
- C. CENTER OF HYDRANT IS TO BE PLACED AT PROPERTY LINE, OR 5 FOOT FROM BCR OR ECR, OR AS DIRECTED BY INSPECTOR.
- D. HYDRANT LATERAL LENGTH IS VARIABLE -TO BE SPECIFIED ON PLAN DRAWINGS. LATERAL MUST BE INSTALLED STRAIGHT AND LEVEL, WITH NO DEFLECTION AT JOINTS ALLOWED.
ALL JOINTS TO BE RESTRAINED. (SEE ITEM 5 OF APPROVED MATERIALS LIST)
- E. LOCATING WIRE TO RUN FROM MAIN, (TIED IN WITH INSULATING CONNECTORS) ALONG HYDRANT LATERAL AND CONNECTED TO SNAKEPIT MAGNETIZED TRACER BOX.
- F. WHERE NO SIDEWALK IS TO BE CONSTRUCTED, A 3'x3'x6" CONCRETE PAD SHALL BE PROVIDED.
- G. HYDRANT ASSEMBLY TO BE INSTALLED PLUMB.
- H. PUBLIC HYDRANT SHALL BE PAINTED YELLOW (FED NO.13655 OSHA/YELLOW, HIGH VISIBILITY)
HYDRANT TOPS AND CAPS SHALL BE PAINTED PER NFPA 291 FLOWRATES:

LIGHT BLUE (≥ 1500 GPM)
GREEN (1000 – 1499 GPM)
ORANGE (500 – 999 GPM)
RED (< 499 GPM)

- A. HYDRANT SHALL NOT HAVE MORE THAN ONE (1) EXTENSION TO RAISE TO PROPER HEIGHT.
- B. RESTRAIN MAINLINE 10' ON EACH SIDE OF HYDRANT TEE.
- C. GUARD POSTS (PER STD. DWG. W-42) SHALL BE CONSTRUCTED WHERE APPURTENANCES ARE INSTALLED NOT ADJACENT TO PORTLAND CEMENT CONCRETE (PCC) CURB AND GUTTER.

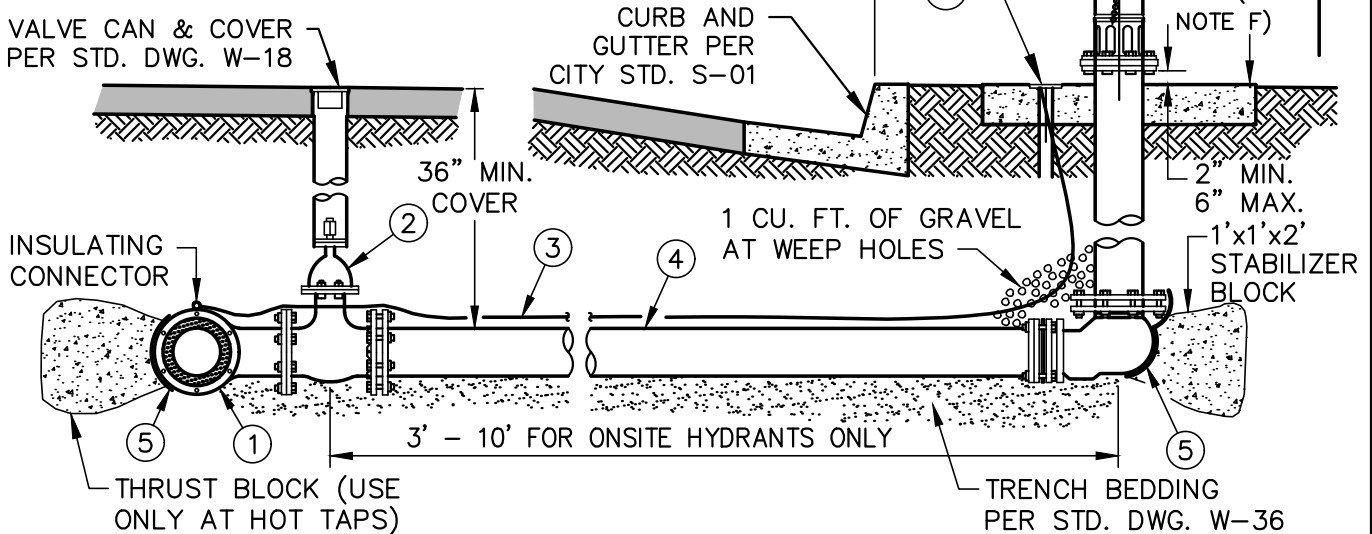

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	MAIN SIZE x 6" TEE OR TAPPING SLEEVE (SEE STD. DWG. W-21)	6-B / 7-A
2	6" GATE VALVE (FL x MJ)	2-B
3	LOCATING WIRE WITH CONNECTORS	10-A, 10-B
4	6" PIPE	1-A, 1-C
5	BOND BREAKER	13-E
6	FIRE HYDRANT ASSEMBLY	3-A
7	SNAKEPIT MAGNETIZED TRACER BOX W/ 6" TOP FLANGE	10-C


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STANDARD FIRE HYDRANT	W-11
2/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1



CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	BLANK INTENTIONALLY	W-12
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

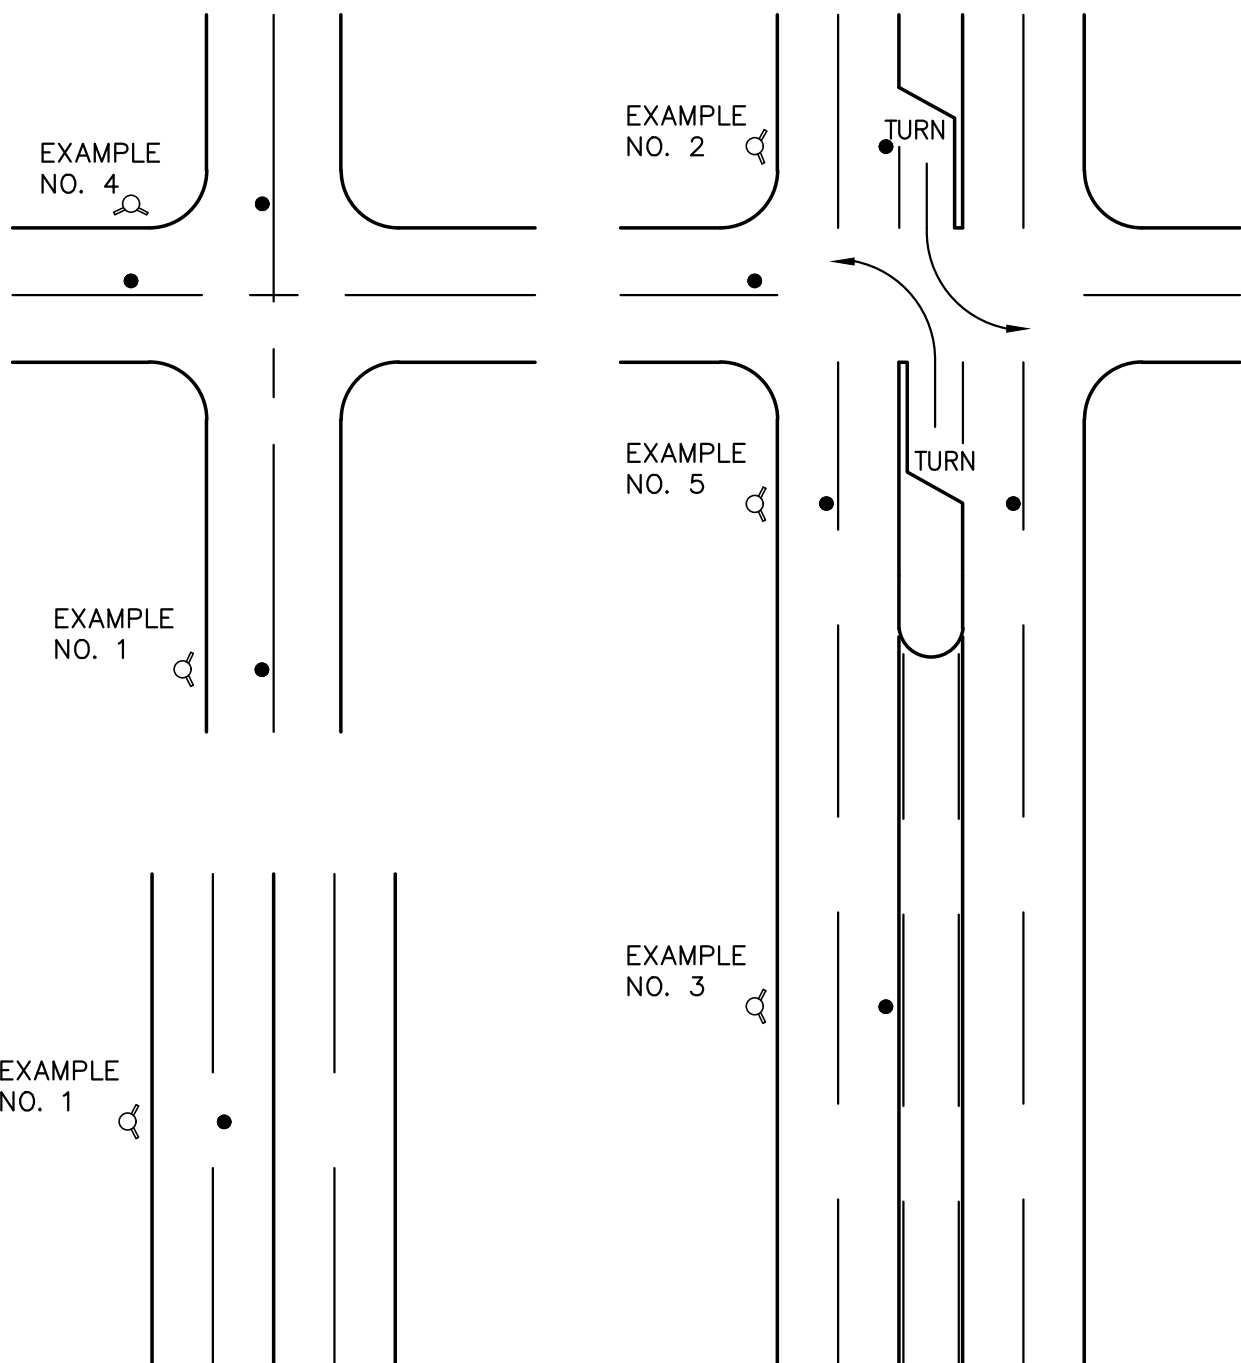

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	TYPICAL FIRE HYDRANT PAVEMENT MARKER INSTALLATION	W-13
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. PHASE BREAKS NOT SHOWN ON APPROVED WATER IMPROVEMENT PLANS MUST BE AUTHORIZED BY THE ENGINEER PRIOR TO INSTALLATION. AT THE DISCRETION OF THE ENGINEER, STD. DWG. W-15 MAY BE USED IN LIEU OF THE STANDARD SHOWN HEREON.
- B. GUARD POSTS (PER STD. DWG. W-42) REQUIRED IF INSTALLING WHERE ACCESSIBLE TO TRAFFIC

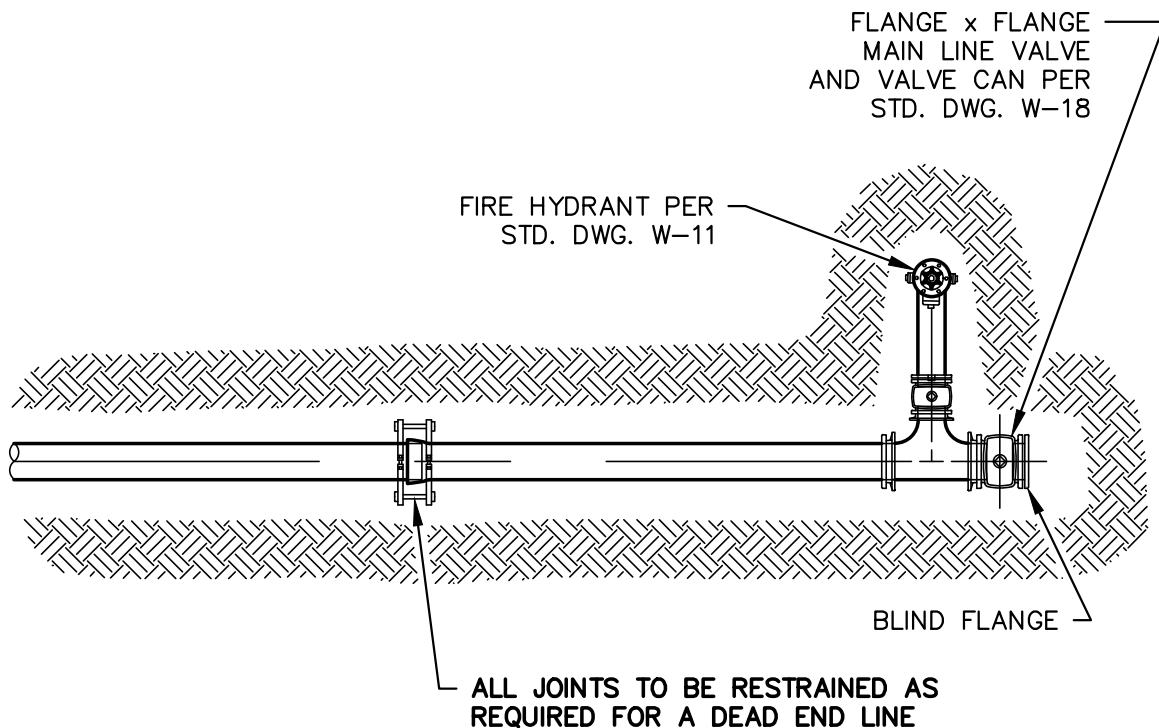


PLAN

ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	JOINT RESTRAINT		5-A, B, C
2	BLIND FLANGE		
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	PHASE BREAK END	W-14
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:


A. ITEMS 4, 5, 6 AND 7 ARE OPTIONAL AND TO BE PROVIDED BY CONTRACTOR FOR EASE OF TESTING. THESE ITEMS SHALL BE REMOVED PRIOR TO TRENCH BACKFILL.

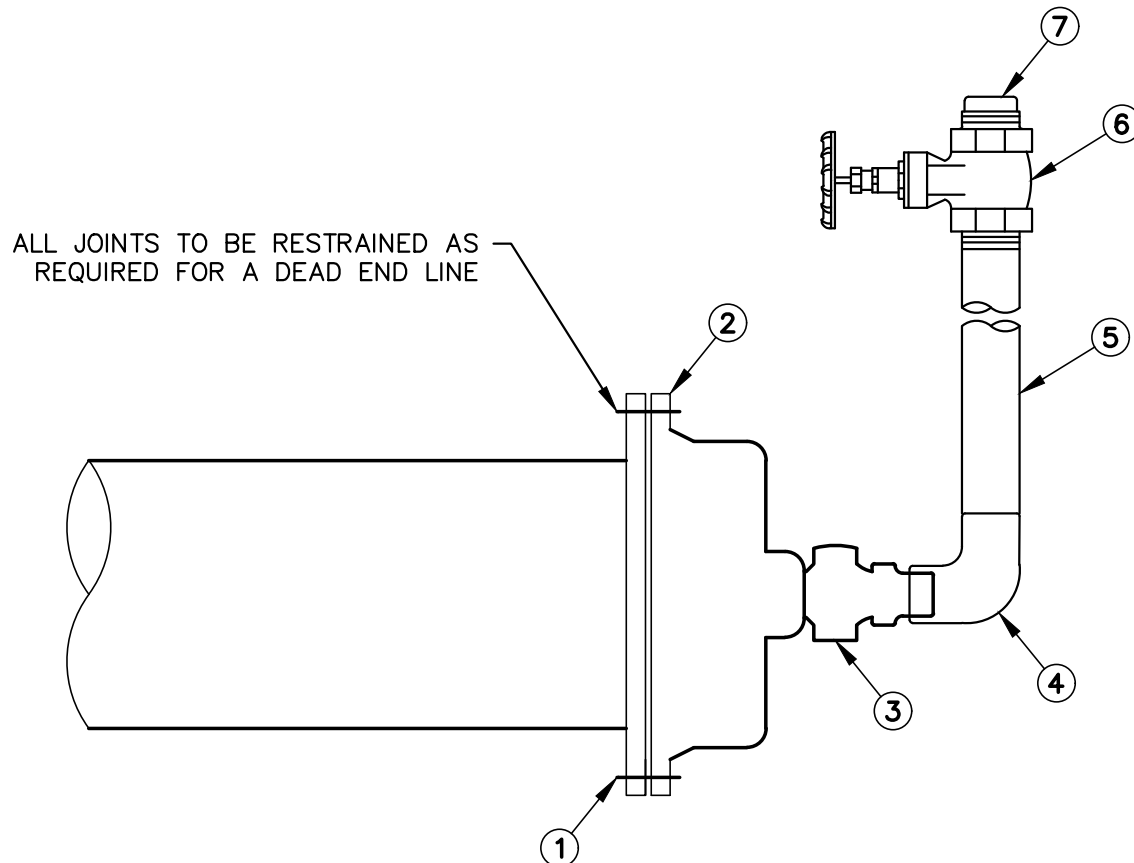

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER	
1	JOINT RESTRAINT	5-A, B, C	
2	MJ CAP OR FL x MJ ADAPTOR AND BLIND FLANGE WITH 2" TAP		
3	2" CORP STOP W/ THREADED PLUG		
4	STREET 90° BEND (BRASS)		
5	2" NIPPLE, LENGTH AS NEEDED FOR TEMPORARY BLOW-OFF		
6	2" BALL VALVE WITH HANDWHEEL FOR TEMPORARY BLOW-OFF		
7	2" THREADED PLUG FOR TEMPORARY BLOW-OFF		
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	TEMPORARY BLOW-OFF ASSEMBLY	W-15
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. LOCATING WIRE TO RUN FROM MAIN, (TIED IN WITH INSULATING CONNECTORS) ALONG LATERAL AND CONNECTED TO SNAKEPIT MAGNETIZED TRACER BOX.
- B. WHERE NO SIDEWALK IS TO BE CONSTRUCTED, A 3'x3'x6" CONCRETE PAD SHALL BE PROVIDED.
- C. BLOW-OFF ASSEMBLY TO BE INSTALLED PLUMB; LATERAL TO BE INSTALLED LEVEL AND STRAIGHT, (NO DEFLECTION AT JOINTS ALLOWED).
- D. EXPOSED COMPONENTS SHALL BE PAINTED WHITE.
- E. **ALL JOINTS TO BE RESTRAINED.** (SEE ITEM 5 OF APPROVED MATERIALS LIST).
- K. GUARD POSTS (PER STD. DWG. W-42) SHALL BE CONSTRUCTED WHERE APPURTENANCES ARE INSTALLED NOT ADJACENT TO PORTLAND CEMENT CONCRETE (PCC) CURB AND GUTTER.

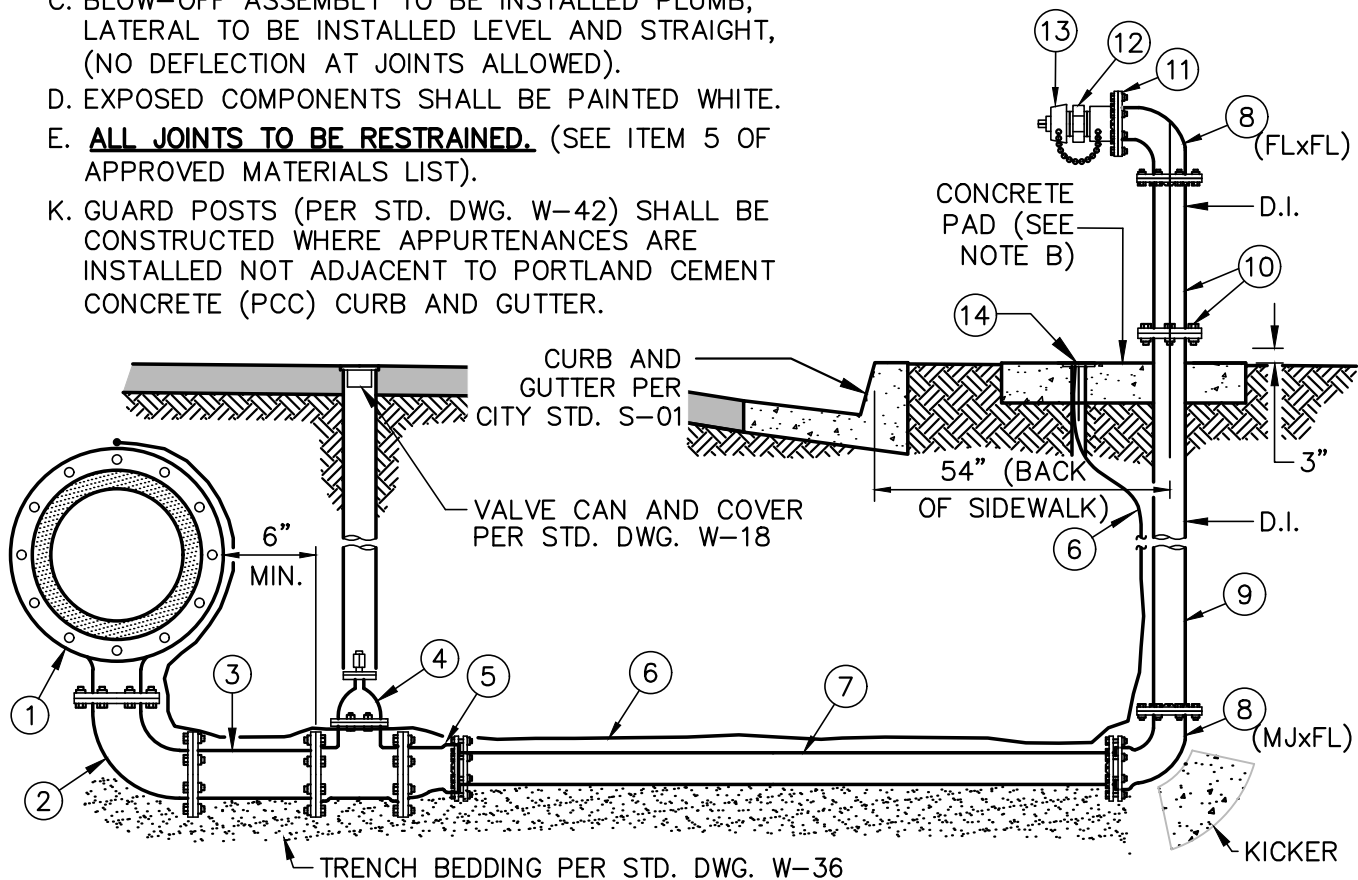


ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	MAINSIZE x 6" TEE	6-B
2	6"Ø 90° BEND (FL)	6-C
3	6"Ø D.I. SPOOL (FL), LENGTH AS NEEDED	6-E
4	6" GATE VALVE (FLG'D)	2-B
5	6" x 4" ECCENTRIC REDUCER WITH TOP LEVEL (FL x MJ)	6-C
6	LOCATING WIRE WITH CONNECTORS (IF REQUIRED BY INSPECTOR) 12AWG COPPER-CLAD STEEL (CCS), HDPE-INSULATED (MIN.).	10-A, 10-B
7	4"Ø D.I. PIPE, LENGTH AS NEEDED	1-C
8	4"Ø 90° BEND (FL X FL) OR (MJ x FL) PER PLAN	6-C
9	4"Ø D.I. SPOOL, LENGTH AS REQUIRED	6-E
10	4"Ø 18" LONG D.I. SPOOL, W/ BREAK AWAY BOLTS	6-E, 13-K
11	4" BLIND FLANGE W/ 2" THREADED TAP	6-G
12	2-1/2" MIPT x 2-1/2" NST (HOSE COUPLING THREAD)	6-C, 6-D
13	2-1/2" HOSE NOZZLE CAP, PLASTIC WITH CHAIN	6-C, 6-D
14	SNAKEPIT MAGNETIZED TRACER BOX W/ 6" TOP FLANGE W/ GROUND.	10-C

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	4" BLOW-OFF ASSEMBLY	W-16
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. LOCATING WIRE TO RUN FROM MAIN, (TIED IN WITH INSULATING CONNECTORS) ALONG LATERAL AND CONNECTED TO SNAKEPIT MAGNETIZED TRACER BOX.
- B. WHERE NO SIDEWALK IS TO BE CONSTRUCTED, A 3'x3'x6" CONCRETE PAD SHALL BE PROVIDED.
- C. BLOW-OFF ASSEMBLY TO BE INSTALLED PLUMB; LATERAL TO BE INSTALLED LEVEL AND STRAIGHT, (NO DEFLECTION AT JOINTS ALLOWED).
- D. EXPOSED COMPONENTS SHALL BE PAINTED WHITE.
- E. **ALL JOINTS TO BE RESTRAINED.** (SEE ITEM 5 OF APPROVED MATERIALS LIST).
- K. GUARD POSTS (PER STD. DWG. W-42) SHALL BE CONSTRUCTED WHERE APPURTENANCES ARE INSTALLED NOT ADJACENT TO PORTLAND CEMENT CONCRETE (PCC) CURB AND GUTTER.

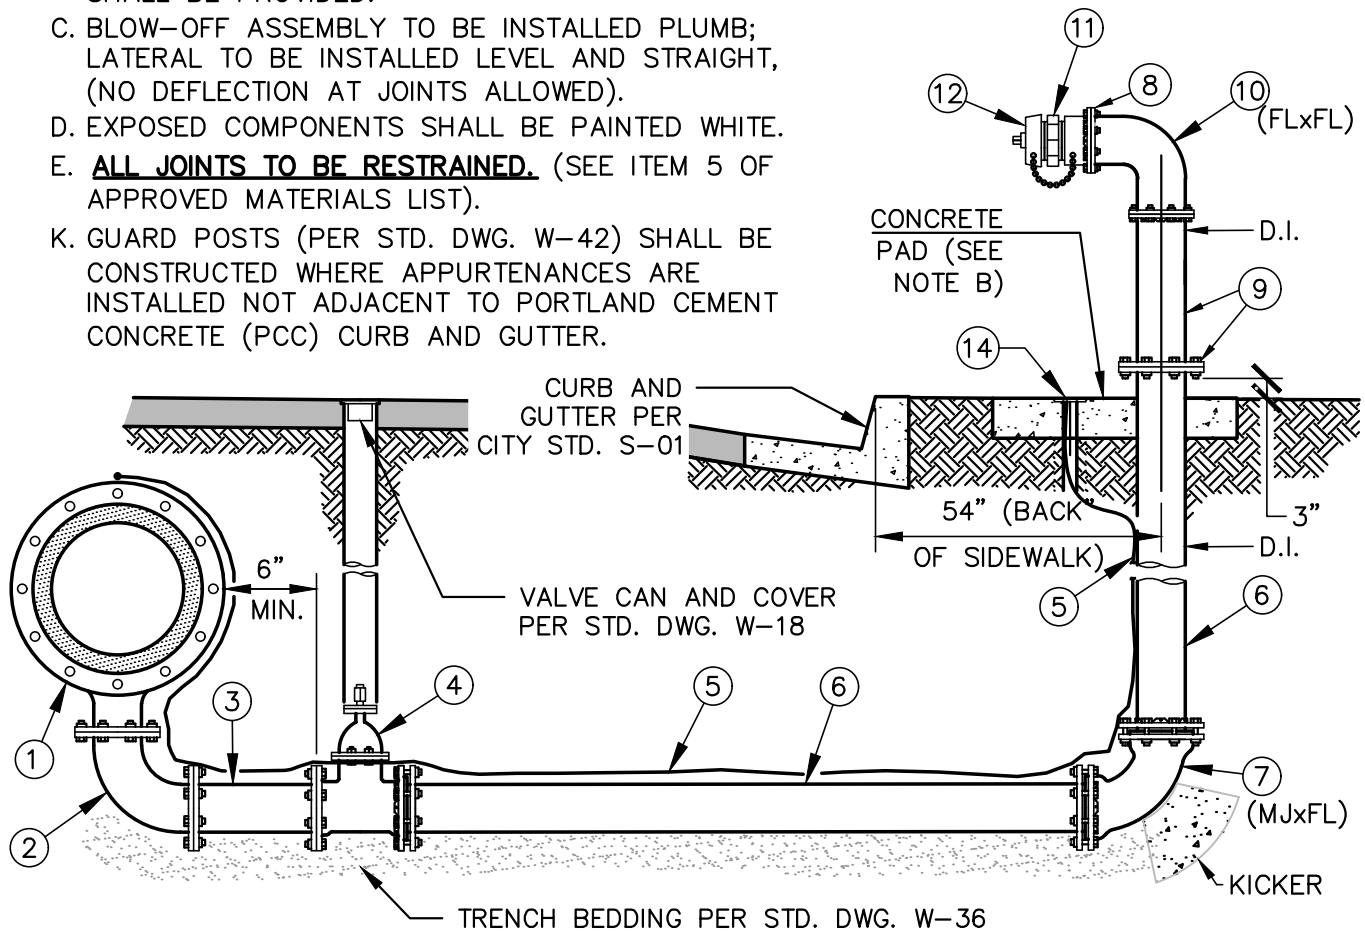


ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	MAINSIZE x 6" TEE	6-B
2	6" 90° BEND (FL)	6-C
3	6" SPOOL (FL), LENGTH AS NEEDED	6-E
4	6" GATE VALVE (FL X MJ)	2-B
5	LOCATING WIRE WITH CONNECTORS (IF REQUIRED BY INSPECTOR)	10-A, 10-B
6	6" PIPE (PE x PE), LENGTH AS NEEDED	1-C
7	6" 90° BEND (MJ x MJ)	6-C
8	6" BLIND FLANGE W/ 4" THREADED TAP	6-G
9	6" BLACK IRON, 18" LONG (MIPT x FL) W/ BREAK AWAY BOLTS	1-G
10	6"Ø 90° BEND (FL X FL) OR (MJ x FL) PER PLAN	6-C
11	4" MIPT x 4" NST (HOSE COUPLING THREAD)	6-C, 6-D
12	4" HOSE NOZZLE CAP, PLASTIC WITH CHAIN	6-C, 6-D
13	NOT REQUIRED	
14	SNAKEPIT MAGNETIZED TRACER BOX W/ 6" TOP FLANGE	10-C

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	6" BLOW-OFF ASSEMBLY	W-17
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:


- A. VALVE CAN ASSEMBLY SHALL NOT BE LOCATED IN A GUTTER OR CROSS GUTTER.
- B. WHERE DEPTH TO VALVE OPERATOR IS OVER 6 FEET, AN OPERATOR EXTENSION PER STD. DWG. W-19 WILL BE REQUIRED.

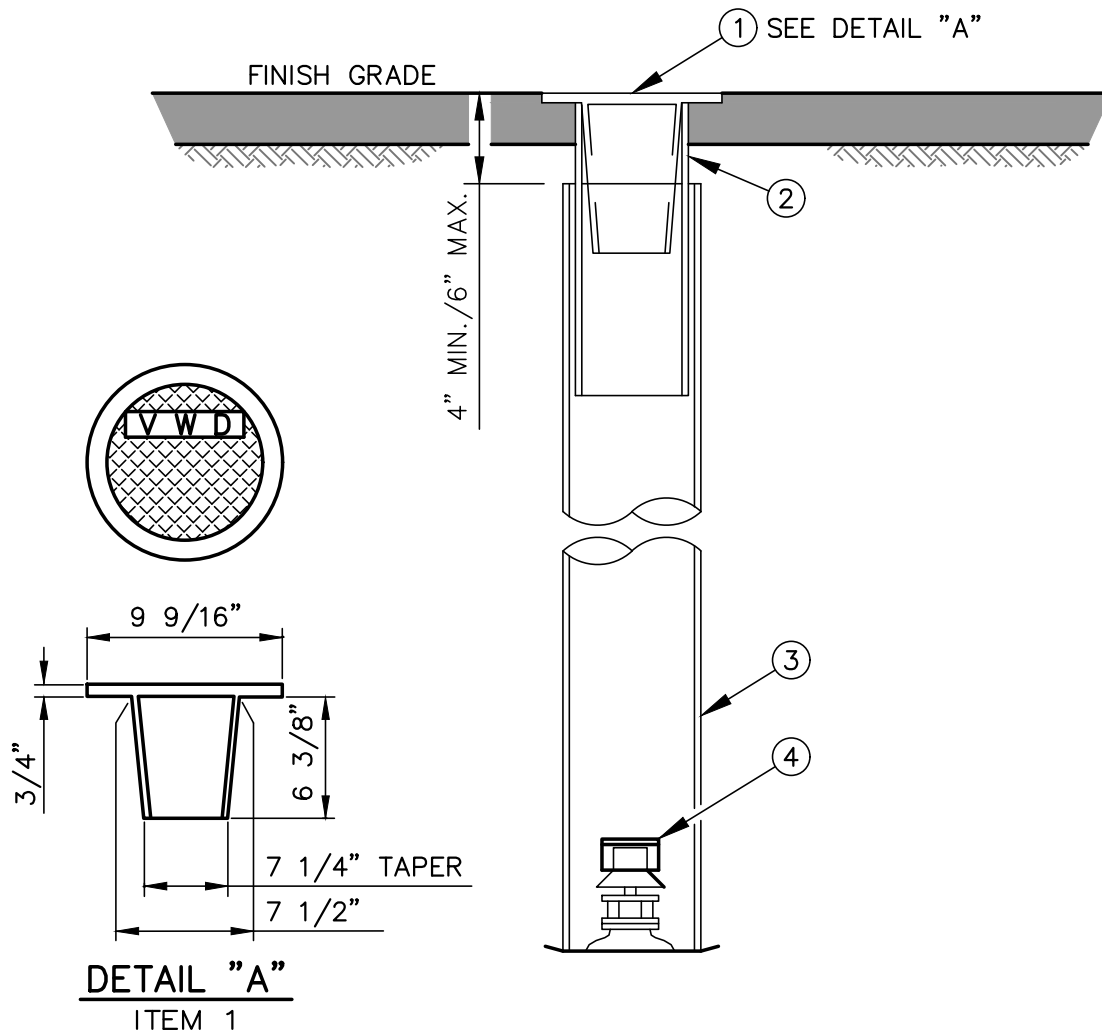


ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	VALVE COVER – WITH 1” ’VWD’ CAST THEREON FOR WATER LINE		13–F
2	VALVE SLIP CAN – 18” LONG (ADJUST TO GRADE, ONE ONLY)		13–G
3	VALVE CAN TUBE – 8” SDR35 OR C900 CL305 DR14, (LENGTH VARIES)		13–H
4	VALVE		2–A, 2–B
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	VALVE CAN ASSEMBLY	W-18
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. VALVE CAN ASSEMBLY SHALL NOT BE LOCATED IN A GUTTER OR CROSS GUTTER.
- B. WHERE DEPTH TO VALVE OPERATOR IS OVER 6 FEET, AN OPERATOR EXTENSION PER STD. DWG. W-19 WILL BE REQUIRED.

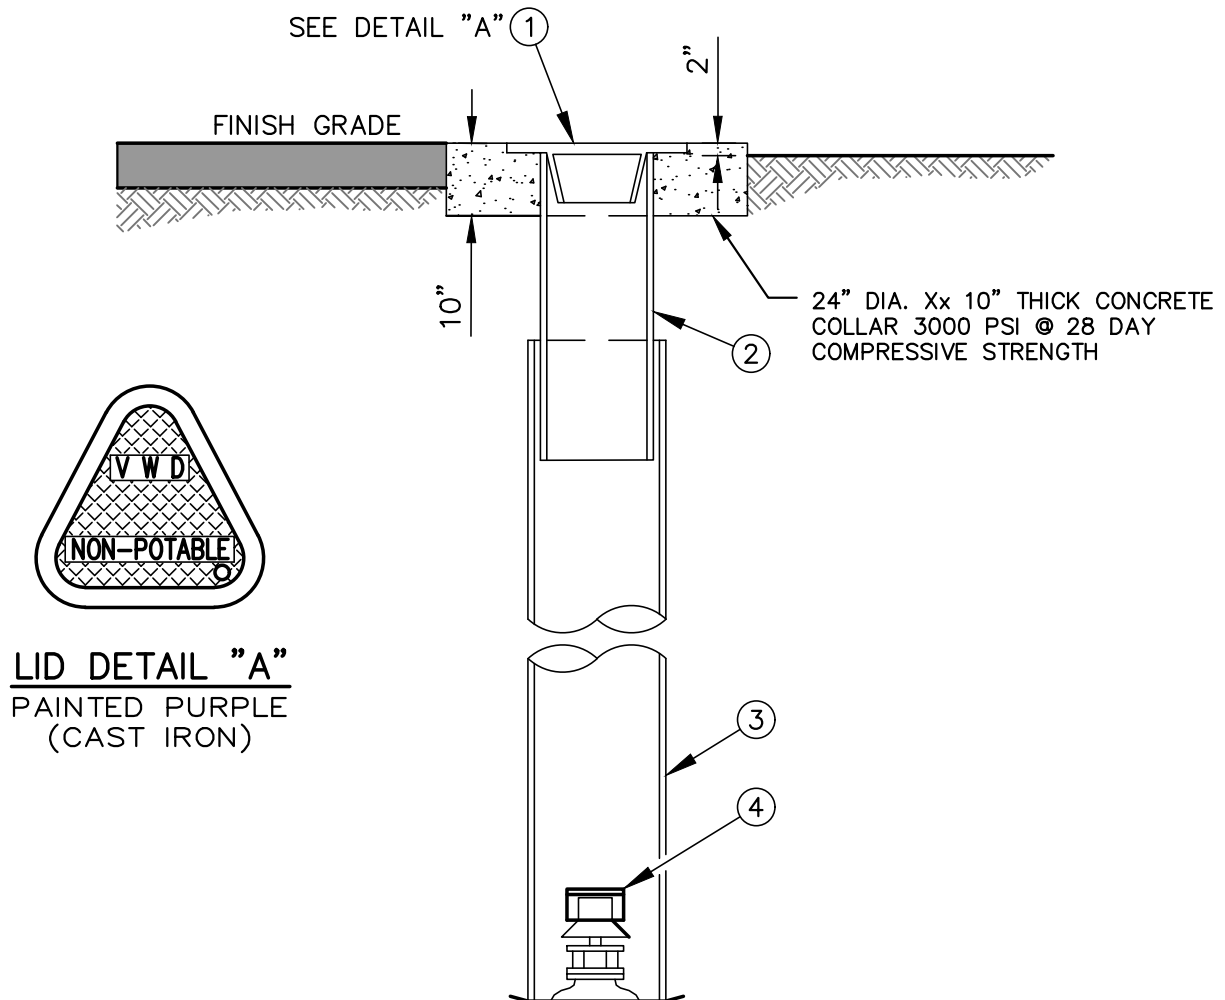


ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	VALVE COVER – WITH 1” ’VWD’ CAST THEREON FOR WATER LINE		13–F
2	VALVE SLIP CAN – 18” LONG (ADJUST TO GRADE, ONE ONLY)		13–G
3	8” O.D. (LENGTH VARIES) VALVE CAN		13–H
4	VALVE		2–A, 2–B
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	VALVE CAN ASSEMBLY - RECLAIMED	W-18b
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

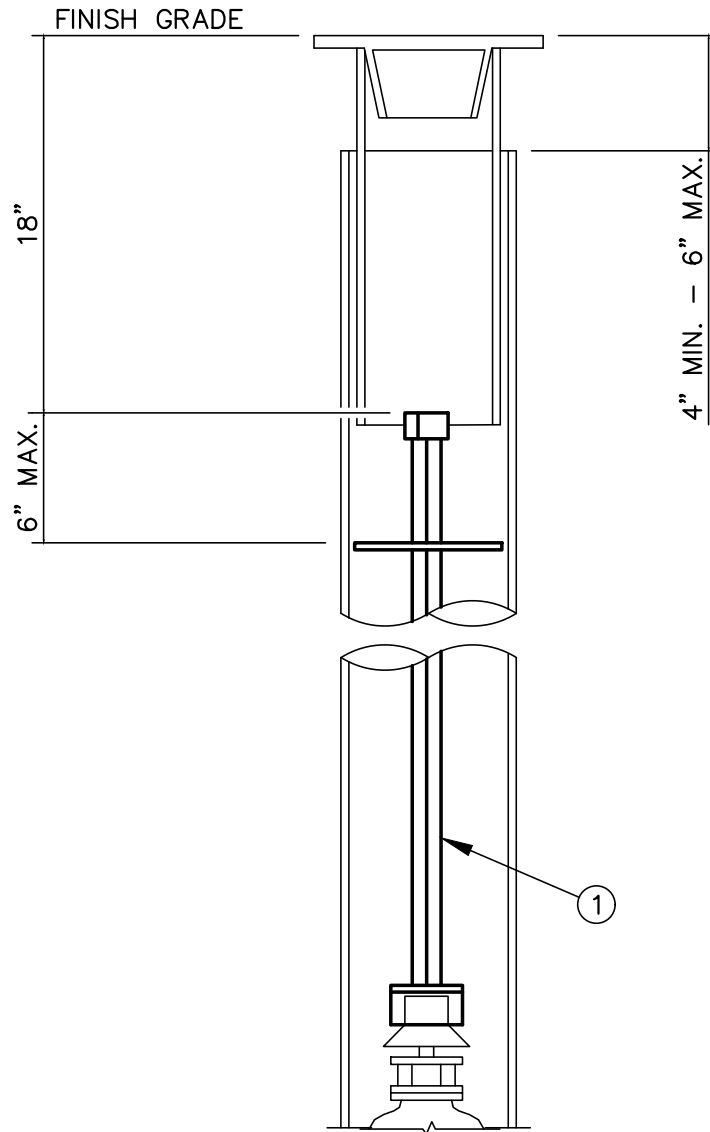

NOTES:

- A. EXTEND 2" NUT TO WITHIN 18" OF FINISH GRADE WHEN VALVE NUT IS DEEPER THAN 6 FEET FROM FINISHED GRADE.
- B. WHERE LENGTH OF EXTENSION IS OVER 8 FEET, A SECOND PLATE SHALL BE INSTALLED IN THE CENTER OF THE EXTENSION STEM.
- C. EXTENSION STEM SHALL BE OF SOLID DESIGN, NO PINNED COUPLINGS PERMITTED.
- D. EXTENSION STEMS SHALL NOT BE ATTACHED TO THE OPERATING NUT OF THE VALVE.

ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	VALVE STEM EXTENSION		13-I
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	VALVE OPERATOR EXTENSION	W-19
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

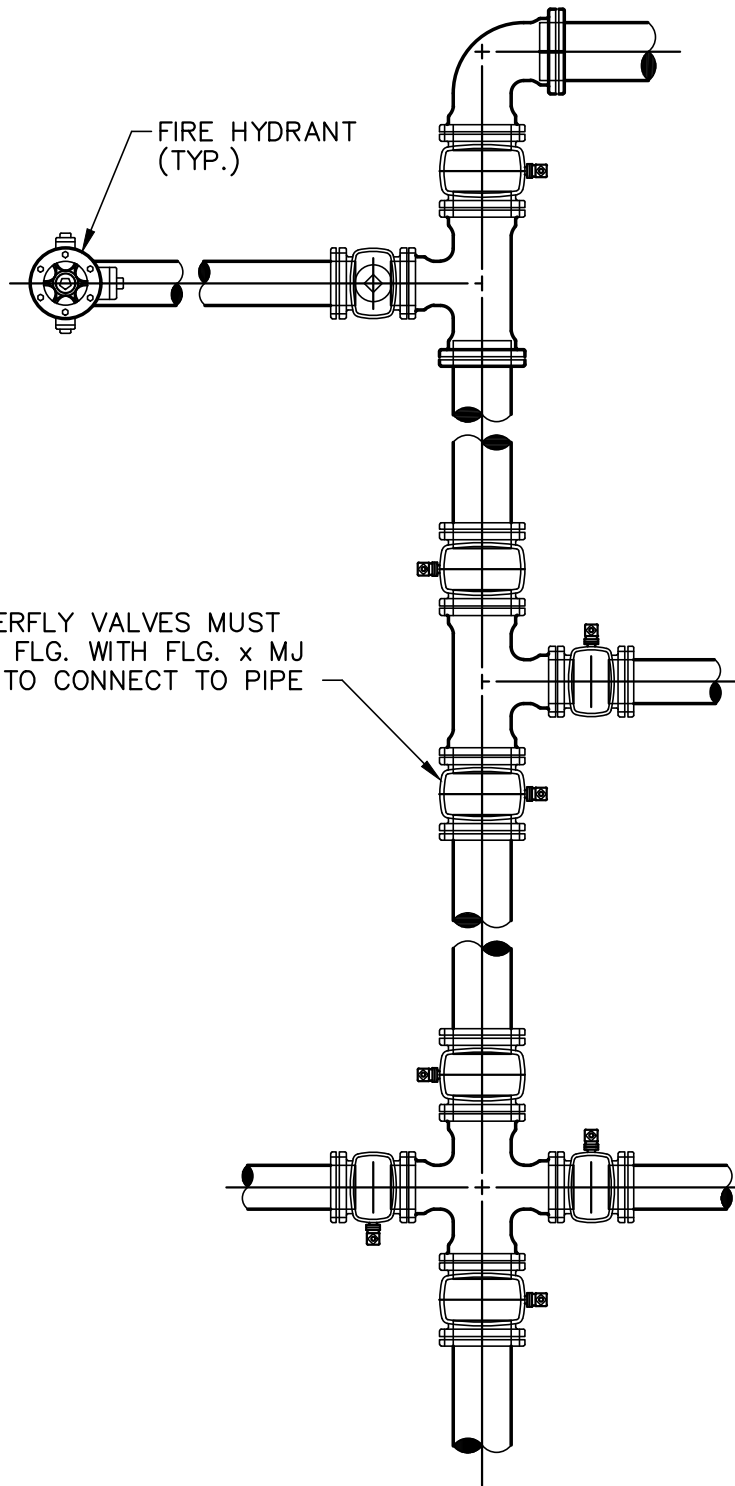


NOTES:

- A. ALL VALVES MUST BE FLANGED TO AN ADJACENT FITTING, INCLUDING AT PHASE BREAKS.
- B. SEE STANDARD DRAWING W-18 FOR VALVE CAN REQUIREMENTS.
- C. IF STANDING ON TEE OR CROSS LOOKING TOWARD MAIN, VALVE OPERATOR SHALL BE ON LEFT SIDE OF MAIN.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	TYPICAL BUTTERFLY VALVE OPERATOR LOCATIONS	W-20
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- NO FULL SIZE TAPS ARE PERMITTED ON CLASS 150 PVC C-900.
- REFER TO "GENERAL PIPING SYSTEM AND APPURTENANCES" SECTION OF THE SPECIFICATIONS.
- VALVE TO BE INSTALLED MUST BE BOLTED ON.

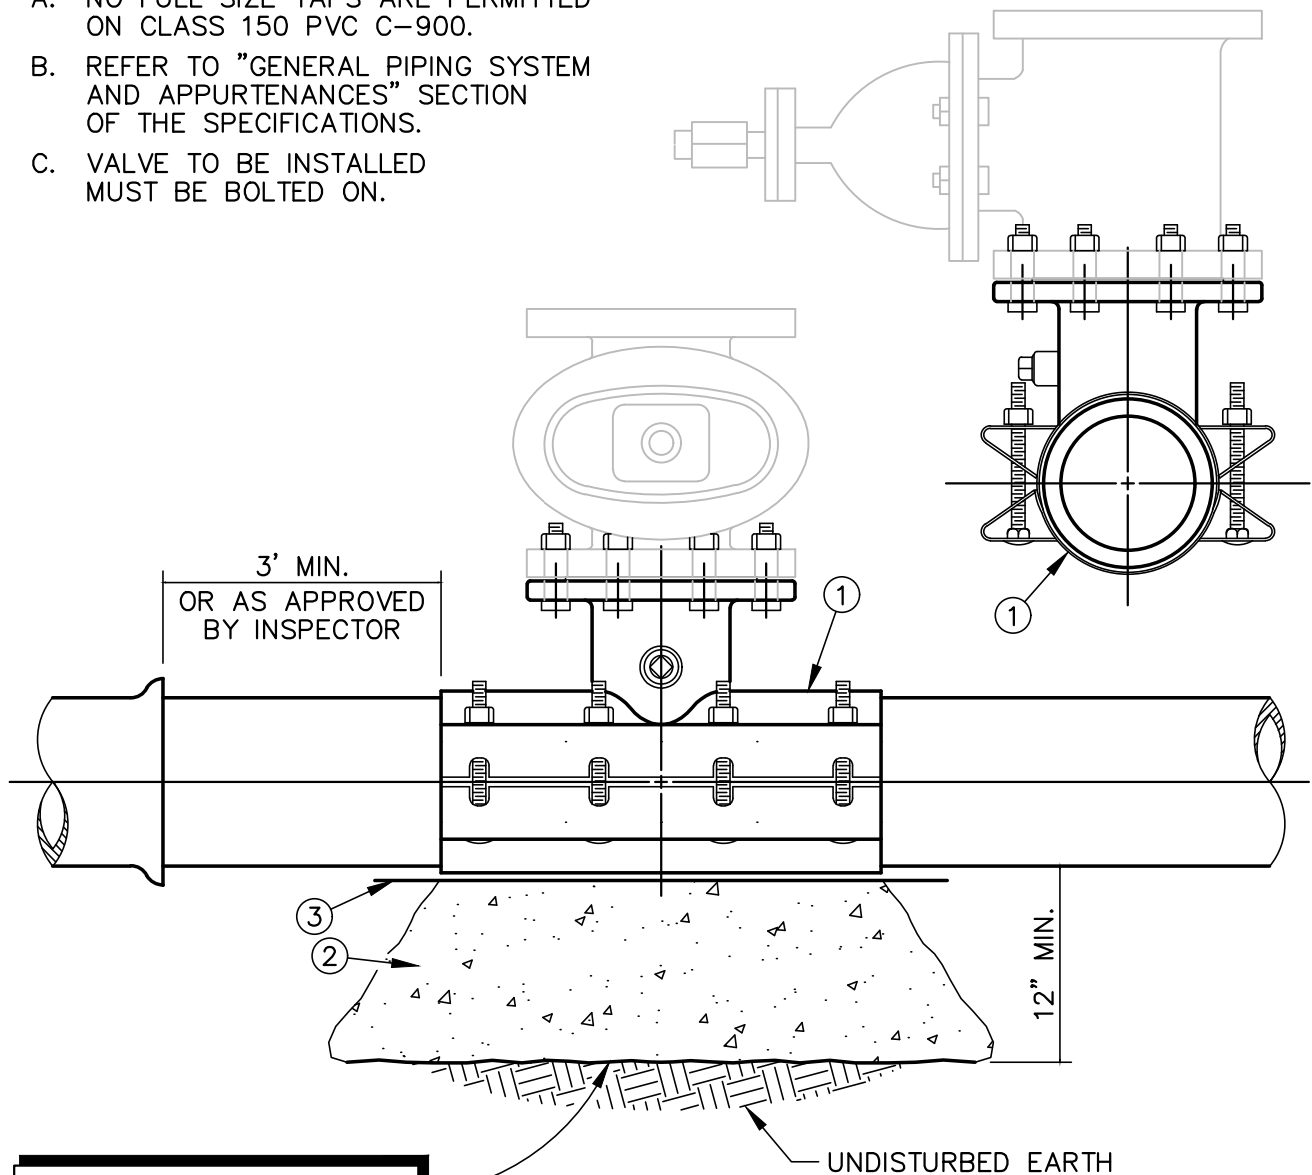


MINIMUM BEARING SURFACE AREA

PIPE SIZE	TEE
6"	3.5 SQ. FT.
8"	5.5 SQ. FT.
12"	12.0 SQ. FT.



ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	TAPPING SLEEVE		7-A
2	CONCRETE THRUST BLOCK		
3	BOND BREAKER		13-E
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	HOT TAP DETAIL AC, PVC, DIP	W-21
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. USE COLLAR REINFORCEMENT WHEN OUTLET TO MAIN RATIO IS 50% OR LESS.
- B. USE WRAPPER REINFORCEMENT WHEN OUTLET TO MAIN RATIO IS GREATER THAN 50%.
- C. REINFORCEMENT DESIGN IS BASED ON THE STEEL AREA REMOVED FROM THE MAIN LINE AND THE OPERATING PRESSURE OF THE SYSTEM.
- D. JOB SPECIFICATIONS/DETAILS FOR REINFORCEMENT SHALL GOVERN IF IN EXCESS OF NOTES A, B AND C ABOVE.
- E. OUTLET NOZZLE SHOULD BE POSITIONED AND WELDED ON TO MAIN PRIOR TO WELDING ON THE REQUIRED REINFORCEMENT (COLLAR-WRAPPER).
- F. FLANGE SHALL BE ATTACHED WITH BOLT HOLES CENTERED ABOUT THE VERTICAL AXIS OF THE PIPE UNLESS OTHERWISE NOTED.
- G. ON CEMENT COATED STEEL PIPE, RECOAT PIPE ACCORDING TO MANUFACTURERS RECOMMENDATIONS.

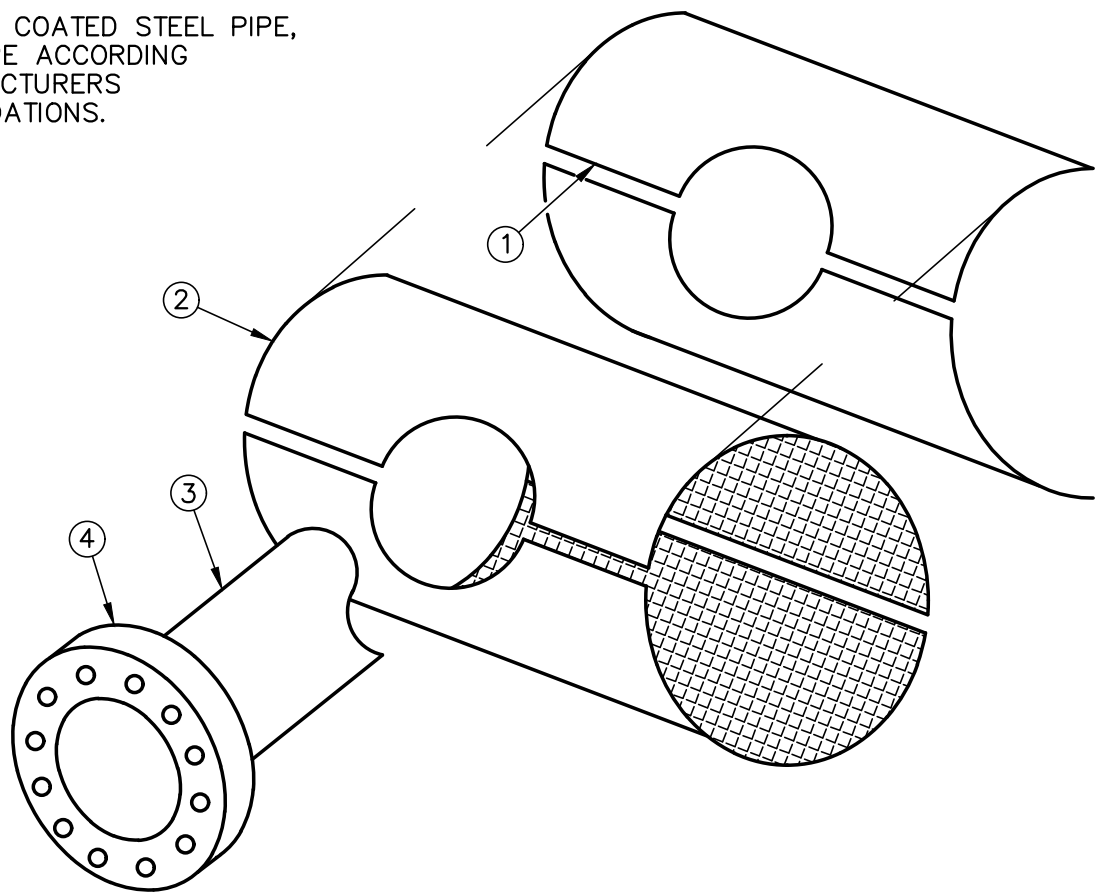


ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	COLLAR REINFORCEMENT		7-C
2	WRAPPER REINFORCEMENT (FULL WRAP)		7-C
3	OUTLET NOZZLE		7-D
4	FLANGE		7-E
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	TAPPING OUTLET - FOR STEEL PIPE	W-22
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

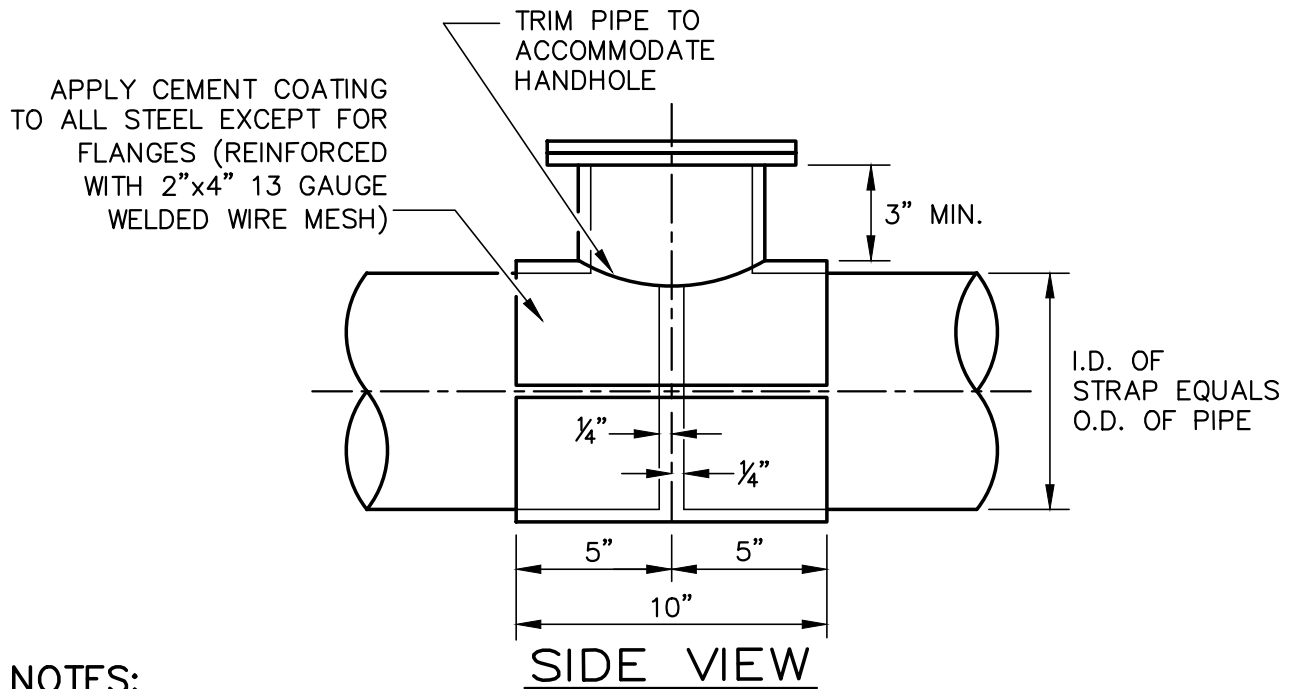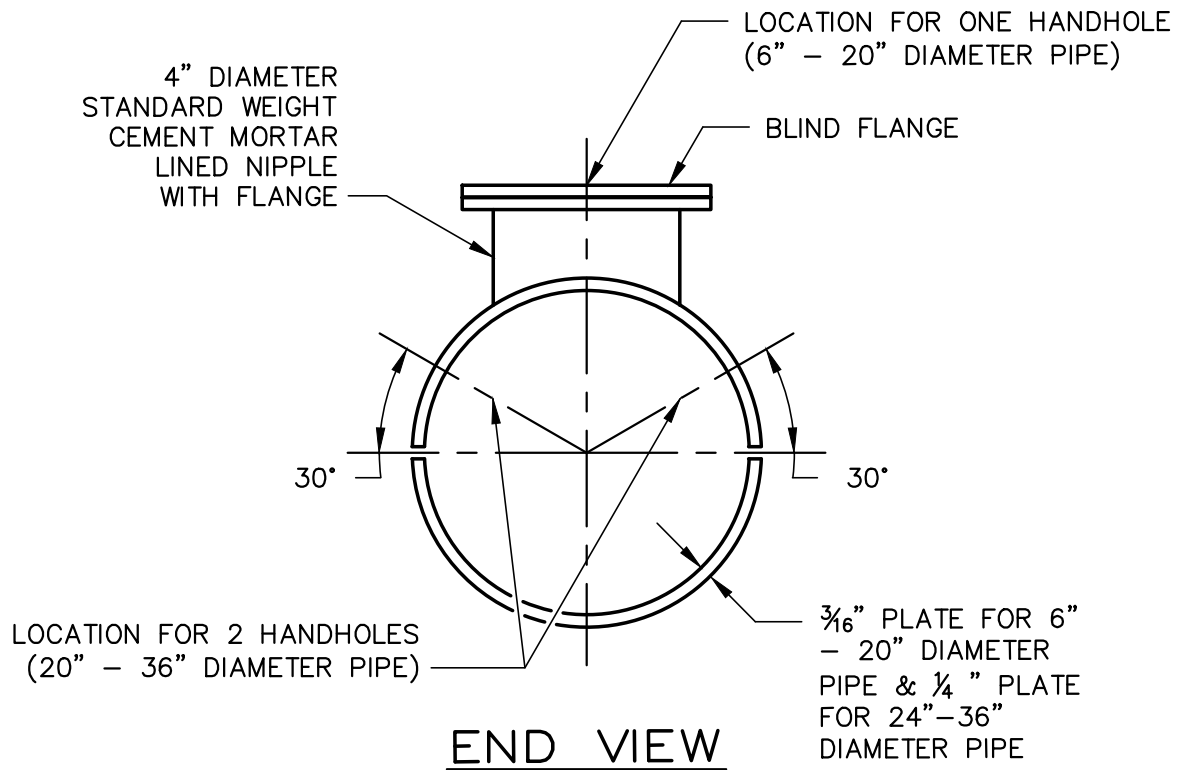

NOTES:


- A. ALL JOINTS SHALL BE FULLY WELDED
- B. FLANGE BOLTS SHALL BE SELECTED FROM THE APPROVED MATERIALS LIST.
- C. ANY 6" OR LARGER TAP, OR ANY TAP/LATERAL THAT IS 50% OR GREATER OF THE MAIN SIZE, MUST HAVE A FULL-CIRCLE WELD AROUND THE WATER MAIN.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	WELDED STEEL PIPE BUTT-JOINT WITH HANDHOLE	W-23
4/24/2026	B.K.		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

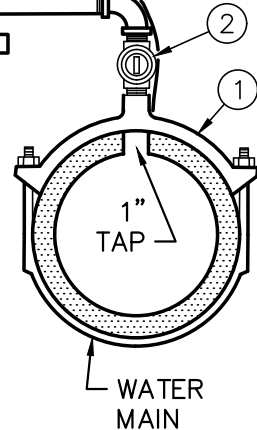

- A. WHERE NO SIDEWALK IS TO BE CONSTRUCTED, A 2'x2'x4" CONCRETE PAD SHALL BE PROVIDED.
- B. GUARD POSTS (PER STD. DWG. W-42) REQUIRED IF INSTALLING WHERE ACCESSIBLE TO TRAFFIC.
- C. 1" AIR VACUUMS ARE INTENDED USE FOR SHORT RUNS SUCH AS CUL-DE-SACS. MAX 8"Ø PIPE.


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	STANDARD 1" AIR AND VACUUM RELEASE VALVE ASSEMBLY	W-24
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

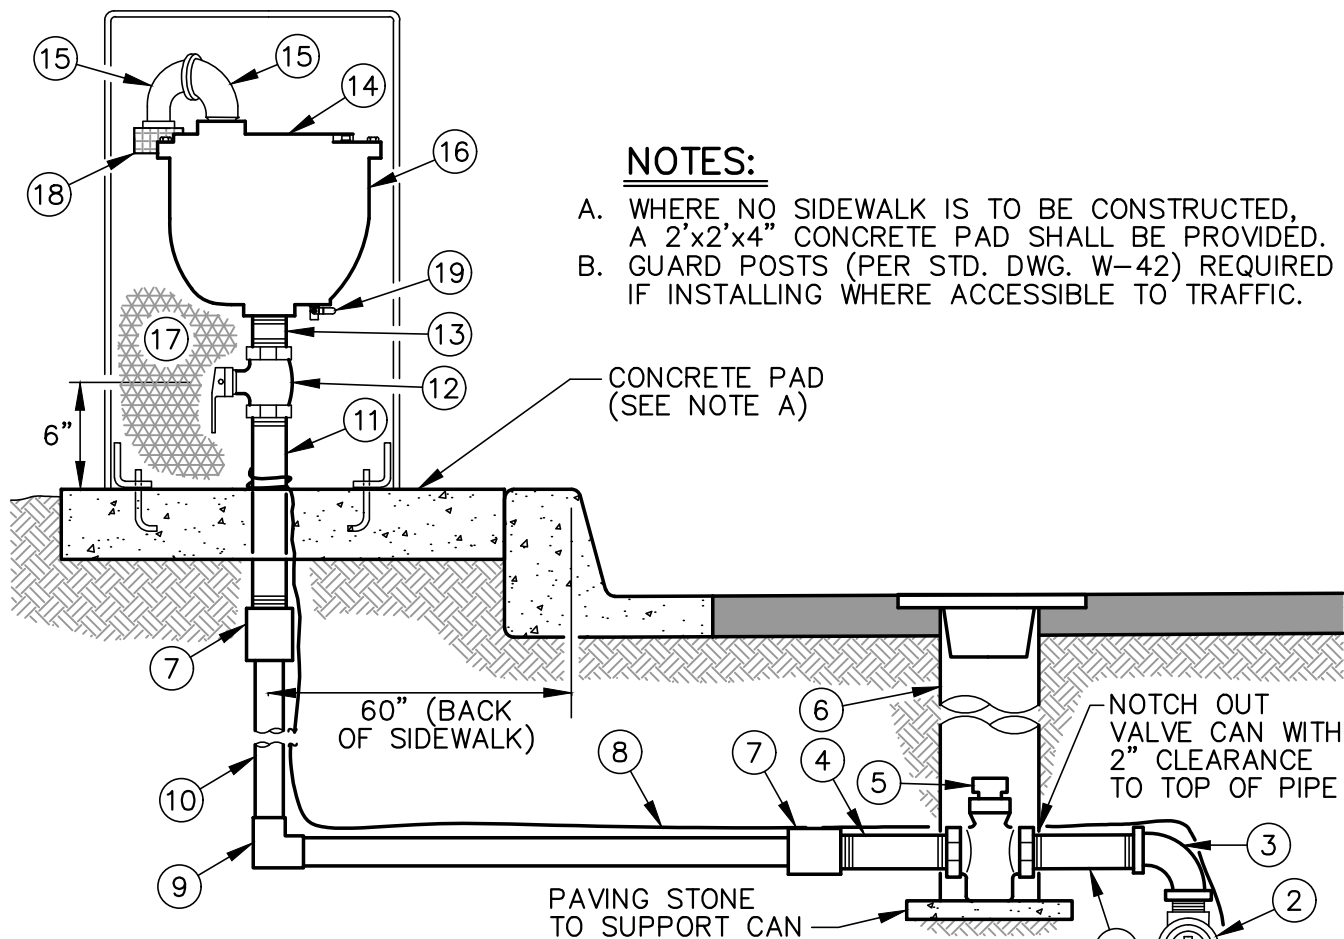

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	"MAIN SIZE" x 2" SERVICE SADDLE	7-B
2	2" CORP. STOP (MIPT x MIPT)	2-L
3	2" 90° BEND, BRONZE, (FIPT x FIPT)	6-D
4	(2) 2" x 6" NIPPLE, BRASS, (MIPT x MIPT)	6-D
5	2" GATE VALVE, 2" OPERATING NUT	2-B
6	VALVE CAN SET (SEE STD. DWG. W-18)	13-F,G,H
7	2" SOLDER x FIPT FITTING	6-D
8	LOCATING WIRE W/ CONNECTORS (IF REQUIRED)	10-A, 10-B
9	2" - 90° SOLDER FITTING	6-D
10	2" TUBING (LENGTH VARIES, GRADES TOWARD MAIN)	1-D
11	2" x 18" NIPPLE, BRASS, (MIPT x MIPT)	6-D
12	2" BALL VALVE W/ HANDLE, BRONZE (FIPT x FIPT)	2-I
13	2" x CLOSE NIPPLE, BRASS, (MIPT x MIPT)	6-D
14	2" AIR AND VACUUM RELEASE VALVE, (FIPT)	11-B
15	(2) 2" 90° PVC SCH. 80 STREET BEND	6-F
16	AIR-VAC ENCLOSURE (SEE STD. DWG. W-27)	11-E
17	INSULATING BAG	11-G
18	SCREENED CAP	11-H
19	1/2" BALL VALVE (FIPT x FIPT) W/ NIPPLE	2-I

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	STANDARD 2" AIR AND VACUUM RELEASE VALVE ASSEMBLY	W-25
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

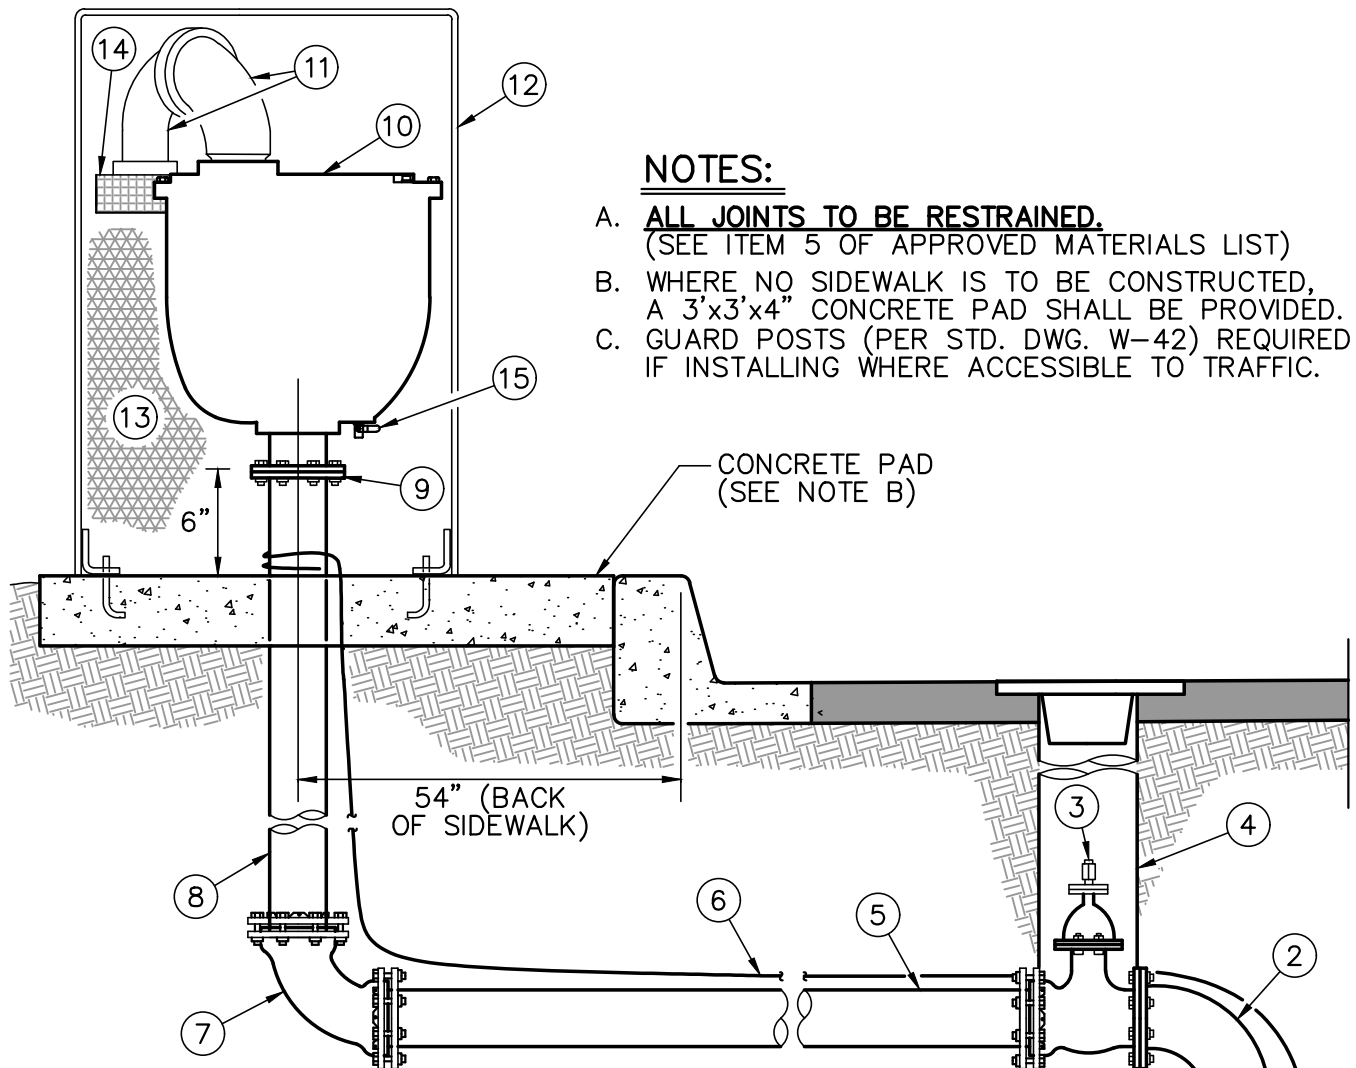

NOTES:


- A. **ALL JOINTS TO BE RESTRAINED.**
(SEE ITEM 5 OF APPROVED MATERIALS LIST)
- B. WHERE NO SIDEWALK IS TO BE CONSTRUCTED, A 3'x3'x4" CONCRETE PAD SHALL BE PROVIDED.
- C. GUARD POSTS (PER STD. DWG. W-42) REQUIRED IF INSTALLING WHERE ACCESSIBLE TO TRAFFIC.

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	"MAIN SIZE" x 6" TEE (FL OUTLET)	6-B
2	6" 90° BEND, DUCTILE IRON (FL x FL)	6-C
3	6" RESILIENT WEDGE GATE VALVE (FLxMJ)	2-B
4	VALVE CAN (SEE STD. DWG. W-18)	13-F,G,H
5	6" PIPE (PE x PE)	1-C
6	LOCATING WIRE W/ CONNECTORS (IF REQ.)	10-A, 10-B
7	6" x 4" REDUCING 90° BEND (MJ x MJ)	6-C
8	4" PIPE, (FL x PE)	1-C
9	BREAK-OFF BOLTS	13-K
10	4" AIR AND VACUUM RELEASE VALVE (FLG'D)	11-C
11	(2) 2" 90° PVC SCH. 80 STREET BEND	6-F
12	AIR-VAC ENCLOSURE (SEE STD. DWG. W-27)	11-F
13	INSULATING BAG	11-G
14	SCREENED CAP	11-H
15	1/2" BALL VALVE (FIP x FIP) W/ NIPPLE	2-I

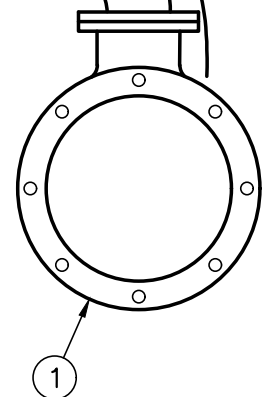


CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	STANDARD 4" AIR AND VACUUM RELEASE VALVE ASSEMBLY	W-26
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

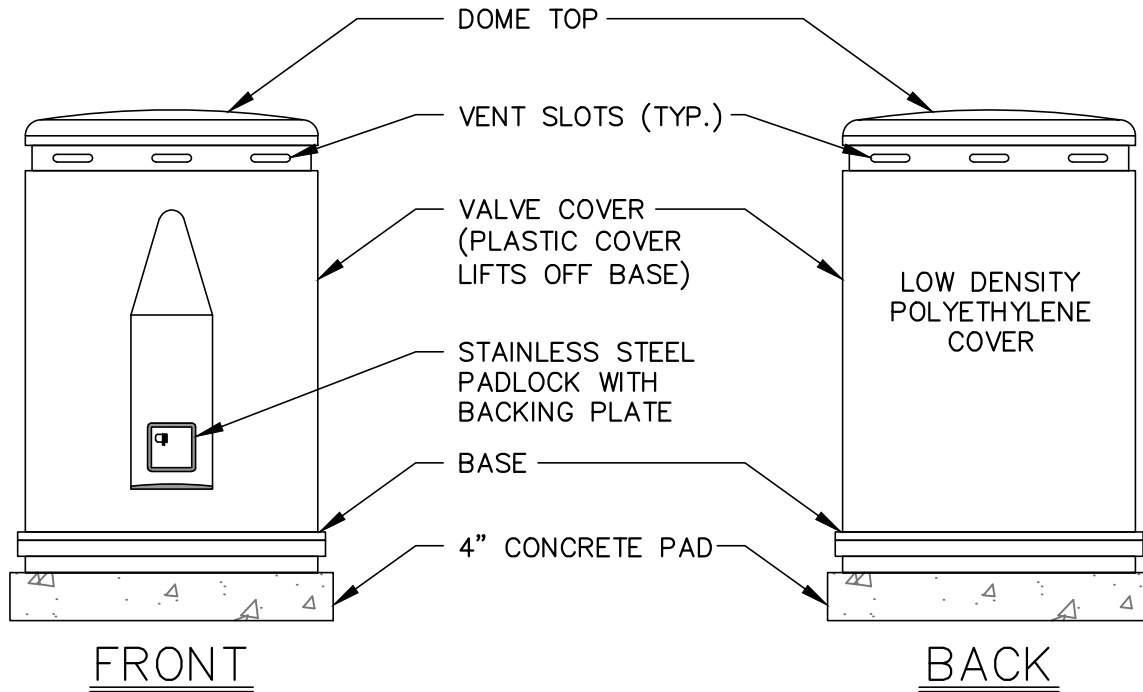

3-1/2" CONCRETE
ANCHORS WITH
BREAK AWAY BOLTS

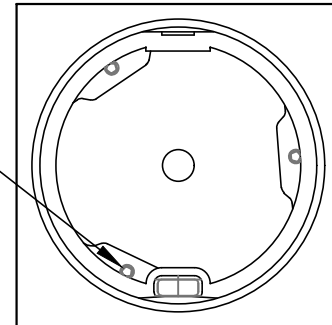


VALVE SIZE	DIAMETER A	HEIGHT B
1"	14"	24"
2"	18"	30"
4"	24"	36"

NOTE:
THIS ENCLOSURE SHALL BE SUPPLIED WITH A ZINC RICH
PRIMER AND RAL-1023 "SAFETY YELLOW" POLYESTER
POWDER COAT FINISH.

ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
	AIR & VACUUM VALVE ENCLOSURE		11-D, 11-E, 11-F
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	AIR & VACUUM ENCLOSURE	W-27
4/24/2026	B.K.		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. REDUCED PRESSURE DETECTOR ASSEMBLY SHALL BE INSTALLED IN A LOCATION APPROVED BY VWD AND THE FIRE DEPARTMENT HAVING JURISDICTION.
- B. REDUCED PRESSURE DETECTOR ASSEMBLY SHALL BE INSTALLED HORIZONTAL AND PLUMB.
- C. ASSEMBLIES MUST BE USC & CDPH APPROVED.
- D. RPBD MUST BE TESTED BY A CERTIFIED CITY BACKFLOW TESTER PRIOR TO WATER SERVICE BEING ACTIVATED. A COPY OF THE TEST MUST BE SUBMITTED TO THE INSPECTOR.
- E. ALL ASSEMBLIES 2 1/2" AND LARGER SHALL BE FLANGED OR VICTAULIC. LARGER SHALL BE FLANGED
- K. GUARD POSTS (PER STD. DWG. W-42) SHALL BE CONSTRUCTED WHERE APPURTENANCES ARE INSTALLED NOT ADJACENT TO PORTLAND CEMENT CONCRETE (PCC) CURB AND GUTTER.
- L. **ALL JOINTS TO BE RESTRAINED.**
(SEE ITEM 5 OF APPROVED MATERIALS LIST)

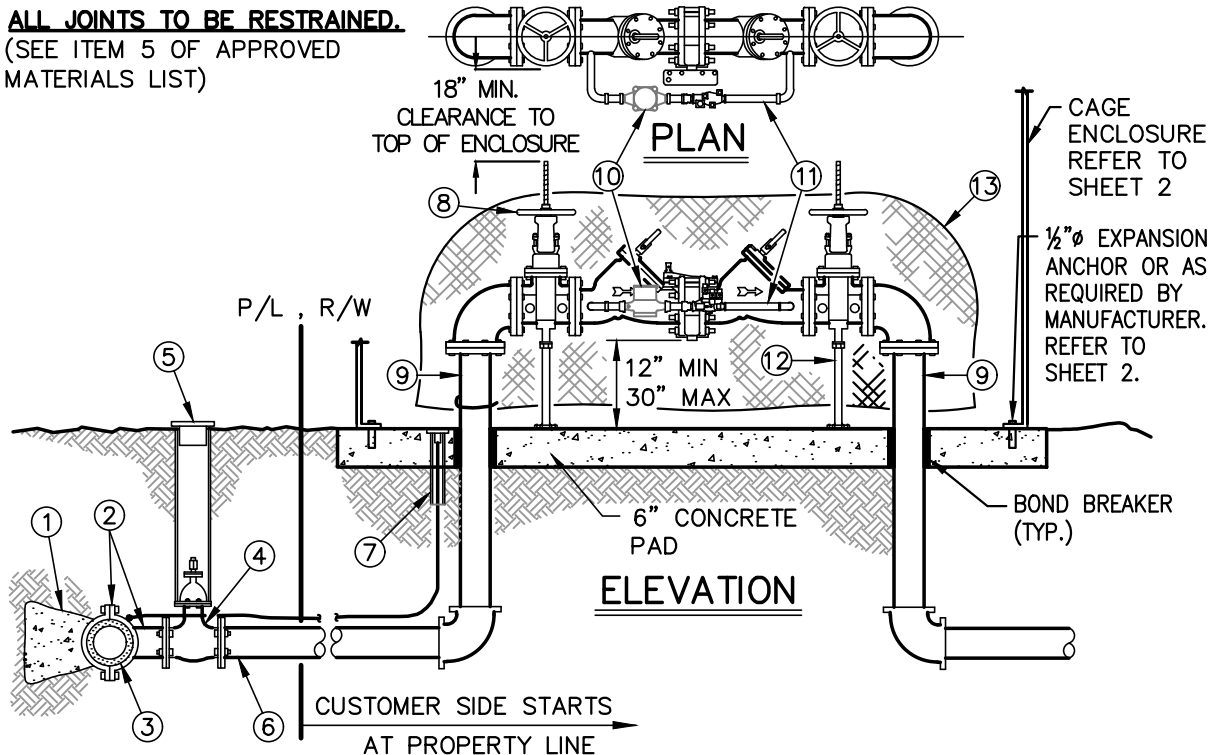


ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	THRUST BLOCK, AS REQUIRED	
2	TAPPING SLEEVE OR TEE	7-A
3	WATER MAIN	
4	RESILIENT WEDGE GATE VALVE (MIN. 6")	2-B
5	VALVE CAN & COVER PER STD. DWG. W-18	13-F,G,H
6	PIPE	1-A,B,C
7	SNAKEPIT MAGNETIZED TRACER BOX W/LOCATING WIRE WITH CONNECTORS 12AWG CCS, HDPE-INSULATED. (IF REQUIRED BY INSPECTOR)	10-A, 10-B, 10-C
8	REDUCED PRESSURE DETECTOR ASSEMBLY W/ OS&Y VALVES	12-A
9	PIPE	1-C
10	3/4-INCH BY-PASS METER (FURNISHED AND INSTALLED BY VWD)	13-C
11	BY-PASS LINE ASSEMBLY WITH RP BACKFLOW	4-A
12	ADJUSTABLE PIPE SUPPORT (REQUIRED FOR 6" & LARGER)	13-D
13	INSULATING BAG	4-B

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	FIRE SERVICE - REDUCED PRESSURE DETECTOR ASSEMBLY	W-28
4/24/2026	B.K.	<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	
			SHEET 1 OF 2

CAGE ENCLOSURE NOTES:

- A. THE CAGE ENCLOSURE SHALL FULLY COVER THE RPDA, INCLUDING SHUTOFF VALVES, BYPASS ASSEMBLY, AND TEST PORTS.
- B. THE ENCLOSURE SHALL BE DESIGNED TO ALLOW UNOBSTRUCTED ACCESS FOR REQUIRED TESTING AND MAINTENANCE IN ACCORDANCE WITH AWWA AND LOCAL WATER DISTRICT STANDARDS.
- C. THE CAGE SHALL NOT INTERFERE WITH OPERATION, READING OF THE BYPASS METER, OR DISCHARGE FROM THE RELIEF VALVE.
- D. ALL EDGES OF ENCLOSURE SHALL BE GROUND SMOOTH, FREE FROM BURRS AND SHARP PROJECTIONS.
- E. ENCLOSURE SHALL BE DESIGNED SO THAT THE RPDA RELIEF VALVE CAN DISCHARGE WITHOUT OBSTRUCTION OR DAMAGE TO THE CAGE.
- F. ENCLOSURE SHALL NOT OBSTRUCT REQUIRED CLEARANCES MANDATED BY FIRE CODE.
- G. ENCLOSURE SHALL BE FIELD-VERIFIED FOR PROPER FIT OVER RPDA BEFORE ANCHORING.
- H. INSTALLATION SHALL COMPLY WITH MANUFACTURER RECOMMENDATIONS, DISTRICT STANDARDS, AND CHAPTER 10.06 – VICTORVILLE WATER DISTRICT BACKFLOW AND CROSS-CONNECTIONS DIVISION.
- G. ENCLOSURE SHALL DISPLAY A PERMANENT IDENTIFICATION TAG OR STENCIL: "BACKFLOW PREVENTER – DO NOT BLOCK" AND "ADDRESS" IN LETTERS AT LEAST 1" HIGH AND ON TWO SIDE OF THE CAGE.
- H. PROVIDE A MINIMUM 12" CLEARANCE ON ALL SIDES OF THE DEVICE AND 18" VERTICAL CLEARANCE ABOVE THE HIGHEST POINT OF REDUCED PRESSURE DEVICE ASSEMBLY.
- I. TOP OF ENCLOSURE SHALL BE HINGED OR REMOVABLE TO ALLOW FOR EQUIPMENT REMOVAL AND REPLACEMENT.
- J. CAGE COLOR SHALL BE GREEN, LIGHT IVORY, OR AS APPROVED BY THE CITY/DISTRICT.

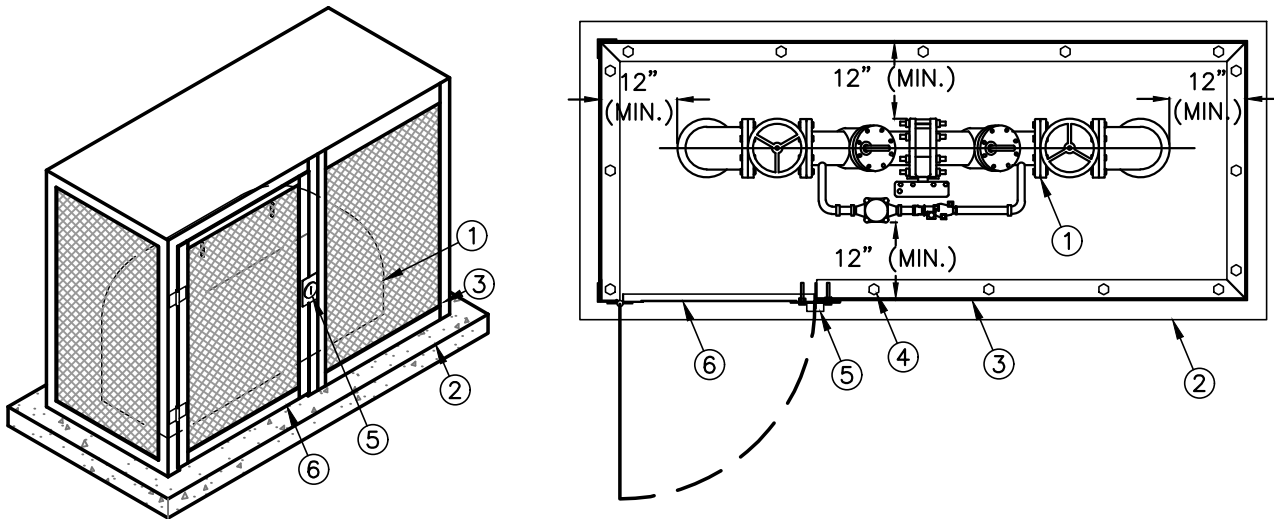

ITEM	DESCRIPTION		
1	REDUCED PRESSURE DETECTOR ASSEMBLY		
2	ENCLOSURE SHALL BE ANCHORED TO A PERMANENT 6"W THICK CONCRETE PAD		
3	ENCLOSURE CONSTRUCTED OF SQUARE TUBING OR ANGLE IRON W/ 11-GAUGE METAL MESH.		
4	SECURE ENCLOSURE TO 6" CONCRETE CURB WITH ½"Ø EXPANSION ANCHOR W/ 3" EMBEDMENT MINIMUM. 2 PER SIDE, MAXIMUM 36"O.C. SPACING, AS REQUIRED BY MANUFACTURER.		
5	HOCKY PUCK PADLOCK (OR EQUIVALENT LOCKING MECHANISM) SECURE W/ ¼" MACHINE BOLTS W/ LOCK WASHERS OR PER MANUFACTURE RECOMMENDATIONS.		
6	30" WIDE DOOR/GATE, HINGED AND OUTWARD SWINGING. CONSTRUCTED OF 3"x1"x¾" ANGLE IRON W/ 11-GA. METAL MESH STEEL.		
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	FIRE SERVICE - REDUCED PRESSURE DETECTOR ASSEMBLY	W-28
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 2 OF 2




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	BLANK INTENTIONALLY	W-29
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:


- A. REDUCED PRESSURE BACKFLOW ASSEMBLY SHALL BE INSTALLED IN A LOCATION APPROVED BY VWD.
- B. REDUCED PRESSURE BACKFLOW ASSEMBLY SHALL BE INSTALLED HORIZONTAL AND PLUMB.
- C. ASSEMBLIES MUST BE USC & CDPH APPROVED.
- D. RPBD MUST BE TESTED BY A CERTIFIED CITY BACKFLOW TESTER PRIOR TO WATER SERVICE BEING ACTIVATED. A COPY OF THE TEST MUST BE SUBMITTED TO THE INSPECTOR.
- E. ALL ASSEMBLIES 3" AND LARGER SHALL BE FLANGED OR VICTAULIC.
- F. GUARD POSTS (PER STD. DWG. W-42) SHALL BE CONSTRUCTED WHERE APPURTENANCES ARE INSTALLED NOT ADJACENT TO PORTLAND CEMENT CONCRETE (PCC) CURB AND GUTTER.
- G. ALL JOINTS TO BE RESTRAINED. (SEE ITEM 5 OF APPROVED MATERIALS LIST)

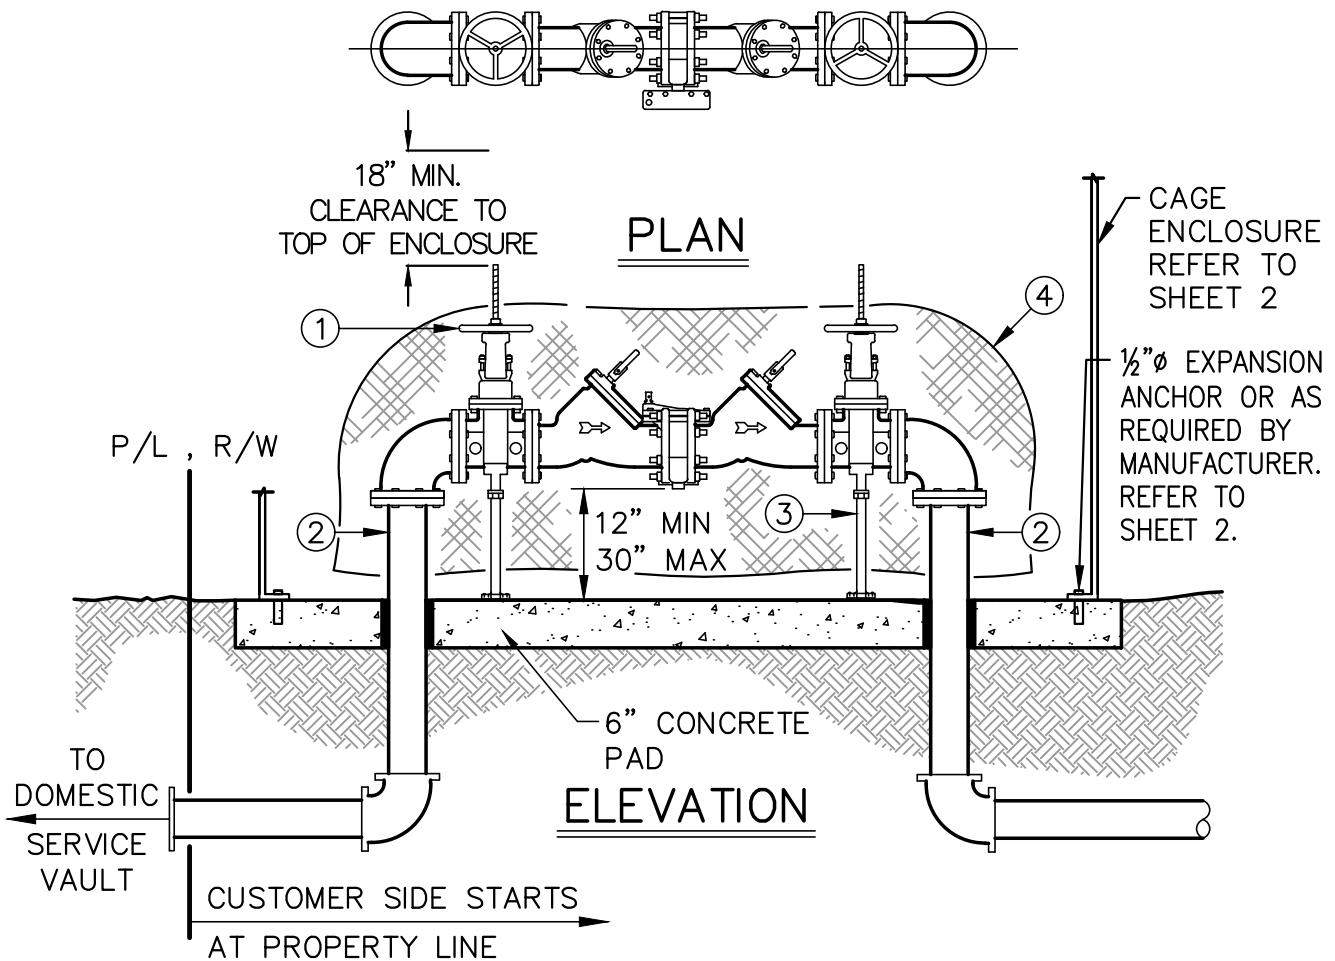



ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	REDUCED PRESSURE ASSEMBLY		12-A
2	PIPE, SAME SIZE AS METER SERVICE LINE		1-C
3	ADJUSTABLE PIPE SUPPORT (REQUIRED FOR 6" & LARGER)		13-C
4	INSULATING BAG		4-B
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	3" & LARGER - REDUCED PRESSURE BACKFLOW DEVICE INSTALLATION	W-30
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 2

CAGE ENCLOSURE NOTES:

- A. THE CAGE ENCLOSURE SHALL FULLY COVER THE RPDA, INCLUDING SHUTOFF VALVES, BYPASS ASSEMBLY, AND TEST PORTS.
- B. THE ENCLOSURE SHALL BE DESIGNED TO ALLOW UNOBSTRUCTED ACCESS FOR REQUIRED TESTING AND MAINTENANCE IN ACCORDANCE WITH AWWA AND LOCAL WATER DISTRICT STANDARDS.
- C. THE CAGE SHALL NOT INTERFERE WITH OPERATION, READING OF THE BYPASS METER, OR DISCHARGE FROM THE RELIEF VALVE.
- D. ALL EDGES OF ENCLOSURE SHALL BE GROUND SMOOTH, FREE FROM BURRS AND SHARP PROJECTIONS.
- E. ENCLOSURE SHALL BE DESIGNED SO THAT THE RPDA RELIEF VALVE CAN DISCHARGE WITHOUT OBSTRUCTION OR DAMAGE TO THE CAGE.
- F. ENCLOSURE SHALL NOT OBSTRUCT REQUIRED CLEARANCES MANDATED BY FIRE CODE.
- G. ENCLOSURE SHALL BE FIELD-VERIFIED FOR PROPER FIT OVER RPDA BEFORE ANCHORING.
- H. INSTALLATION SHALL COMPLY WITH MANUFACTURER RECOMMENDATIONS, DISTRICT STANDARDS, AND CHAPTER 10.06 – VICTORVILLE WATER DISTRICT BACKFLOW AND CROSS-CONNECTIONS DIVISION.
- G. ENCLOSURE SHALL DISPLAY A PERMANENT IDENTIFICATION TAG OR STENCIL: "BACKFLOW PREVENTER – DO NOT BLOCK" AND "ADDRESS" IN LETTERS AT LEASE 1" HIGH AND ON TWO SIDE OF THE CAGE.
- H. PROVIDE A MINIMUM 12" CLEARANCE ON ALL SIDES OF THE DEVICE AND 18" VERTICAL CLEARANCE ABOVE THE HIGHEST POINT OF REDUCED PRESSURE DEVICE ASSEMBLY.
- I. TOP OF ENCLOSURE SHALL BE HINGED OR REMOVABLE TO ALLOW FOR EQUIPMENT REMOVAL AND REPLACEMENT.
- J. CAGE COLOR SHALL BE GREEN, LIGHT IVORY, OR AS APPROVED BY THE CITY/DISTRICT.

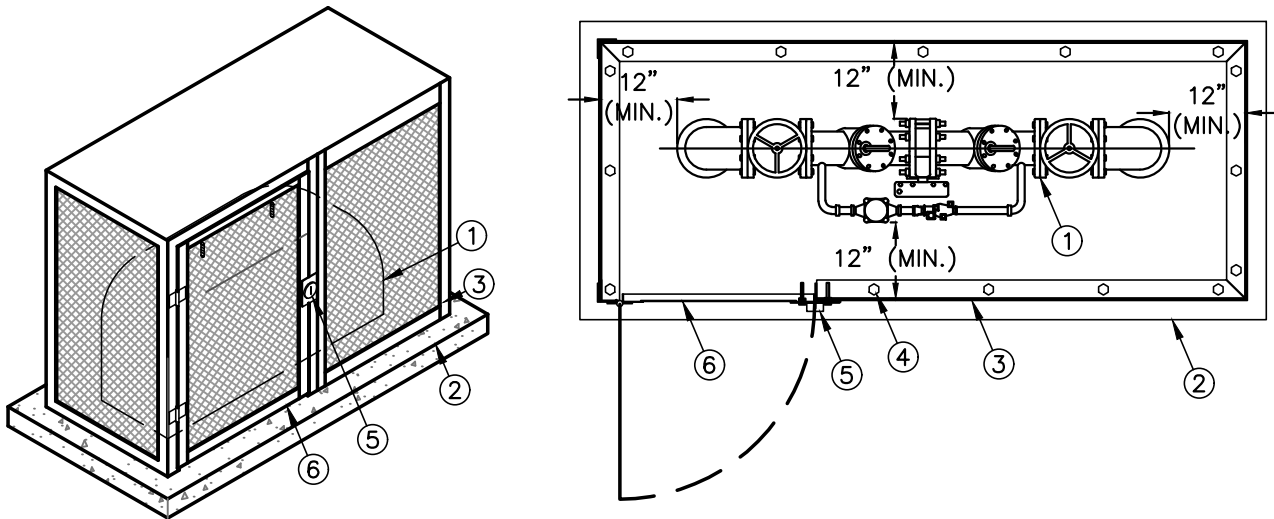

ITEM	DESCRIPTION		
1	REDUCED PRESSURE DETECTOR ASSEMBLY		
2	ENCLOSURE SHALL BE ANCHORED TO A PERMANENT 6"W THICK CONCRETE PAD		
3	ENCLOSURE CONSTRUCTED OF SQUARE TUBING OR ANGLE IRON W/ 11-GAUGE METAL MESH.		
4	SECURE ENCLOSURE TO 6" CONCRETE CURB WITH ½"Ø EXPANSION ANCHOR W/ 3" EMBEDMENT MINIMUM. 2 PER SIDE, MAXIMUM 36"O.C. SPACING, AS REQUIRED BY MANUFACTURER.		
5	HOCKY PUCK PADLOCK (OR EQUIVALENT LOCKING MECHANISM) SECURE W/ ¼" MACHINE BOLTS W/ LOCK WASHERS OR PER MANUFACTURE RECOMMENDATIONS.		
6	30" WIDE DOOR/GATE, HINGED AND OUTWARD SWINGING. CONSTRUCTED OF 3"x1"x 3 ₁₆ " ANGLE IRON W/ 11-GA. METAL MESH STEEL.		
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	3" & LARGER - REDUCED PRESSURE BACKFLOW DEVICE INSTALLATION	W-30
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 2 OF 2

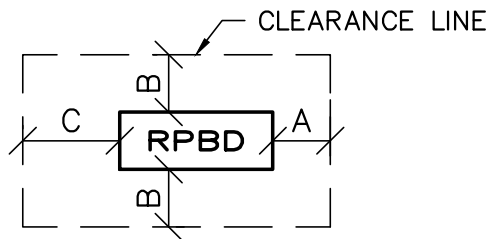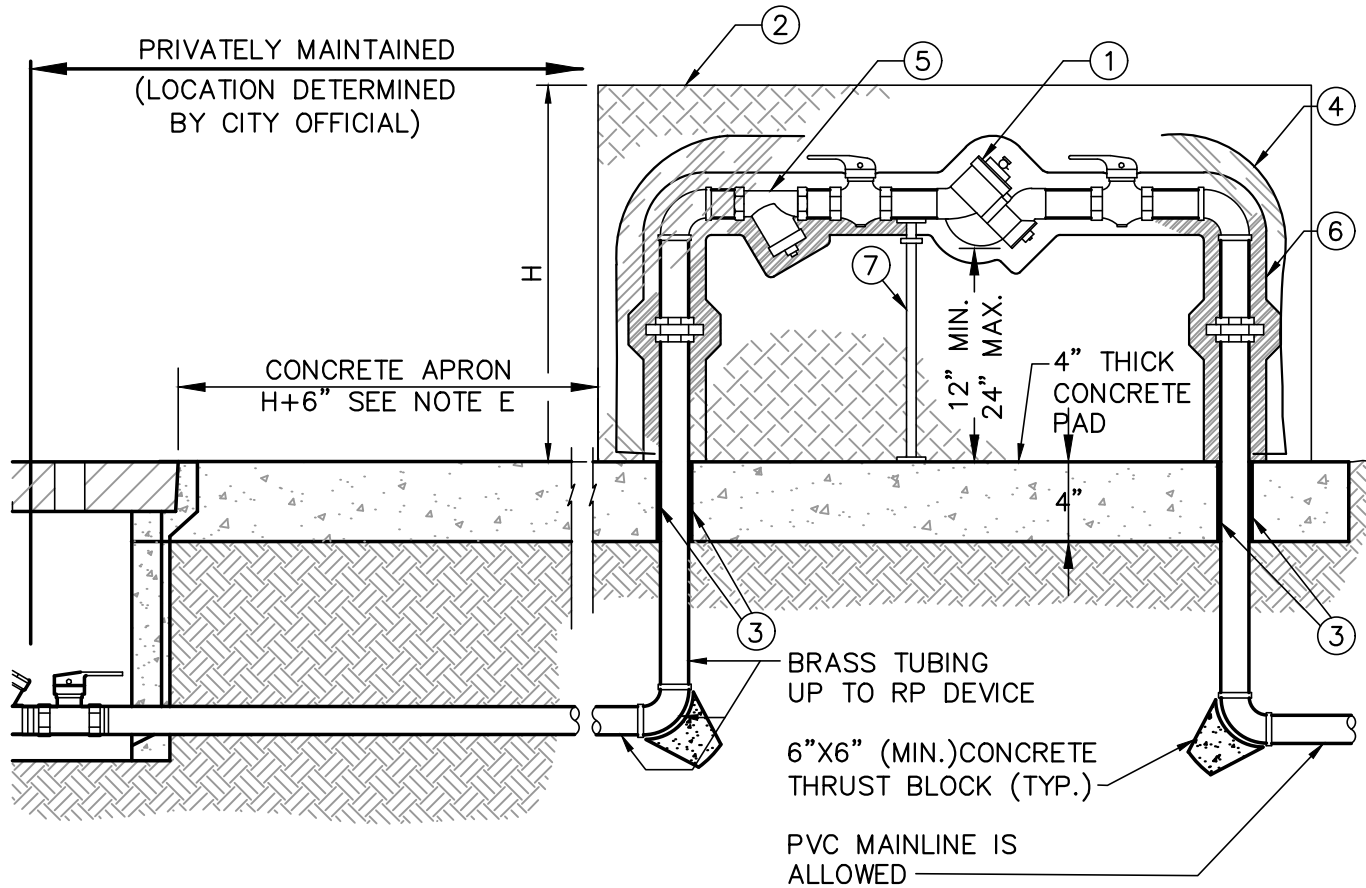

MINIMUM CLEARANCE

SIZE	A	B	C
3/4" - 2"	12"	12"	H+6"

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION DEVICE, SEE NOTE B & I*	4-D
2	ALL-SPEC SECURITY BACKFLOW ENCLOSURE, SEE NOTE F*	4-C
3	BOND BREAKER	13-E
4	INSULATING BAG	4-B
5	LOW LEAD BRASS WYE STRAINER WITH 150 MESH SCREEN, SEE NOTE H* (APPROVED BY PUBLIC WORKS LMAD)	---
6	UV RESISTANT FLEXIBLE ELASTOMERIC CLOSED-CELL THERMAL INSULATION SEE NOTE G*	---
7	OPTIONAL PIPE SUPPORT	---

*SEE SHEET 2 FOR NOTES

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	LMAD BACKFLOW DEVICE INSTALLATION	W-31
4/24/2026	B.K.		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 2

NOTES:

- A. RP AND PIPING SHALL BE AT LEAST THE SAME DIAMETER AS THE METER.
- B. BACKFLOW DEVICE SHALL BE LEAD FREE ZURN-WILKINS 375-XLB OR APPROVED EQUAL.
- C. BRASS PRESSURE REGULATOR INSTALLED WHEN PRESSURE IS GREATER THAN 60 PSI.
- D. RP SHALL BE LOCATED AS CLOSE TO THE METER AS POSSIBLE. LOCATION SHALL BE APPROVED BY INSPECTOR.
- E. NO CONNECTIONS OF ANY KIND WILL BE ALLOWED IN THIS AREA. INSPECTION BY THE CITY SHALL TAKE PLACE PRIOR TO BACKFILL.
- F. CONCRETE PAD 4" WITH (ALL-SPEC) BACKFLOW ENCLOSURE PART NO. BFE-5430 FOR 2" DEVICE AND BFED-6036 FOR 2 1/2" DEVICE.
- G. FREEZE PROTECTION SHALL BE PROVIDED WITH PIPE INSULATION WRAP AND FREEZE PROTECTION BLANKET WITH MINIMUM R-30 RATING.
- H. WYE STRAINER REQUIRED TO BE INSTALLED BEFORE REDUCED PRESSURES BACKFLOW DEVICE 2" OR SMALLER.
- I. RP MUST BE TESTED BY A CERTIFIED CITY BACKFLOW TESTER PRIOR TO WATER SERVICE BEING ACTIVATED. A COPY OF THE TEST MUST BE SUBMITTED TO THE INSPECTOR.
- J. PROVIDE PRESSURE REGULATOR AS REQUIRED.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	LMAD BACKFLOW DEVICE INSTALLATION	W-31
4/24/2026	B.K.		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 2 OF 2




CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	BLANK INTENTIONALLY	W-32
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- A. FOR VAULT AND PIPING LAYOUT, SEE APPLICABLE STANDARD DRAWINGS.
- B. A JOINT SEALING COMPOUND SHALL BE USED AT ALL JOINTS.
- C. TRAFFIC RATED LID MAY BE REQUIRED.
- D. MINIMUM VAULT LID DIMENSION FOR VAULTS UP TO 5' WIDE AND 9' LONG SHALL BE 4' X 6'.

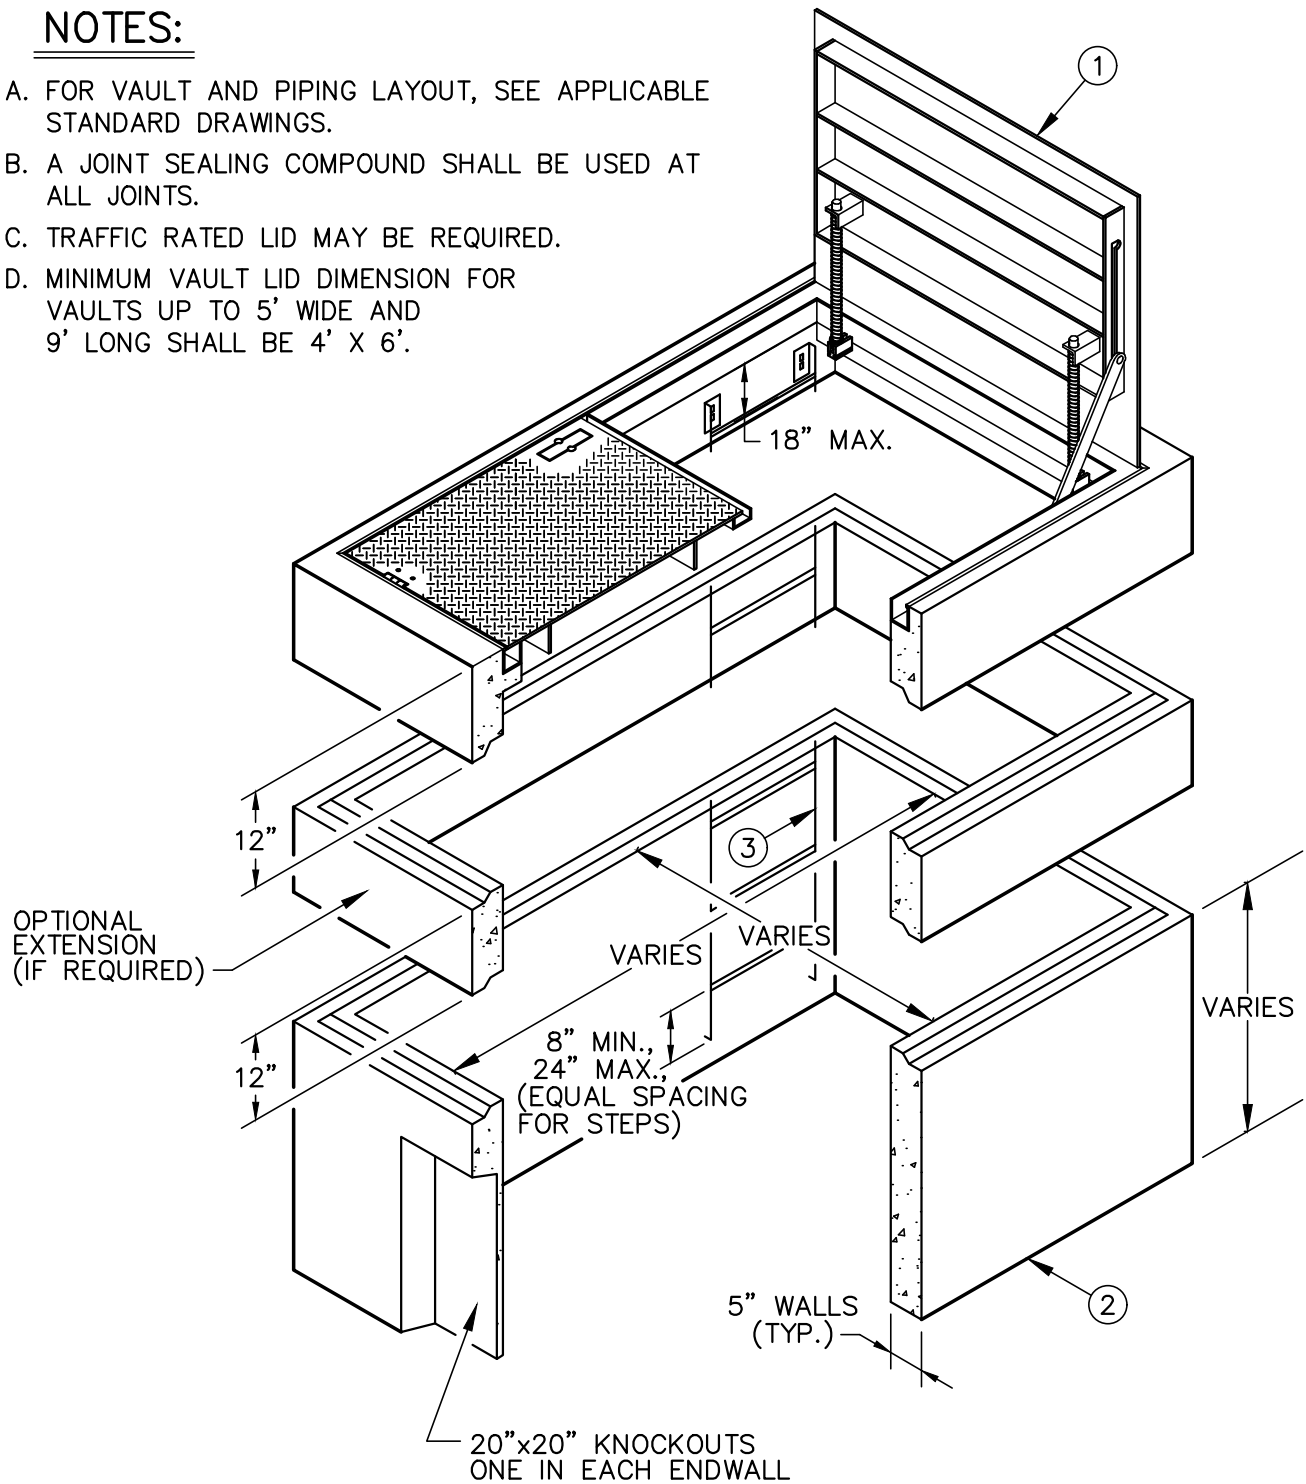

ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	VAULT LID		9-B, 9-C
2	VAULT BOX		9-A
3	LADDER		9-F
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	VAULT AND LID	W-33
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

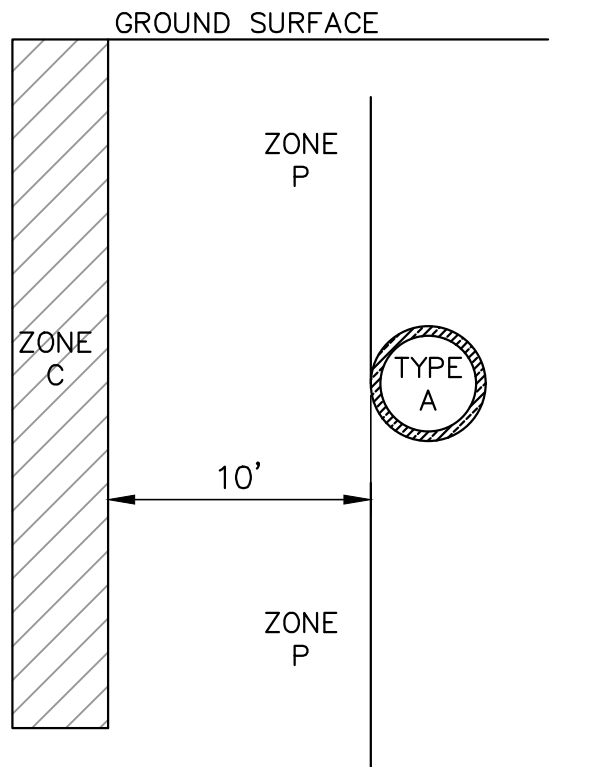

PIPE CONVEYANCE TYPE A FLUID

CCR, TITLE 22 SECTION 64572(A)


1. UNTREATED SEWAGE
PRIMARY OR SECONDARY
2. TREATED SEWAGE
DISINFECTED SECONDARY-22
3. RECYCLED WATER
4. DISINFECTED SECONDARY-23
RECYCLED WATER
5. HAZARDOUS FLUIDS

LEGEND

ZONE SPECIAL CONSTRUCTION
P CONSTRUCTION PROHIBITED

R CONSTRUCTION RESTRICTED
(APPROVAL REQUIRED BY SWRCB DIVISION OF DRINKING WATER)

C PVC C-900 DR-14 CLASS 305, C-909 CLASS 305, D.I.P. CLASS 350

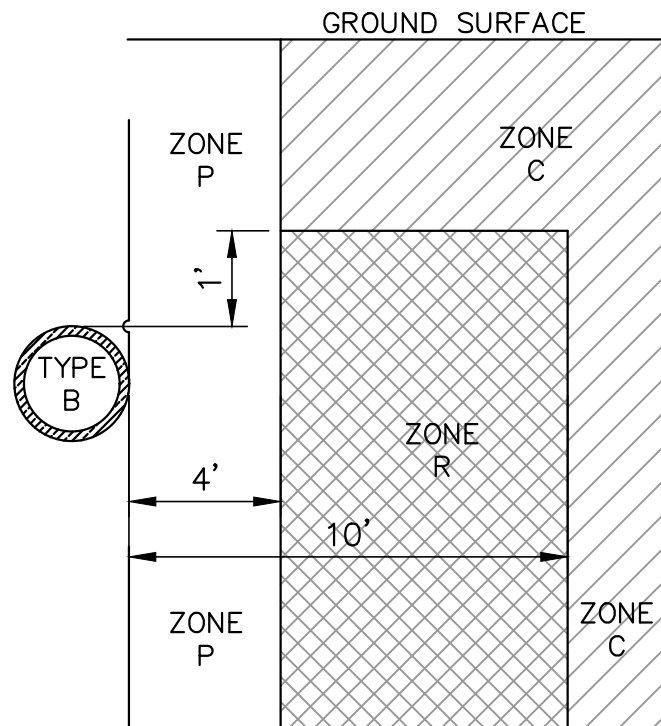

PIPE CONVEYANCE TYPE B FLUID

CCR, TITLE 22 SECTION 64572(B)


1. DISINFECTED TERTIARY RECYCLED
WATER
2. STORM DRAINAGE

NOTE:

IF THE SEPARATION CRITERIA AS LISTED
HEREIN CANNOT BE MET; APPROVAL FOR
CALIFORNIA STATE WATER BOARD'S DIVISION
OF DRINKING WATER (DDW) SHALL BE
OBTAINED AND SUBMITTED TO THE CITY OF
VICTORVILLE PRIOR TO CONSTRUCTION.
VICTORVILLE WATER SYSTEM ID IS:
CA3610052: DISTRICT 13. SAN BERNARDINO.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	PARALLEL SEPARATION CRITERIA FOR WATER MAINS FROM SANITARY SEWERS OR STORM DRAINS	W-34
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

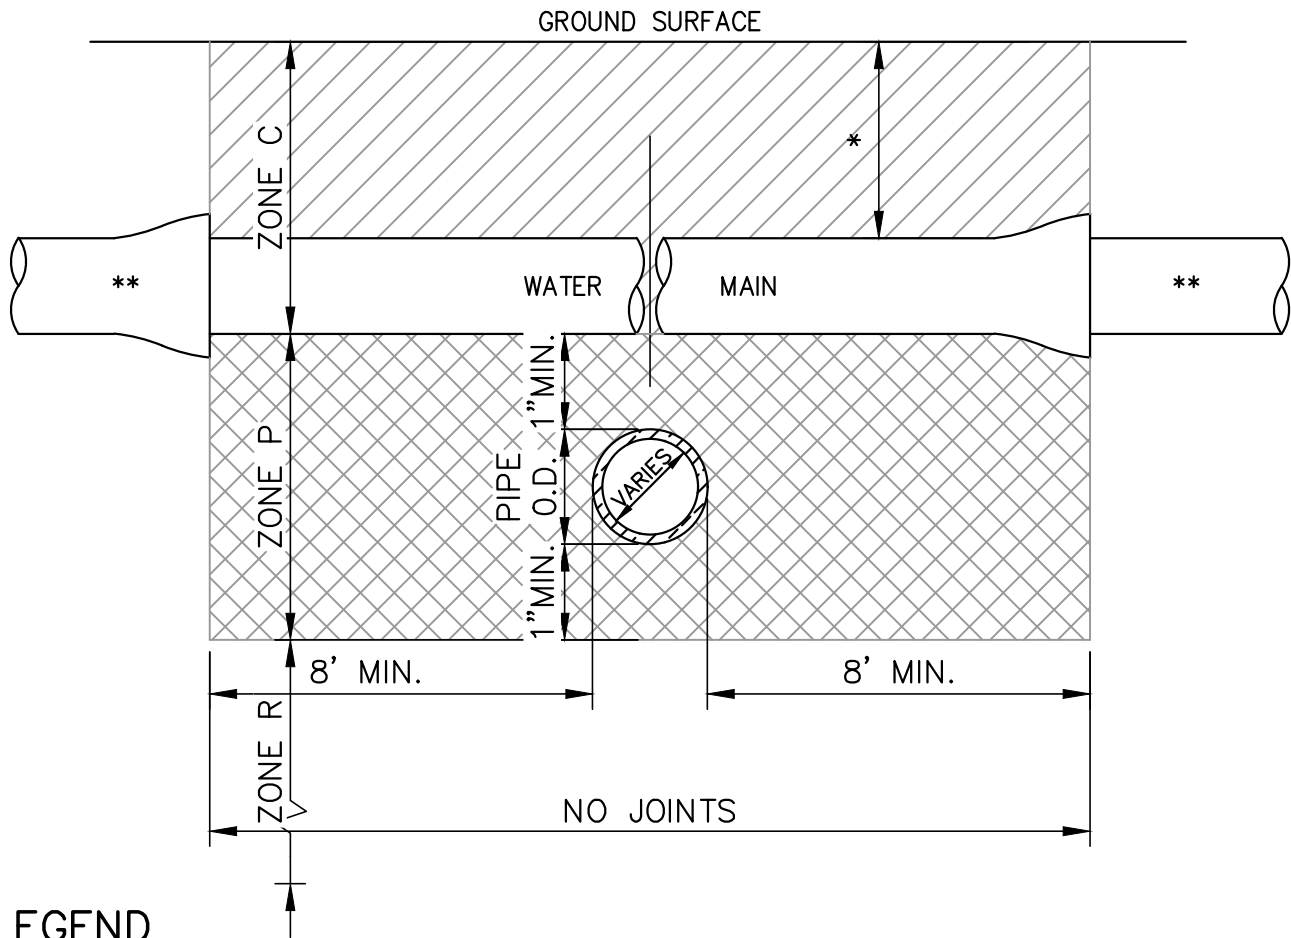

LEGEND

ZONE	SPECIAL CONSTRUCTION
C	PVC C-900 DR -14 CLASS 305, C-909 CLASS 305, D.I.P. CLASS 350
R	CONSTRUCTION RESTRICTED (APPROVAL REQUIRED BY SWRCB DIVISION OF DRINKING WATER)
P	CONSTRUCTION PROHIBITED
*	O.D. $\leq 12"$ – MINIMUM COVER REQUIRED 36" UNDER PAVEMENT, 42" UNDER UNCOVERED SURFACE. O.D. $> 12"$ – MINIMUM COVER REQUIRED 42" UNDER PAVEMENT, 48" UNDER UNCOVERED SURFACE
**	WATER MAIN CROSSING SHALL BE MADE PERPENDICULAR TO AND NO LESS THAN 45-DEGREES TO PIPELINE

NOTE:


IF THE SEPARATION CRITERIA AS LISTED HEREIN CANNOT BE MET; APPROVAL FOR CALIFORNIA STATE WATER BOARD'S DIVISION OF DRINKING WATER (DDW) SHALL BE OBTAINED AND SUBMITTED TO THE CITY OF VICTORVILLE PRIOR TO CONSTRUCTION. VICTORVILLE WATER SYSTEM ID IS:
CA3610052; DISTRICT 13, SAN BERNARDINO.

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	SEPARATION CRITERIA FOR WATER MAINS FROM SANITARY SEWERS OR STORM DRAINS	W-35
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:


- A. TRENCH PATH SHALL BE STRAIGHT GRADE ACROSS WIDTH, AND SHALL NOT BE CURVED AT CENTER.
- B. BACKFILL MATERIAL WITHIN PIPE ZONE SHALL HAVE SAND EQUIVALENT ≥ 30 . SELECT MATERIAL FROM EXCAVATION MAY BE USED ONLY WITH APPROVAL FROM INSPECTOR.
- C. PIPE ZONE MATERIAL SHALL BE JETTED.

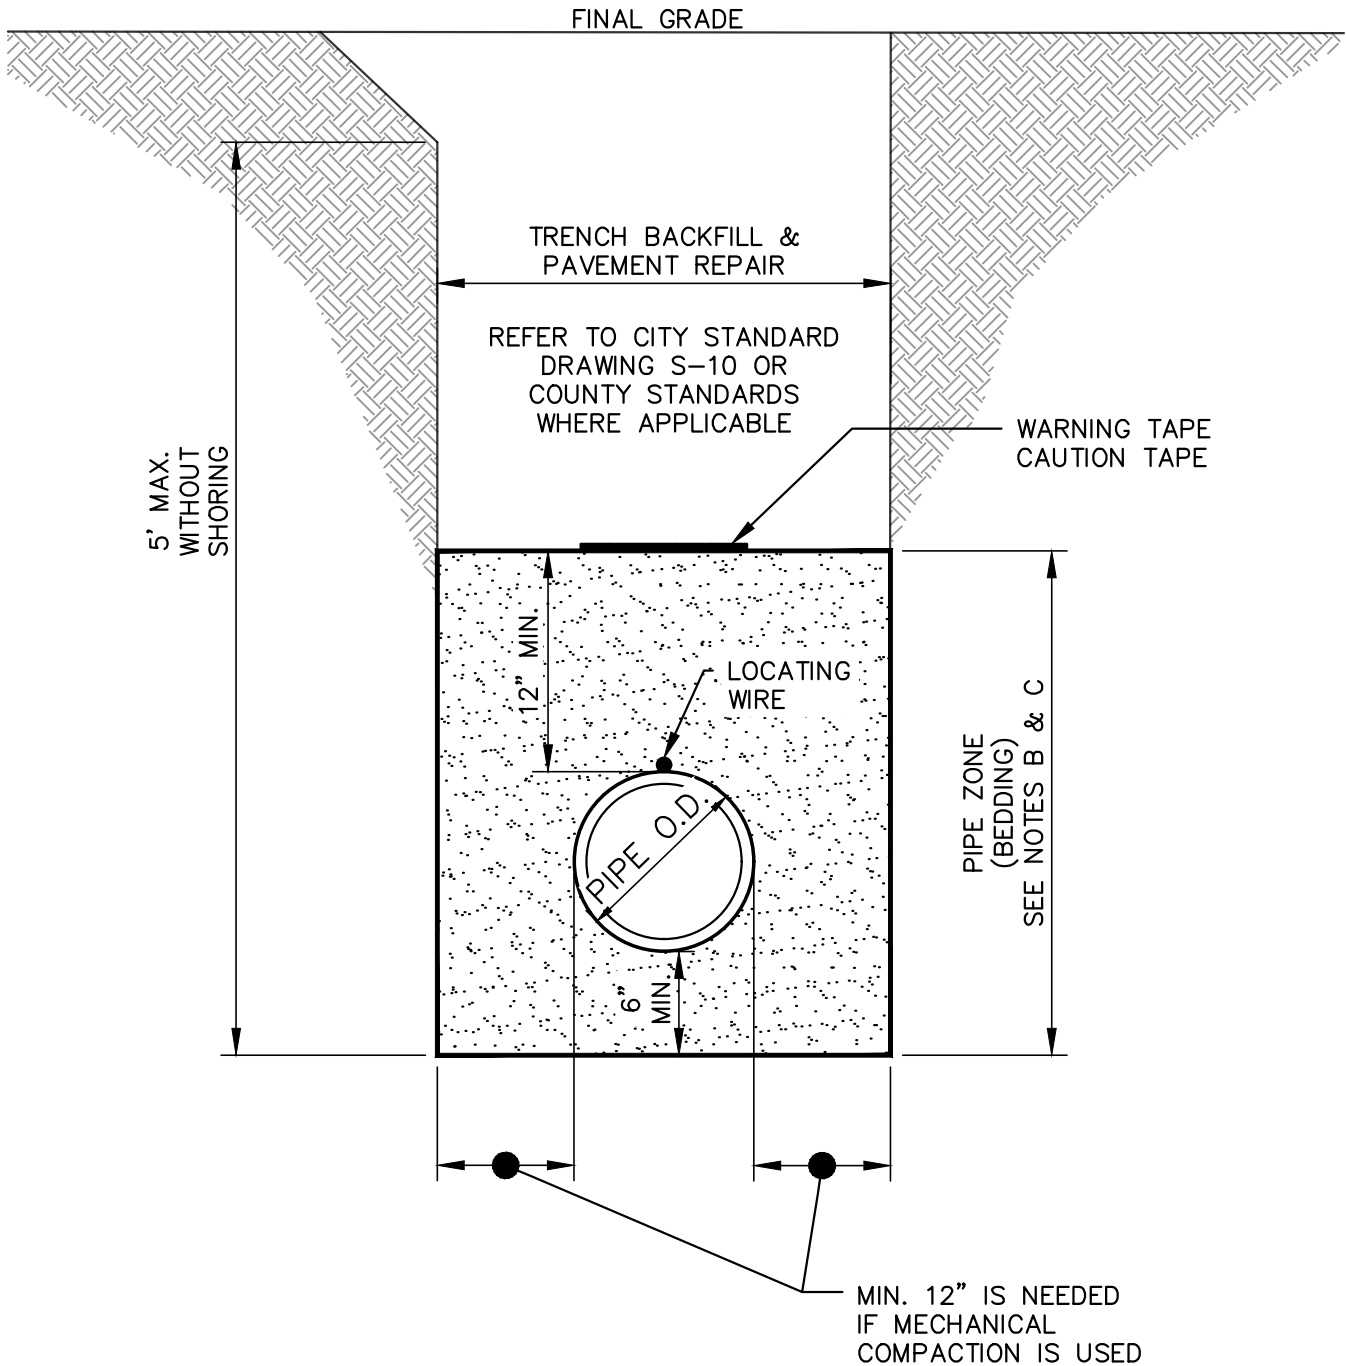

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	TYPICAL TRENCH / PIPE ZONE BACKFILL SCHEMATIC	W-36
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:


1. WHEREVER POSSIBLE, WATERLINE SHOULD BE INSTALLED OVER TOP OF SEWER OR STORM DRAIN. IF WATER MAIN UNDERCROSSING IS REQUIRED DISCUSS MINIMUM COVER REQUIREMENTS WITH THE CITY. IN ADDITION; IF WATER MAIN UNDERCROSSING IS REQUIRED DUE TO HYDRAULIC LIMITING FACTORS, APPROVAL OF EACH UNDERCROSSING SHALL BE OBTAINED FROM CALIFORNIA STATE WATER BOARD'S DIVISION OF DRINKING WATER (DDW). VICTORVILLE WATER SYSTEM DISTRICT ID IS CA3610052; DISTRICT 13, SAN BERNARDINO. APPROVAL SHALL BE SUBMITTED TO THE CITY OF VICTORVILLE PRIOR TO CONSTRUCTION
2. THIS STANDARD APPLIES TO UNDERCROSSINGS OF STORM DRAINS & SEWERS LESS THAN 6'-0" IN DIAMETER OR WIDTH, OR AS DIRECTED BY THE CITY. FOR LARGER UNDERCROSSINGS, REFER TO STANDARD DRAWING W-38.
3. PIPE ENDS SHALL BE FLANGED AND WELDED LAP JOINTS.
4. CITY MAY REQUIRE INSTALLATION OF AN AIR-VAC RELEASE VALVE ASSEMBLY AT THE HIGH POINT AND A BLOW OFF ASSEMBLY AT THE LOW POINT PER APPLICABLE CITY STANDARD DRAWINGS.

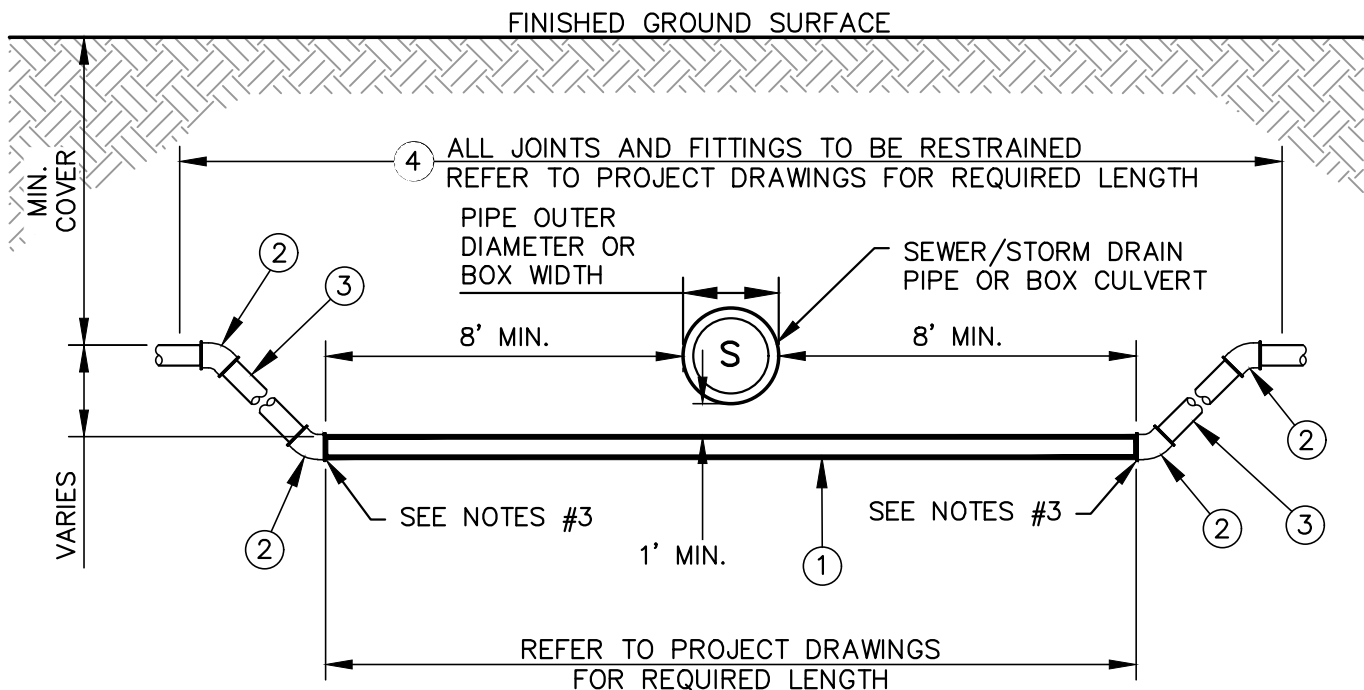

ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	CEMENT MORTAR LINED AND COATED STEEL PIPE		1—F
2	45° BEND		6—C
3	DUCTILE IRON PIPE		1—C
4	JOINT RESTRAINTS		5—A, B, C
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	WATER MAINS UNDERCROSSING SEWER AND STORM DRAIN CEMENT MORTAR LINED AND COATED (CML&C) STEEL PIPE	W-37
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

1. WHEREVER POSSIBLE, WATERLINE SHOULD BE INSTALLED OVER TOP OF SEWER OR STORM DRAIN. IF WATER MAIN UNDERCROSSING IS REQUIRED DISCUSS MINIMUM COVER REQUIREMENTS WITH THE CITY. IN ADDITION; IF WATER MAIN UNDERCROSSING IS REQUIRED DUE TO HYDRAULIC LIMITING FACTORS, APPROVAL OF EACH UNDERCROSSING SHALL BE OBTAINED FROM CALIFORNIA STATE WATER BOARD'S DIVISION OF DRINKING WATER (DDW). VICTORVILLE WATER SYSTEM DISTRICT ID IS CA3610052; DISTRICT 13, SAN BERNARDINO. APPROVAL SHALL BE SUBMITTED TO THE CITY OF VICTORVILLE PRIOR TO CONSTRUCTION.
2. THIS STANDARD APPLIES TO UNDERCROSSINGS OF SEWERS AND STORM DRAINS GREATER THAN 6'-0" IN DIAMETER OR WIDTH, OR AS DIRECTED BY THE CITY.
3. INSTALL CASING SPACERS WITHIN 1' FROM EACH END OF THE CASING AND 1' FROM EACH BELL JOINT AND AT THE CENTER OF EACH PIPE JOINT. CONSULT MANUFACTURER FOR RECOMMENDED SPACER SIZE.
4. CITY MAY REQUIRE INSTALLATION OF AN AIR-VAC RELEASE VALVE ASSEMBLY AT THE HIGH POINT AND A BLOW OFF ASSEMBLY AT THE LOW POINT PER APPLICABLE CITY STANDARD DRAWINGS.

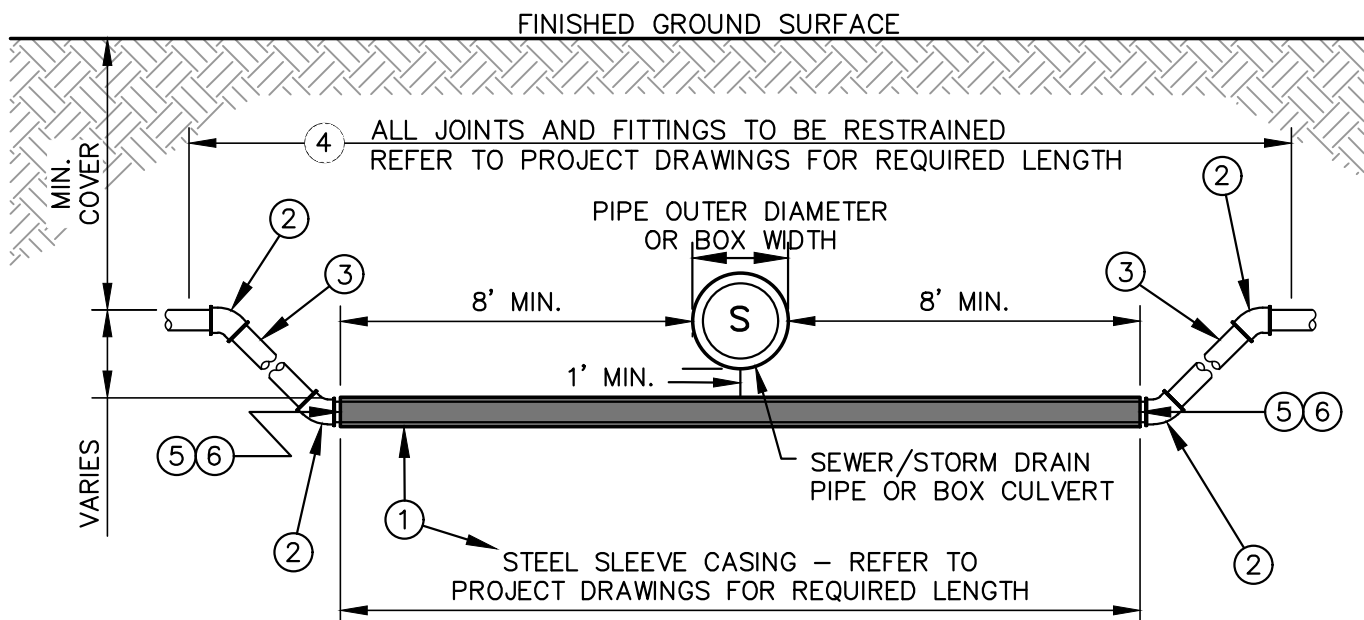

WATER MAIN SIZE	MIN. SLEEVE SIZE / WALL THKNS	WATER MAIN SIZE	MIN. SLEEVE SIZE / WALL THKNS
8"	18" / .25"	18"	30" / .25"
12"	18" / .25"	20"	36" / .375"
16"	30" / .25"	24"	36" / .375"


ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	STEEL CASING	8-B
2	45° BEND	6-C
3	DUCTILE IRON PIPE	1-C
4	JOINT RESTRAINTS	5-A, B, C
5	CASING SPACERS	8-A
6	END SEAL	8-C

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV. DATE	BY	WATER MAINS UNDERCROSSING SEWER AND STORM DRAIN - STEEL SLEEVE CASING	W-38
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:


- RP AND PIPING SHALL BE AT LEAST THE SAME DIAMETER AS THE METER.
- PLACE BOTTOM OF VALVE A MINIMUM OF 12" AND A MAXIMUM OF 24" ABOVE FINISHED GRADE. FOLLOW MANUFACTURES SPECIFICATIONS FOR PLACEMENT IN RESIDENTIAL APPLICATIONS.
- CUSTOMER SHALL PROTECT DEVICE FROM FREEZING AND MAINTAIN ACCESS FOR TESTING. ACCESS BOX IS REQUIRED IN RESIDENTIAL APPLICATIONS.
- RP SHALL BE LOCATED AS CLOSE TO THE METER AS POSSIBLE ON PRIVATE PROPERTY AND SHALL BE READILY ACCESSIBLE AT ALL TIMES (i.e., OUTSIDE OF PERIMETER FENCE OR BLOCK WALL). LOCATION SHALL BE APPROVED BY INSPECTOR.
- NO CONNECTIONS OF ANY KIND WILL BE ALLOWED IN THIS AREA. INSPECTION BY THE CITY SHALL TAKE PLACE PRIOR TO BACKFILL.
- RPBD MUST BE TESTED BY A CERTIFIED CITY BACKFLOW TESTER PRIOR TO WATER SERVICE BEING ACTIVATED. A COPY OF THE TEST MUST BE SUBMITTED TO THE INSPECTOR.
- WHEN PRESSURE IS 80 PSI, A PRESSURE REGULATOR MUST BE INSTALLED.

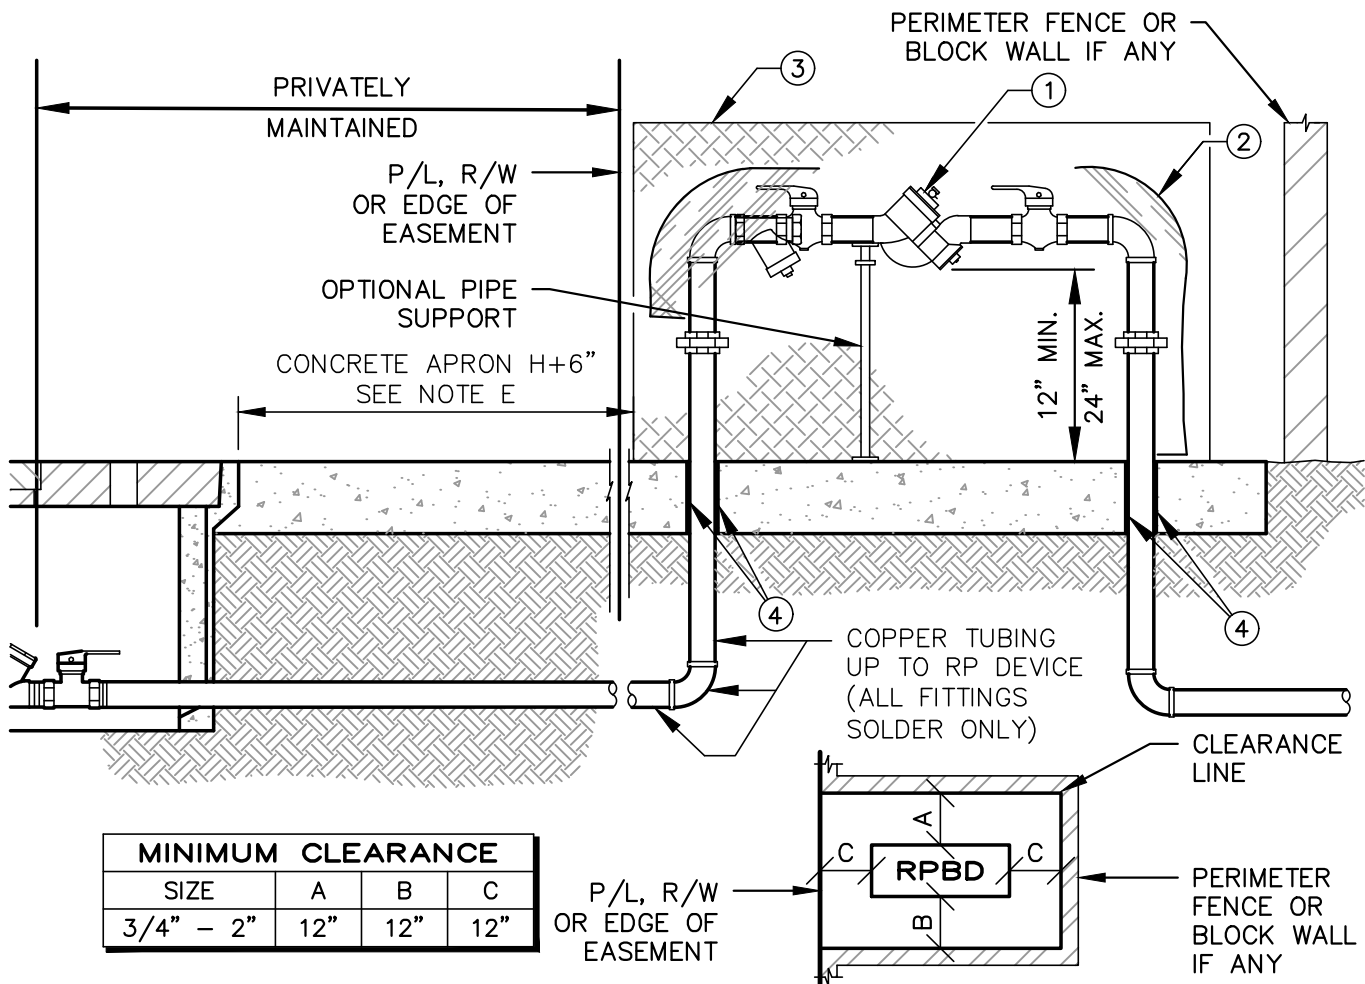


ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION DEVICE (LEAD FREE)		4-A
2	INSULATING BAG		4-B
3	ALL SPEC BACKFLOW ENCLOSURE		13-L
4	BOND BREAKER		5-A, B, C
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	2" & SMALLER REDUCED PRESSURE BACKFLOW DEVICE INSTALLATION	W-39
4/24/2026	STAFF		
		FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:


- A. CURRENT (WITHIN 12 MONTHS) TESTING CERTIFICATION FOR RPBD MUST BE AVAILABLE ON JOB SITE AT ALL TIMES WHILE RPBD IS IN USE.

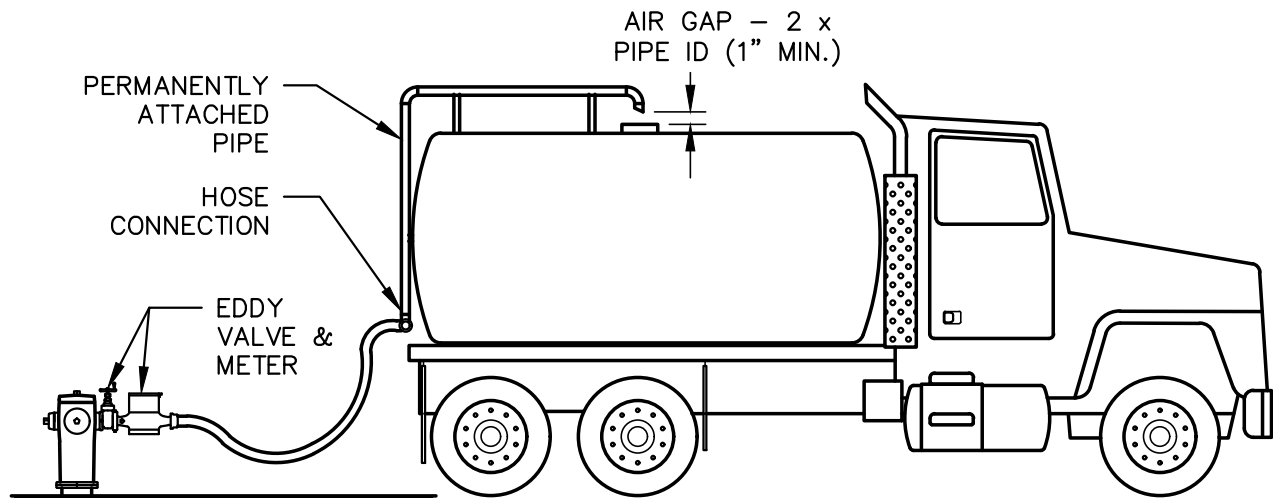

WITH AIR GAP

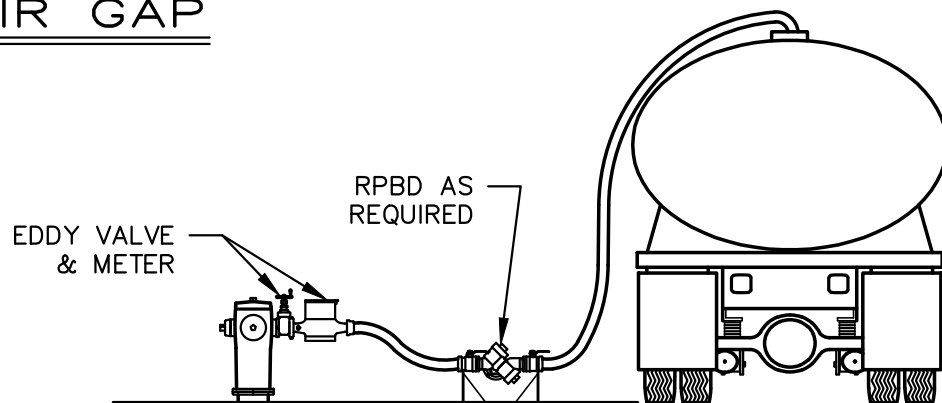

WITH PORTABLE ASSEMBLY

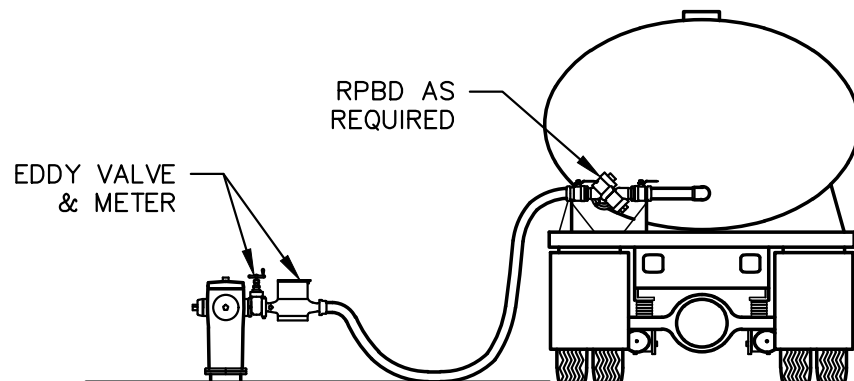


WITH TRUCK MOUNTED ASSEMBLY

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV. DATE	BY	MINIMUM PROTECTION FOR FILLING WATER TRUCKS	W-40
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

NOTES:

- WATER MAINS (4") DIAMETER AND SMALLER SHALL HAVE A SHORT SECTION OF PIPE REMOVED AND PIPE ENDS ENCASED IN CONCRETE.
- EXISTING MAIN TO BE PLUGGED WITH CONCRETE OR PRESSURE GROUTED AT INTERVALS OF ABOUT 200' OR AS DIRECTED BY THE CITY ENGINEER.
- EXISTING MAINS 16" AND LARGER REQUIRE THE ENTIRE LENGTH OF THE PIPE TO BE FILLED BY PRESSURE GROUTING OR BY BLOWN SAND.
- EXISTING VALVES SHALL BE TURNED TO THE CLOSED POSITION. REMOVE VALVE CAN AND REPLACE WITH COMPACTED BACKFILL.
- PRIOR CITY APPROVAL REQUIRED FOR CUTTING AND PLUGGING.

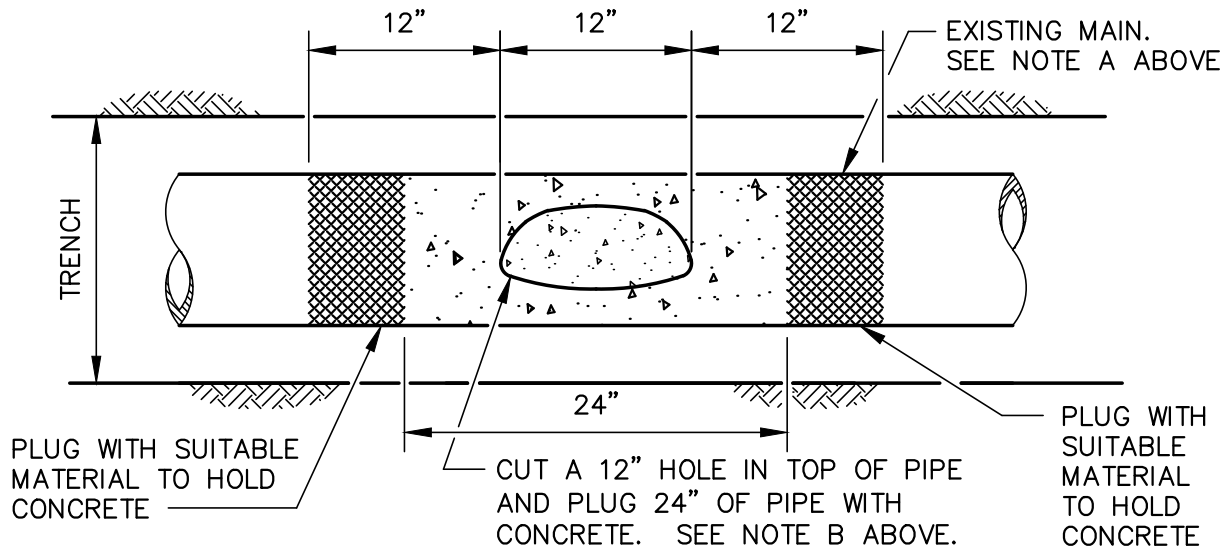


MIDDLE OF EXISTING MAIN

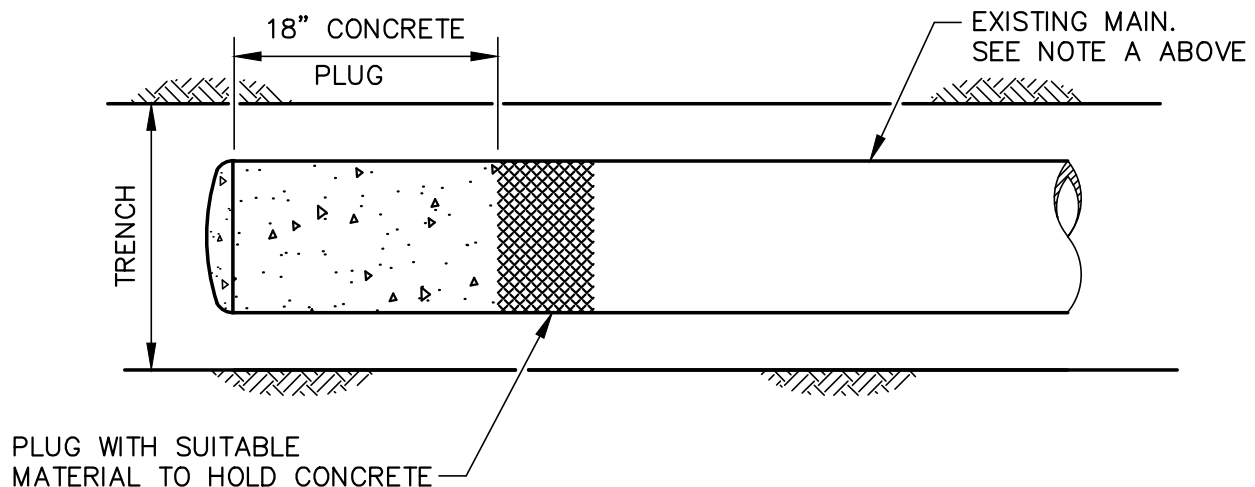

ENDS OF EXISTING MAIN

LEGEND ON PLANS: ———— E ———— ————

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	CUTTING AND PLUGGING ABANDONED WATER MAINS	W-41
4/24/2026	STAFF		
		<i>FAB</i> FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1

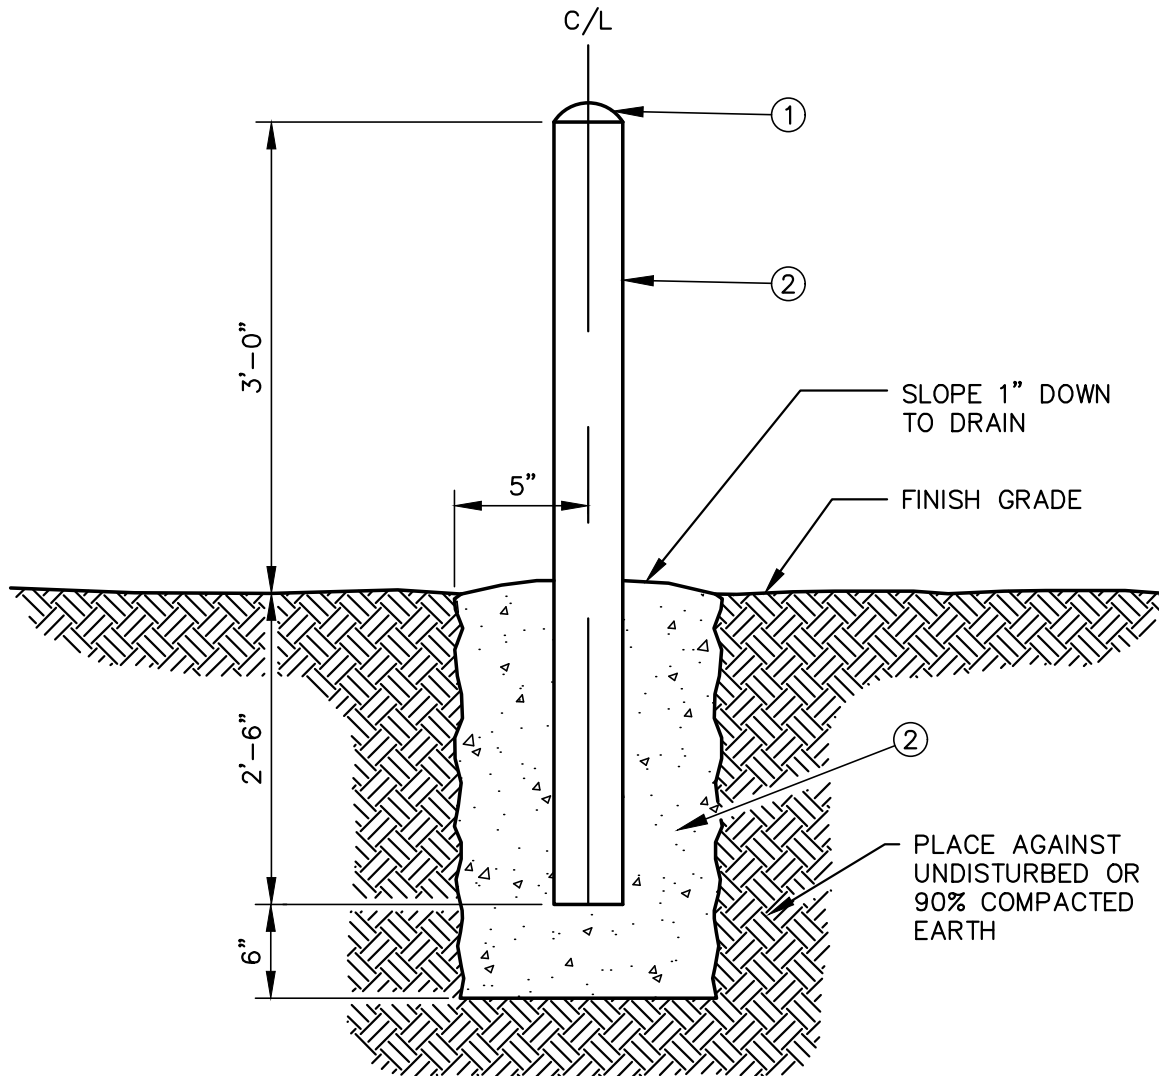

ITEM	DESCRIPTION		APPROVED MATERIAL LIST NUMBER
1	FILL PIPE WITH CONCRETE & ROUND OVER TO FORM CAP		
2	4"Ø x 5'6" SCH. 40 GALVANIZED STEEL PIPE – PAINT YELLOW		
3	CONCRETE FOOTING, 10" DIAMETER		
CITY OF VICTORVILLE - ENGINEERING DEPARTMENT			
REV. DATE	BY	GUARD POST	W-42
4/24/2026	STAFF		
		 FREDY A. BONILLA, CITY ENGINEER	SHEET 1 OF 1